

LADDER WARNING SIGNS

1. GENERAL

1.01 This appendix covers the description and installation of the ladder warning sign.

Note: This sign shall be mounted on all rolling ladders.

1.02 It is reissued to include the appropriate legend on Page 1 in accordance with AT&T's "Guidelines and Procedures for Safeguarding Information" and Pacific Company's System Instruction (SI) 178.

Note: Marginal arrows used to denote changes are omitted.

1.03 For ladder block replacements, order the block indicated in the main section.

2. APPARATUS

- Form P 2265 — Ladder Warning Sign

3. DESCRIPTION

3.01 The ladder warning sign, Form P 2265, is shown in Fig. 1.


3.02 The sign is 6-inches high, 10-inches wide and is made of flexible flame retardant material with luminescent colors for the background, making the sign readable in semi-darkness.

4. INSTALLATION AND MAINTENANCE

4.01 The ladder warning sign shall be hung from ALL rolling ladders as follows:

- (a) It should be located about eye level, usually on the underside of the seventh step.
- (b) It should be installed *neatly* so that it can be easily read *at all times*.

4.02 Periodically, inspect these signs for ease of visibility and condition. When the existing signs become mutilated or broken loose, replace with the new flexible flame retardant type.

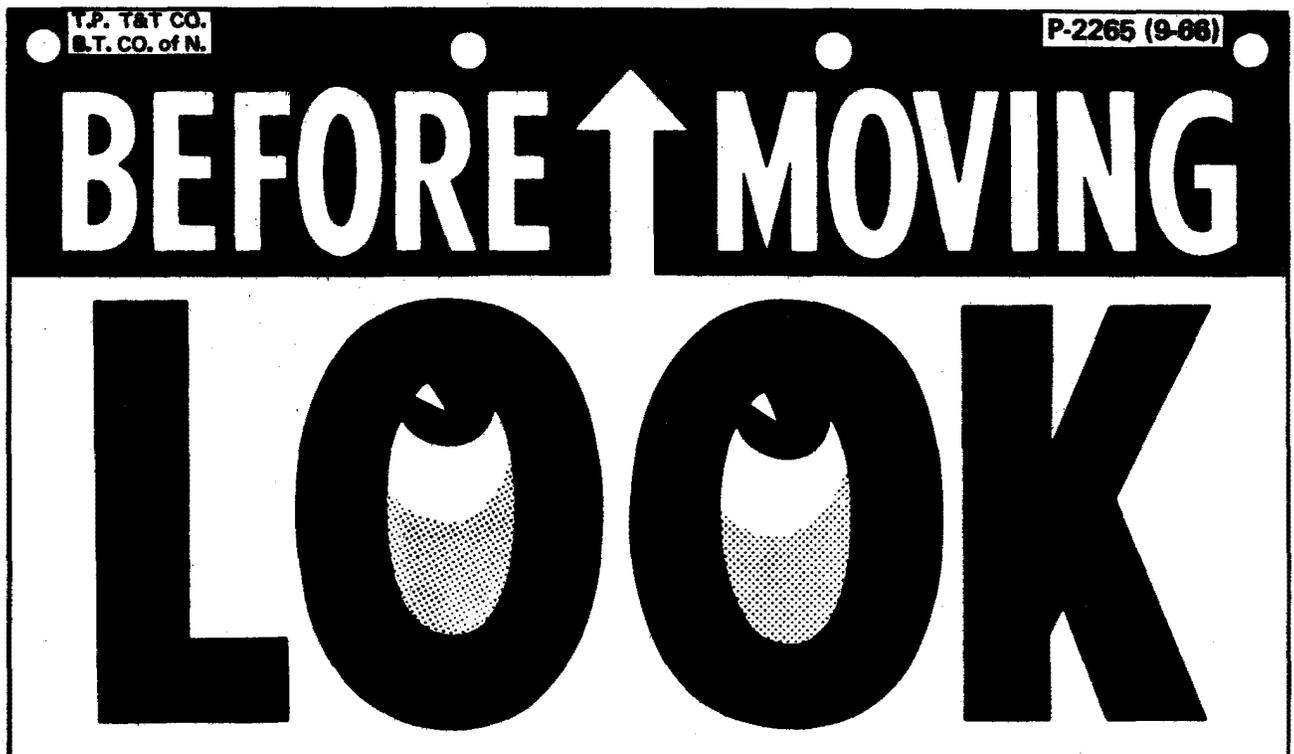

Form P 2265

Fig. 1

NOTICE

Not for use or disclosure outside the
Bell System except under written agreement

Printed in U.S.A.