BELL SYSTEM PRACTICES
Plant Series

SECTION 310-530-901 LL
Appendix 3
Issue A, April 1968
Long Lines Department

GP 8246

SS1 Codes

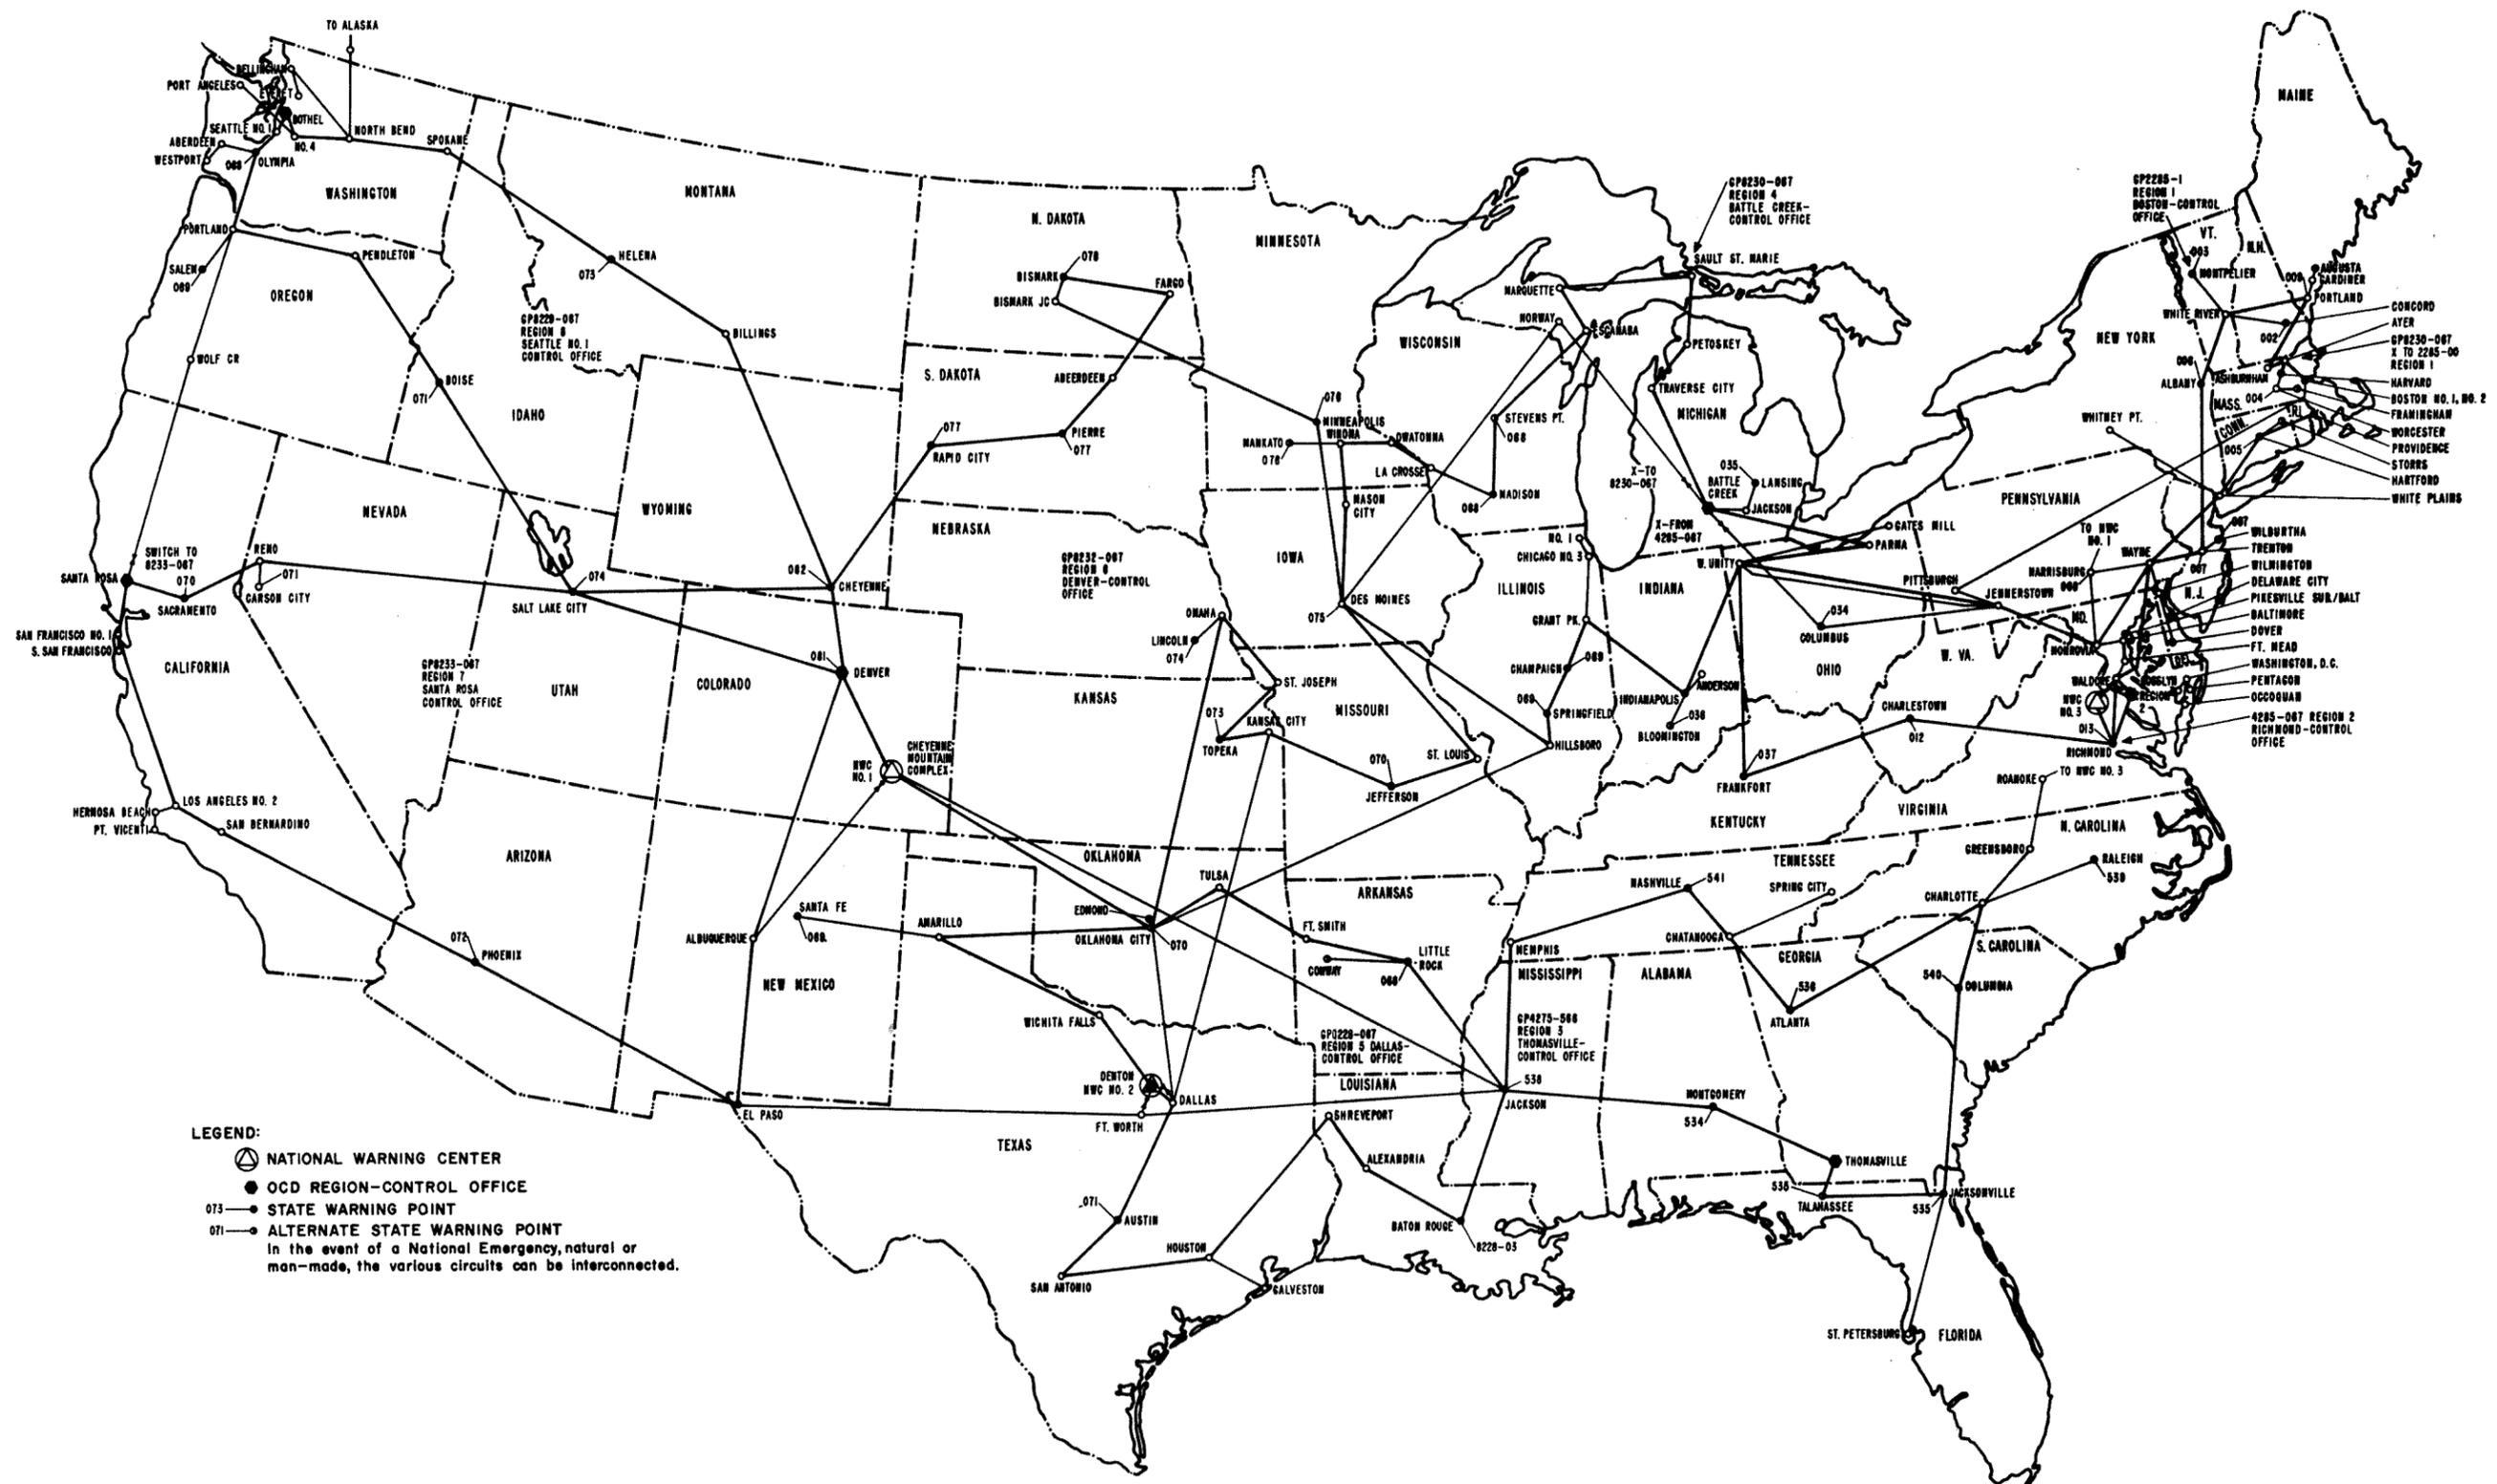|		
Battle Creek Region 4		5-2
Colorado Springs		0-0
Denton Region 5 WC 2		6-2
Everett Region 8		9-2
Derwood Region 2		3-2
Computer		3-3
Harvard Region 1		2-3
Lakewood Region 6		7-2
Santa Rosa Region 7		8-2
Thomasville Region 3		4-2
Warning Center 3	Warning	2-4
	OEP	2-5
All Stations		3-0
Thomasville Connect 2207-8246		4-4
Region 3 Disconnect		4-5
Region 7 Connect 8229-67 to 8233-67		8-4
Santa Rosa Disconnect		8-5
Region 1 Connect 2285-1 to 8230-67		2-6
Harvard Disconnect		2-7
Region 1 Connect 2206-8246		3-6
Harvard Disconnect		3-7
Pentagon		
Room 3E340		0-5
Room 3D347		0-6
Region 8-Bothel		9-5
Region 4 Connect 4285-067 to 8230-067		3-5
Battle Creek Disconnect		5-5
Suitland, Md.		0-9
Region 4 Connect 8232-67 to 8230-67		5-3
Battle Creek Disconnect		5-4
Conference All Regions		3-4
Disconnect Conference		3-8
Region 5 Connect 8233-67 to 8228-67		6-3
Denton Disconnect		6-4
Region 5 Connect 8232-67 to 8228-67		6-5
Denton Disconnect		6-6

Fig. 1 — Private Line Telephone Service, OCD
National Warning System (NAWAS)

LEGEND:
△ NATIONAL WARNING CENTER
● OCD REGION-CONTROL OFFICE
073 ●─── STATE WARNING POINT
071 ●─── ALTERNATE STATE WARNING POINT
In the event of a National Emergency, natural or
man-made, the various circuits can be interconnected.