

SERVICE 570 TELEPHONE SETS

1. GENERAL

1.01 The 8-type apparatus units contain all the electrical components of the 570-type (emergency reporting) telephone sets.

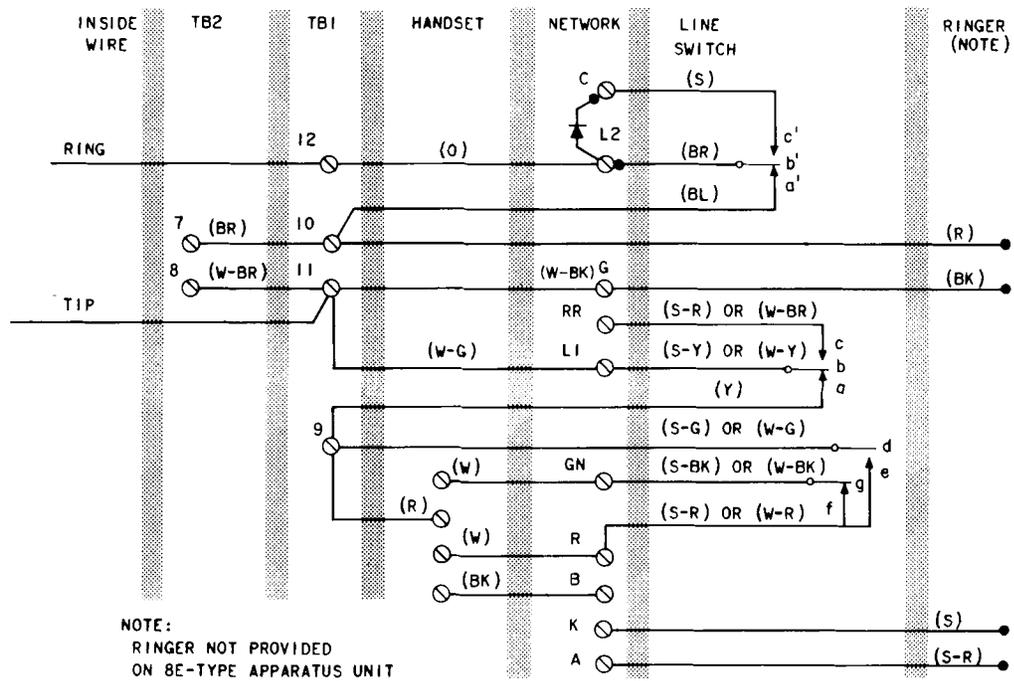


Fig. 1—8A (MD) and 8E (MD) Apparatus Units, Connections

SECTION 502-580-455

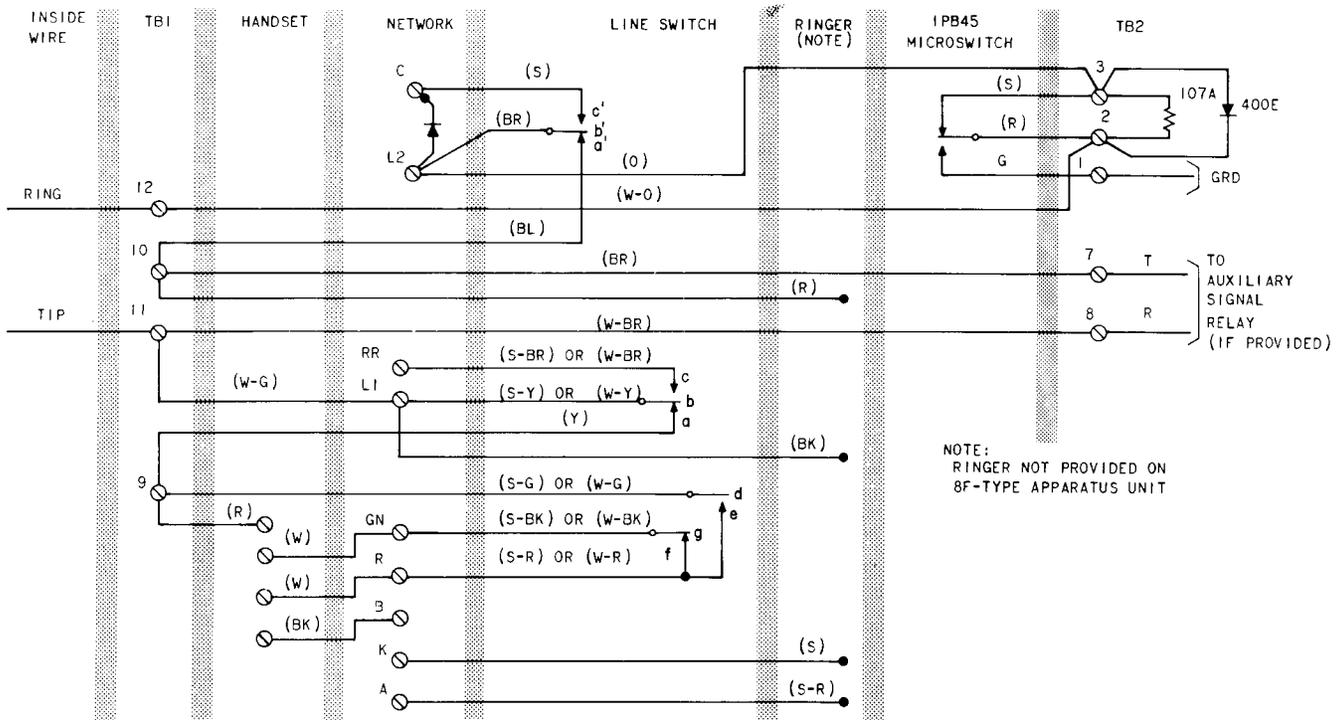


Fig. 2—8B (MD) and 8F (MD) Apparatus Units, Connections

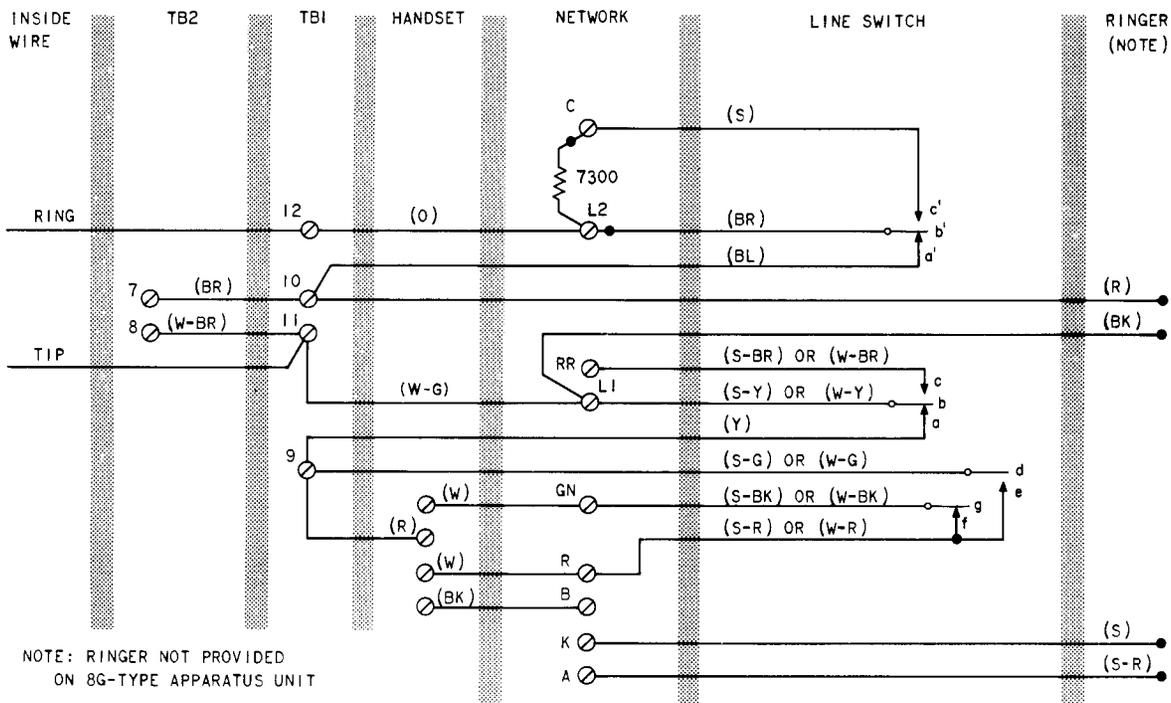


Fig. 3—8C (MD) and 8G (MD) Apparatus Units, Connections


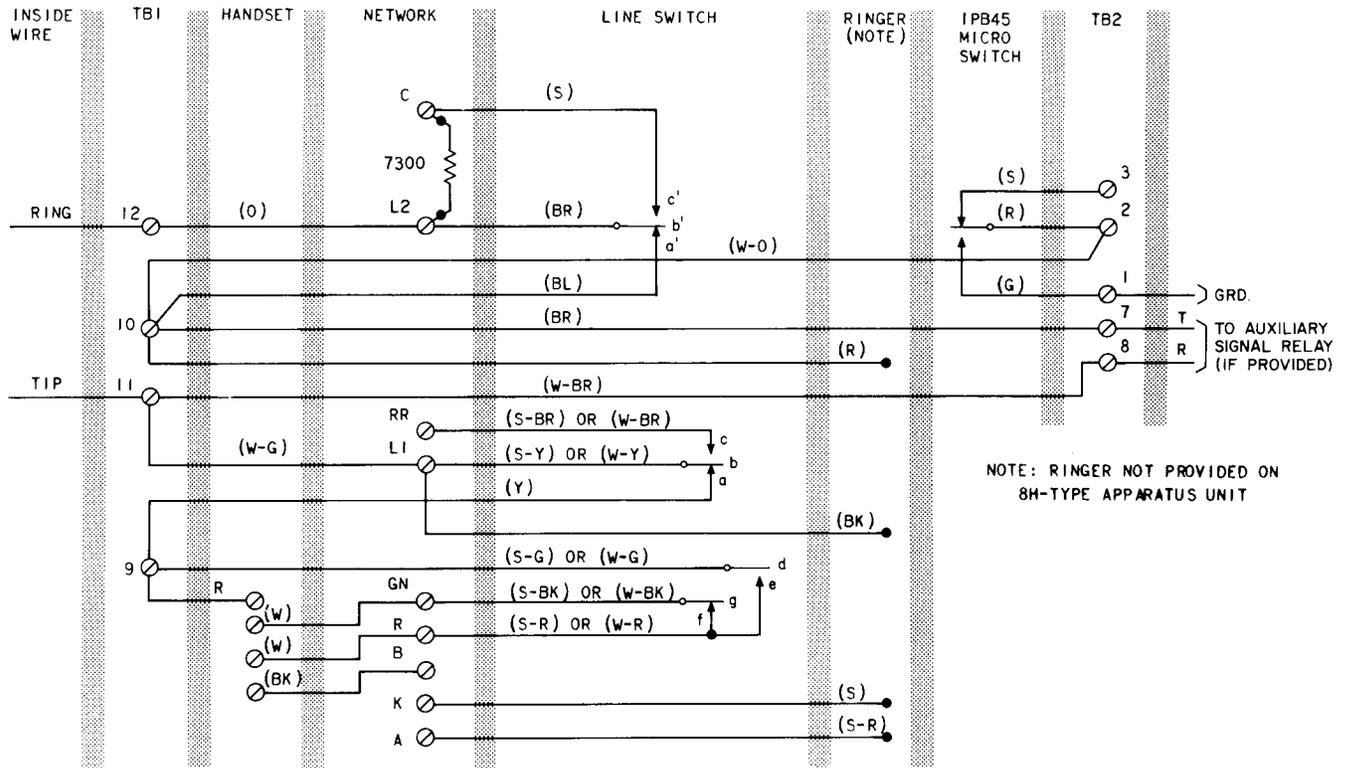


Fig. 4—8D (MD) and 8H (MD) Apparatus Units, Connections

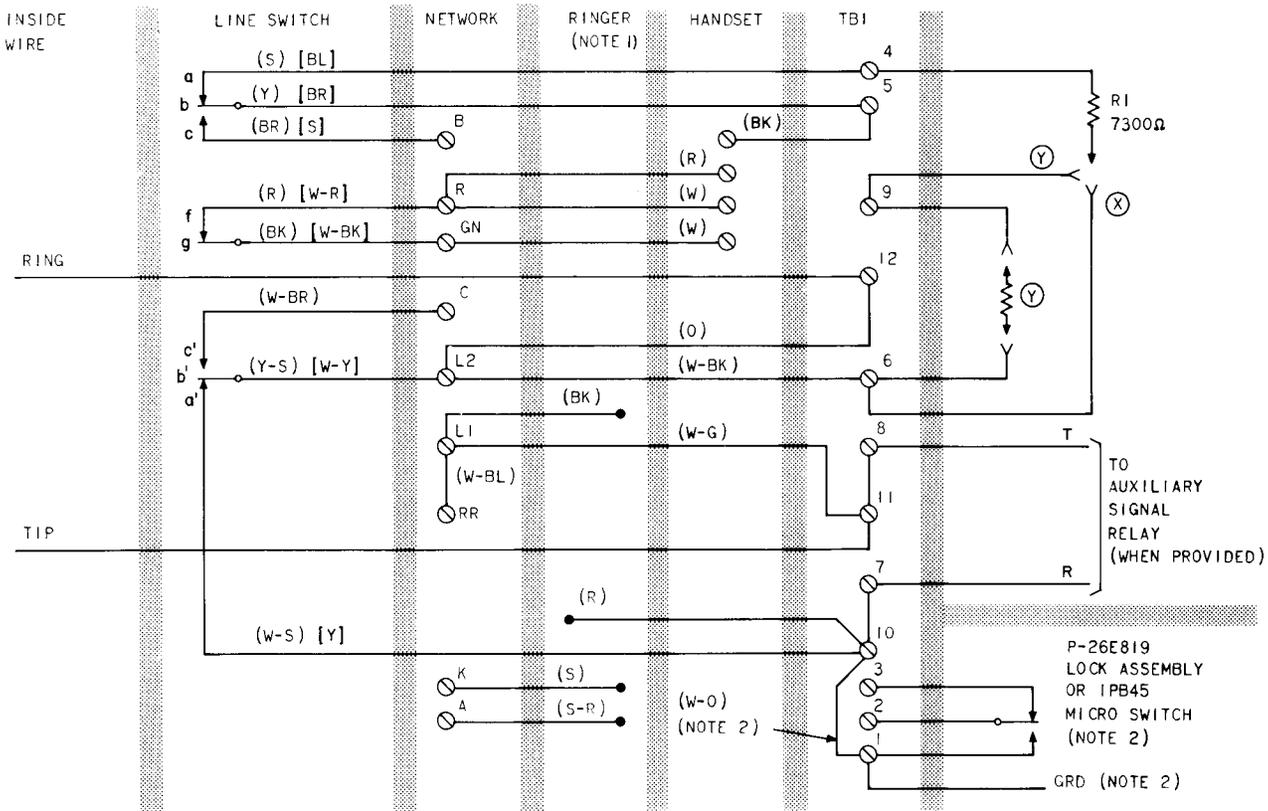

NOTES:

1. RINGER NOT PROVIDED IN 8N- AND 8P-TYPE APPARATUS UNIT
 2. NOT PROVIDED ON 8J- AND 8N-TYPE APPARATUS UNIT
- (X) FACTORY WIRING ARRANGEMENT
 (Y) UNIGAGE OUTSIDE PLANT
 (KS-14603L2C 3700 OHM) RESISTOR
 () CURRENT COLOR CODE
 [] MD COLOR CODE

Fig. 5—8J-, 8K-, 8N-, and 8P-Type Apparatus Units, Connections

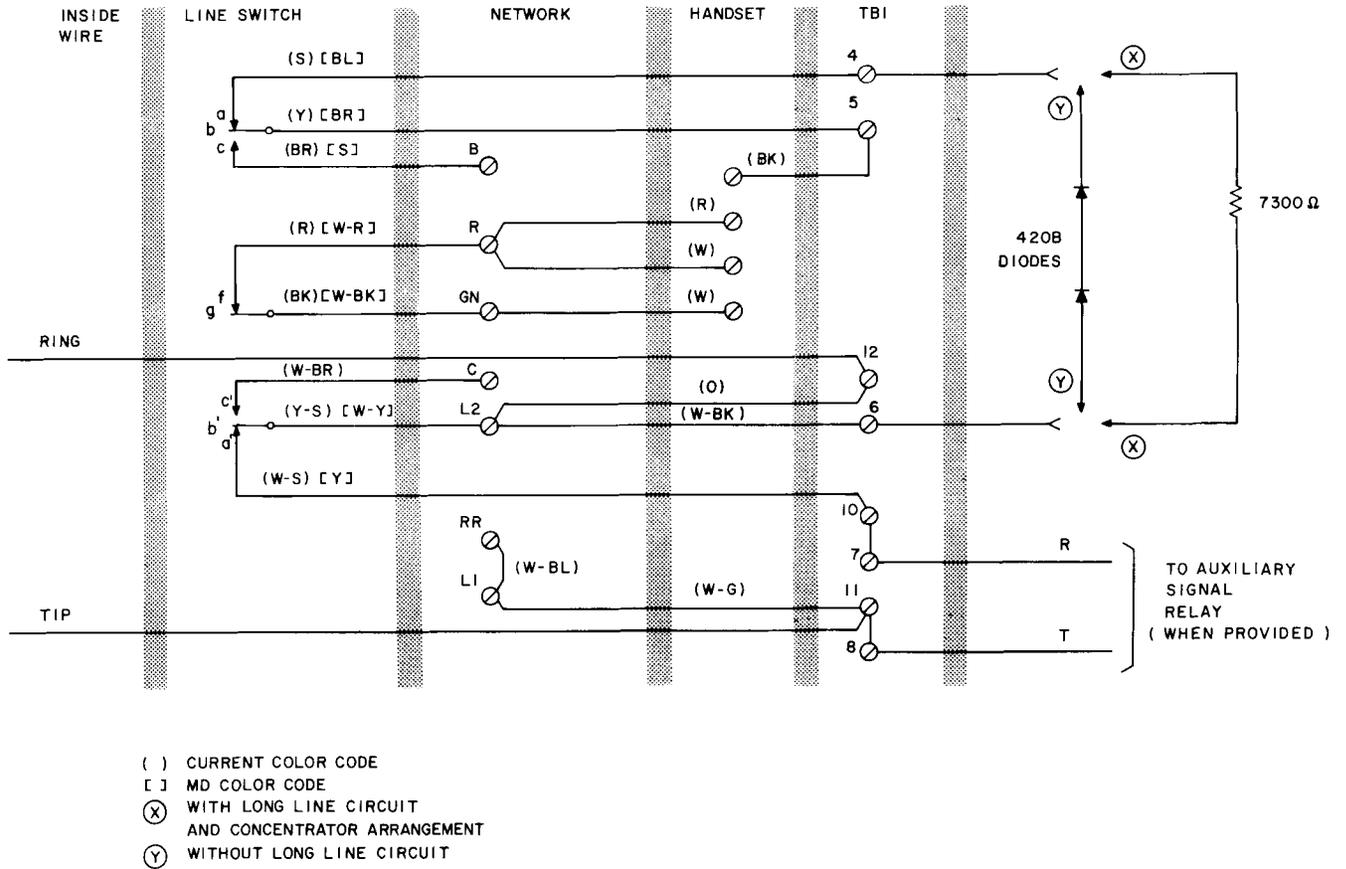


Fig. 6—8L-Type Apparatus Unit, Connections

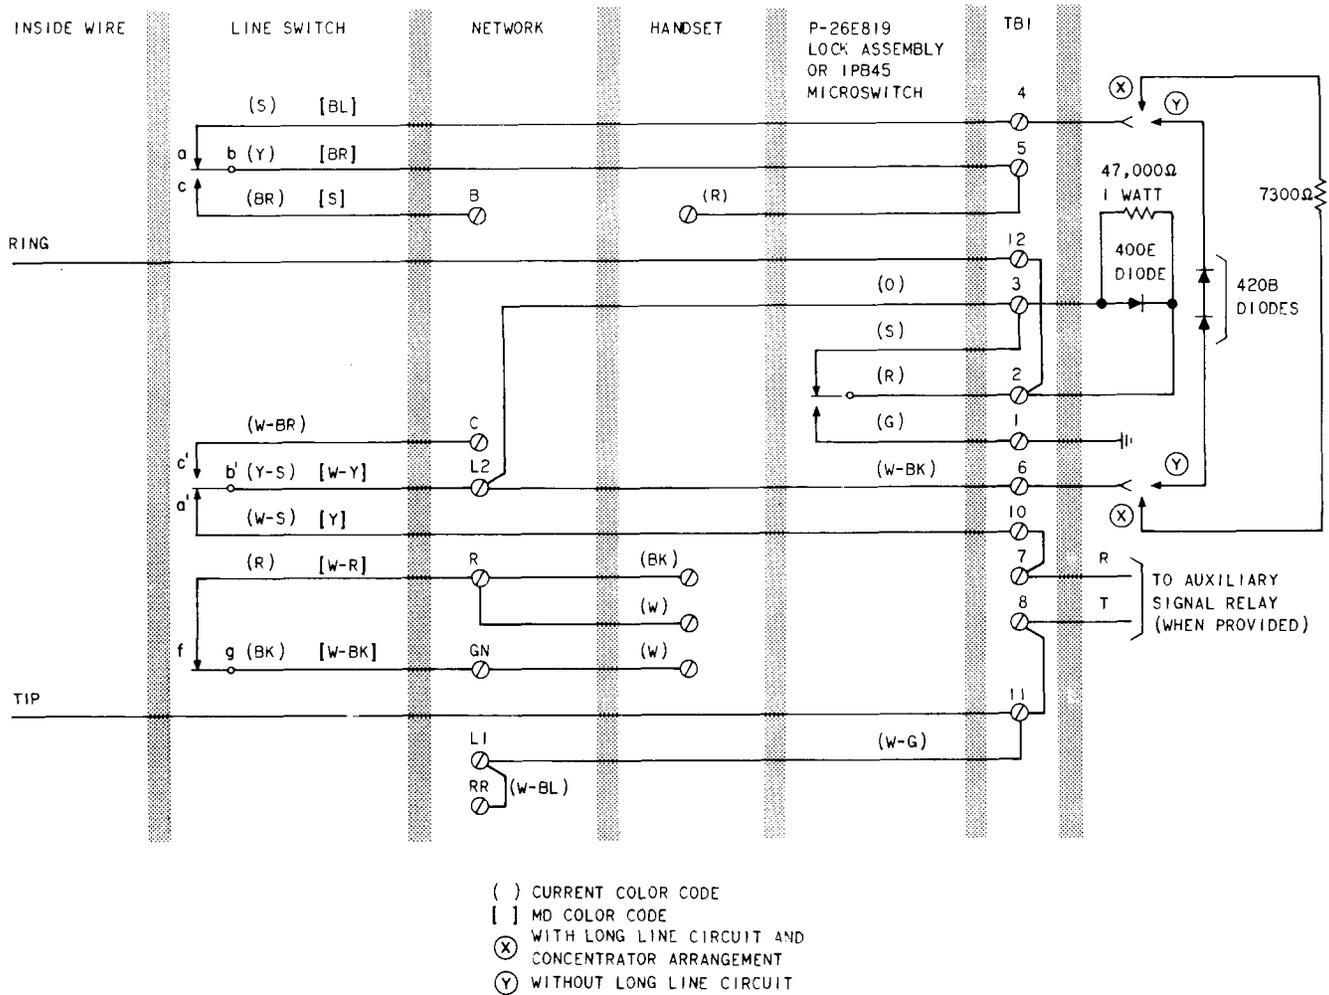


Fig. 7—8M-Type Apparatus Unit, Connections

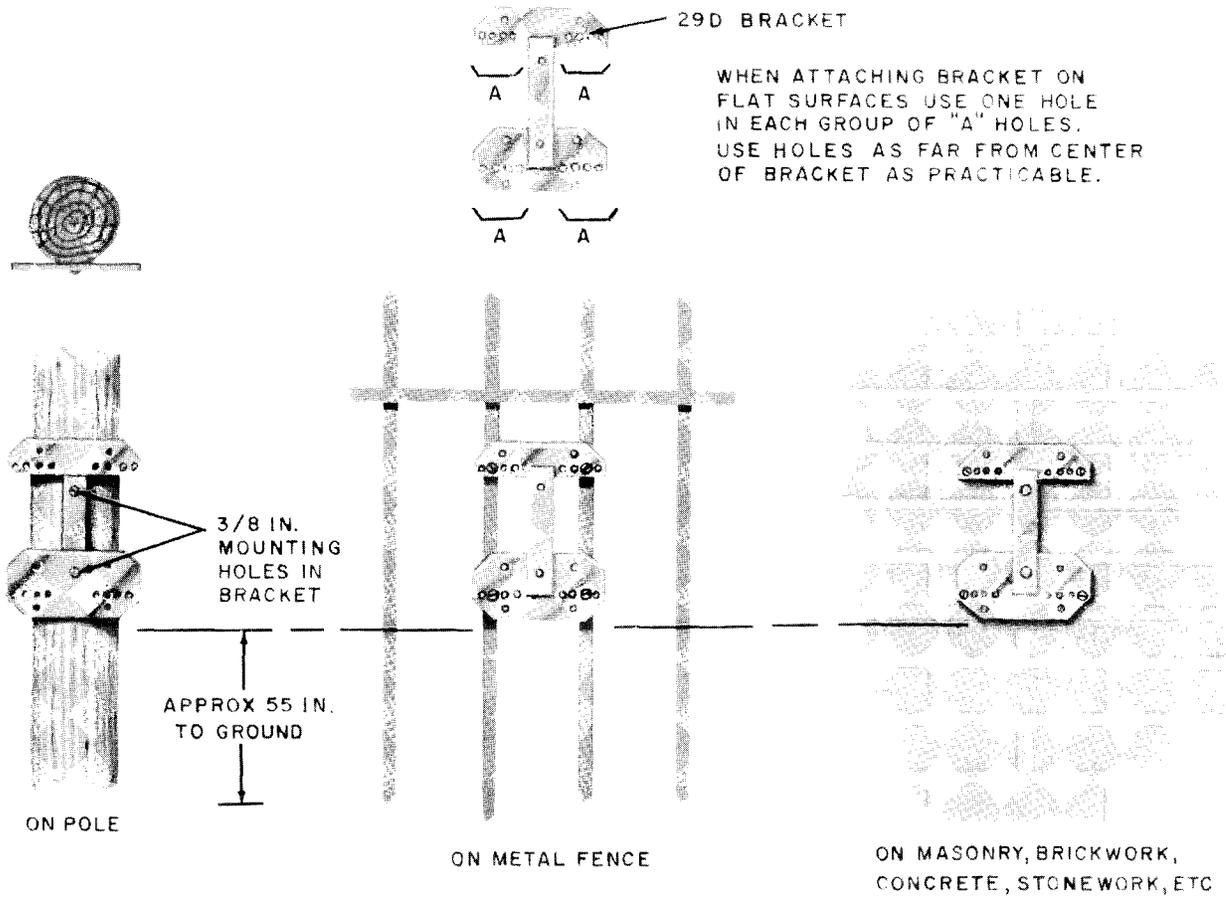


Fig. 8—29-Type Bracket Mounted on Various Surfaces

TABLE A
FASTENERS FOR 29-TYPE APPARATUS BRACKETS

SURFACE	QUAN	FASTENERS
Wood	4	1-1/2 in. No. 14 RH galvanized wood screws
Wood poles	4	2-1/2 in. or longer No. 14 RH galvanized wood screws
Wood poles (where diameter of pole is 8 inches or less)	2	5/16 x 3 in. coach screws or 2-1/2 in. or longer No. 14 RH galvanized wood screws
Finished masonry, brickwork, concrete, etc	4	5/16 x 2-1/4 in. hammer drive anchors, or approved equivalent
Solid metal — metal fences, columns, etc*	4	1 x 5/16 in. No. 18 RH brass machine screws. Drill and tap holes using 17/24 in. drill and 5/16 in. No. 18 tap
Hollow tile, corrugated metal, plaster board, etc	4	1/4 x 4 in. RH toggle bolts

* Iron straps, bolts, etc may be used where local instructions permit. Attach telephone set securely.