

PLEASE NOTE AND RETURN:

BURNS, J. G. 3
DUMINS, G. C. 0
JACKSON, C. C. 5
KLAISS, M. J. 5
FERRIN, A. B. 10

TELEPHONE SETS—623A3 AND 1623A3

CONNECTIONS

(RESTRICTED DISTRIBUTION)

I. GENERAL

I.01 This section contains connection information on the 623A3 and 1623A3 telephone sets when used with the master control panel of the ESS office.

I.02 Relays necessary for switching from handset to headset operation are shown, but are not designated.

I.03 Fig. 1 and 2 show the following:

- Telephone set circuitry.
- 599G key (first position).
- 598A key (second and third position).
- D120E mounting cord.
- Connections to ESS office equipment.



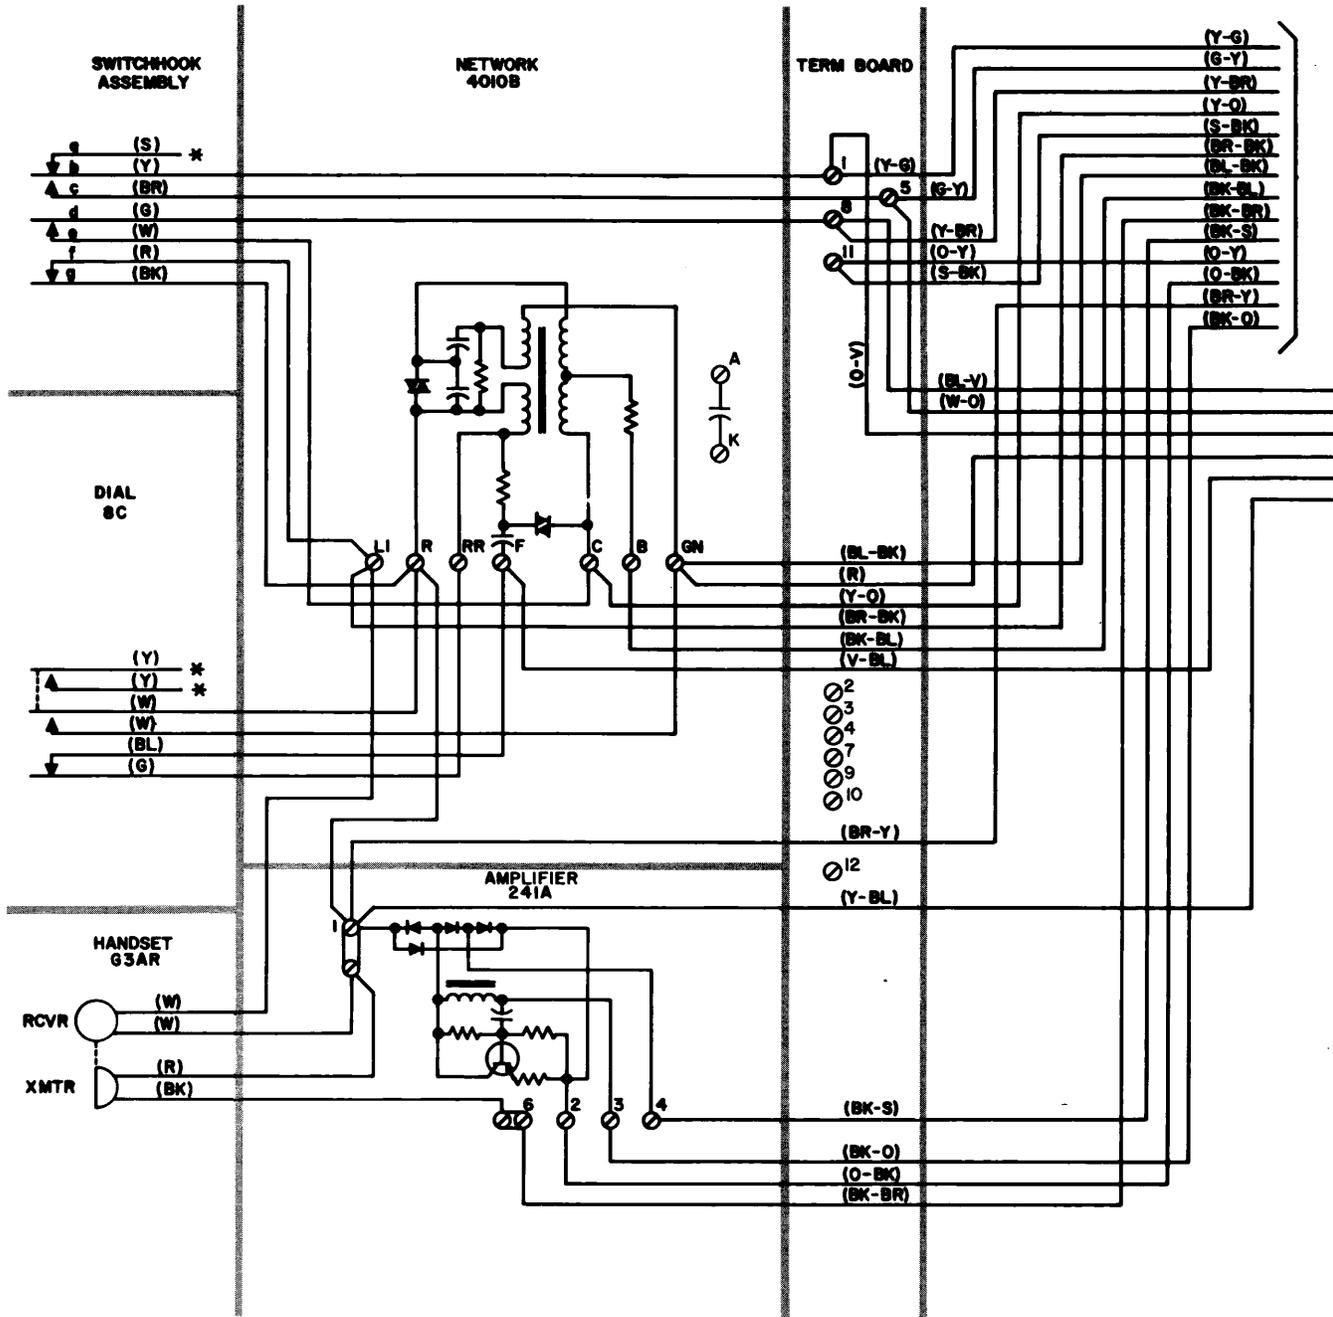


Fig. 1 - 623A3 Telephone Set, Connections

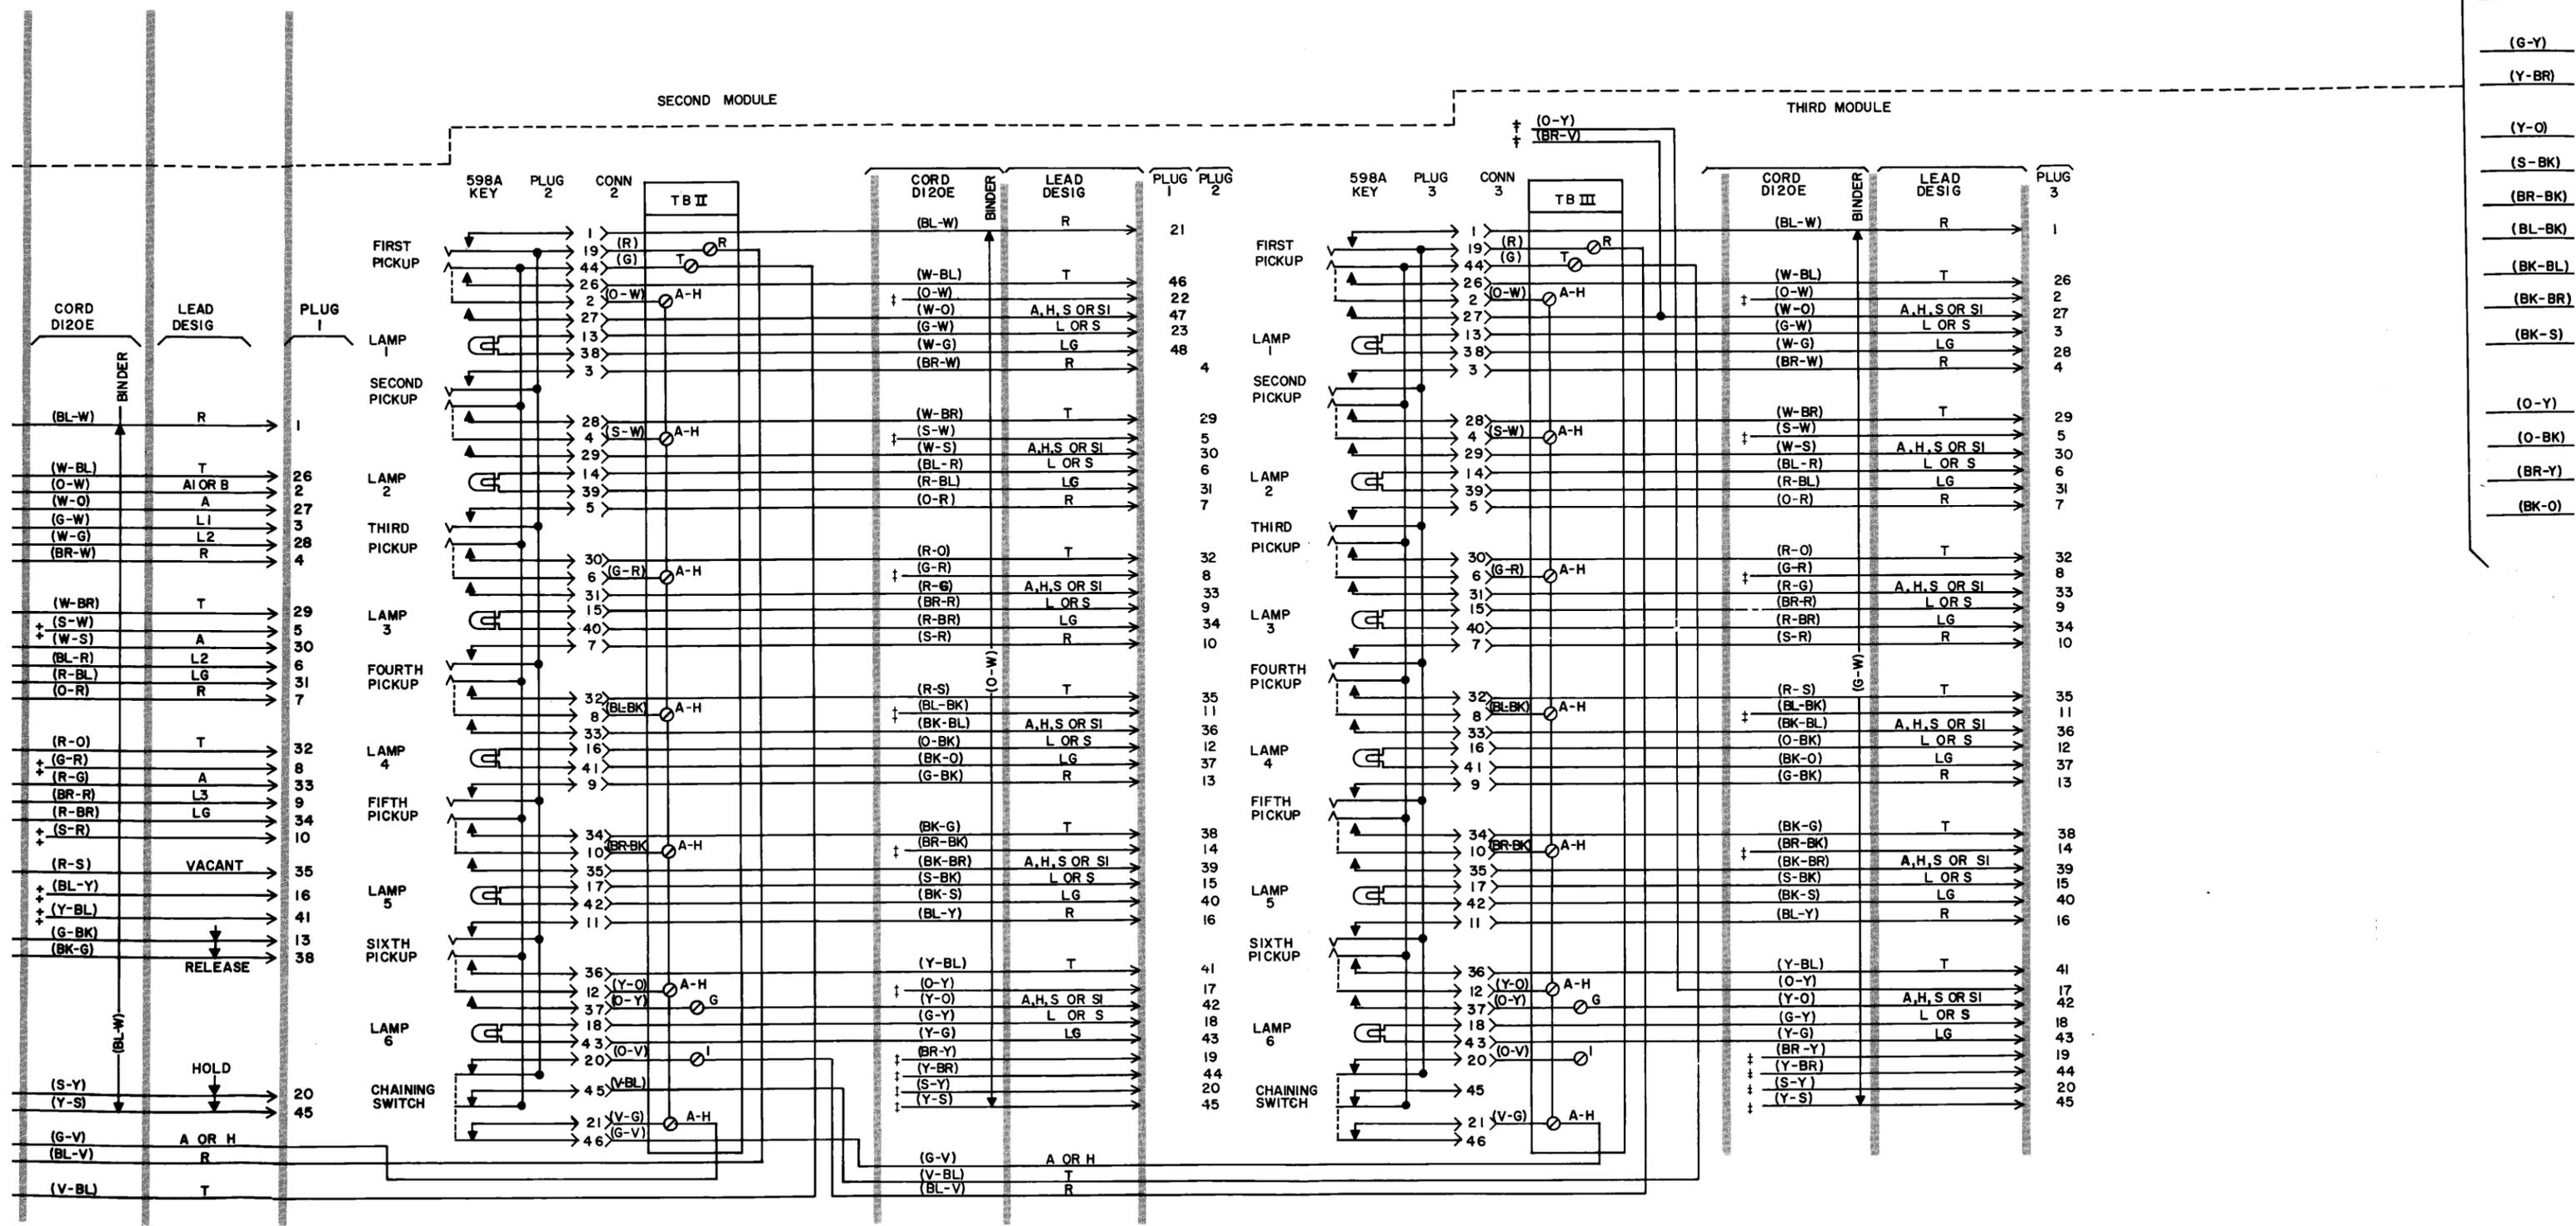

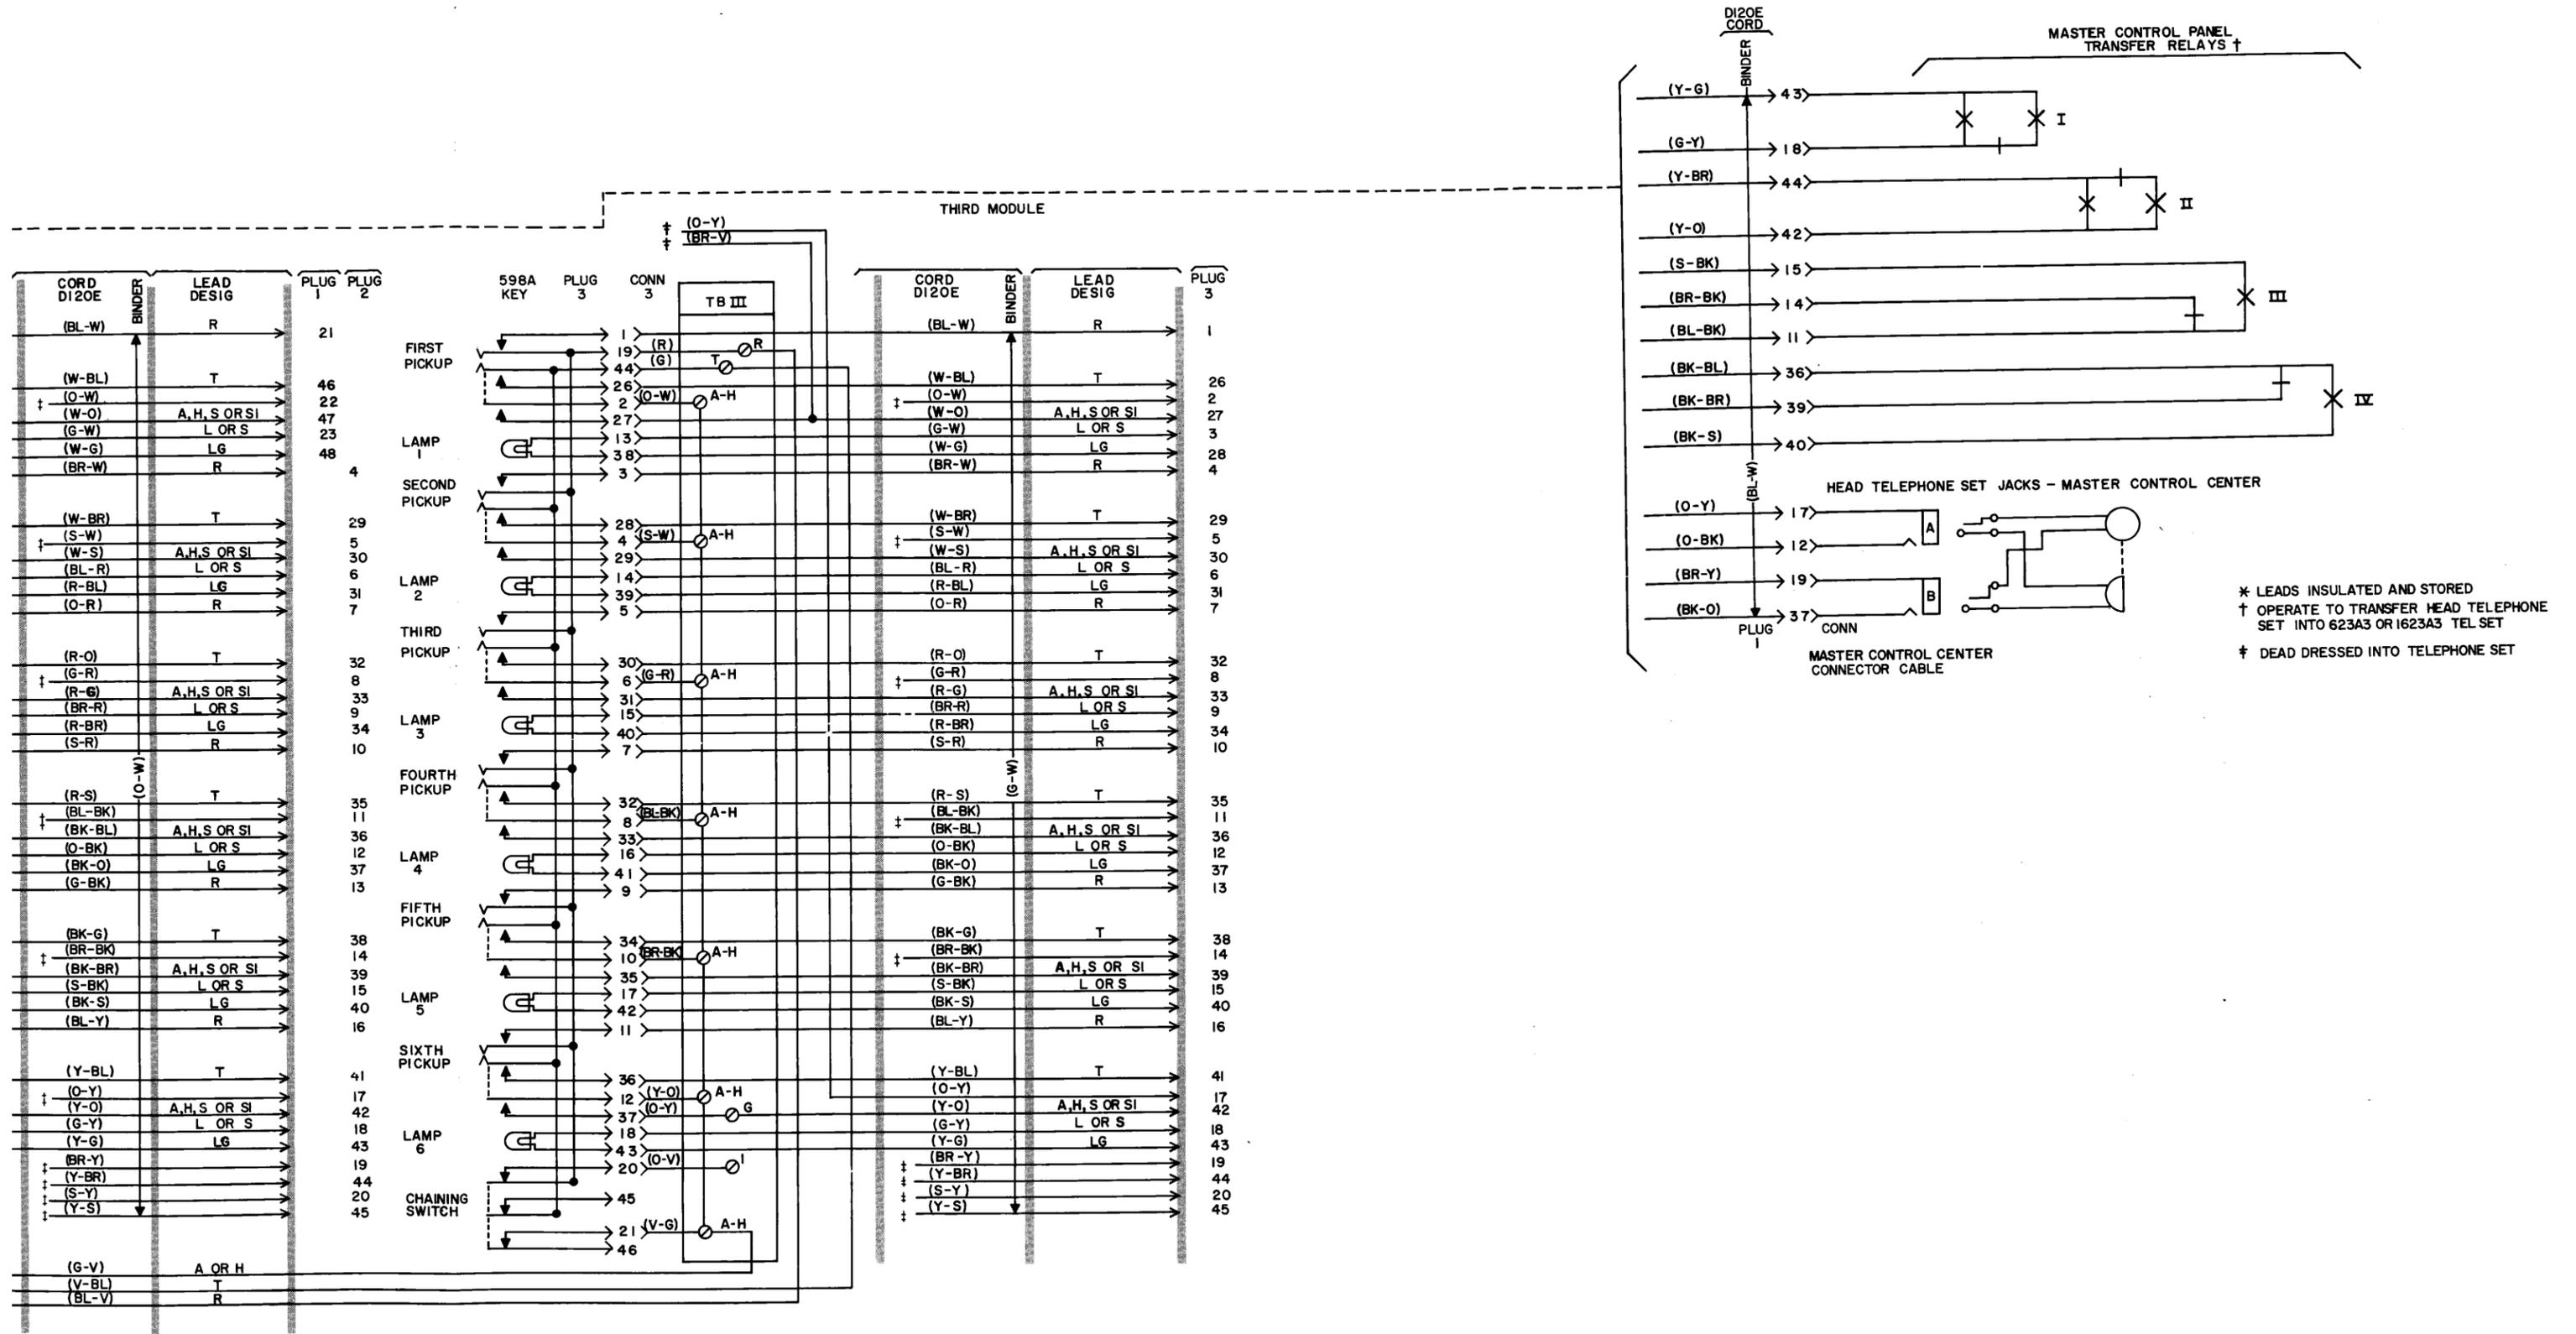

* LEADS INSULATED AND STORED
 † OPERATE TO TRANSFER HEAD TELEPHONE SET INTO 623A3 OR 1623A3 TEL SET
 ‡ DEAD DRESSED INTO TELEPHONE SET

Fig. 2 - 1623A3 Telephone Set, Connections