

REPLACING PAGE ADDENDUM

Filing Instructions:

1. REMOVE FROM THE SECTION THE PAGES NUMBERED THE SAME AS THOSE ATTACHED TO THIS PINK SHEET.
2. INSERT THE ATTACHED PAGES INTO THE SECTION IN THEIR PLACE.
3. PLACE THIS PINK SHEET AHEAD OF PAGE 1 OF THE SECTION.

**KEY TELEPHONE SYSTEMS
STATION ARRANGEMENTS FOR 2- AND 4-WIRE
PRIVATE LINE SERVICE
CONNECTIONS**

1. GENERAL

1.001 This addendum supplements Section 518-610-401, Issue 3. The attached page must be inserted in the section in accordance with the filing instruction above.

1.002 This addendum is issued to correct strapping of 248B KTU shown in Fig. 1.

Attached:

Page 3 dated July 1967, revised

Page 4 dated July 1967, reissued


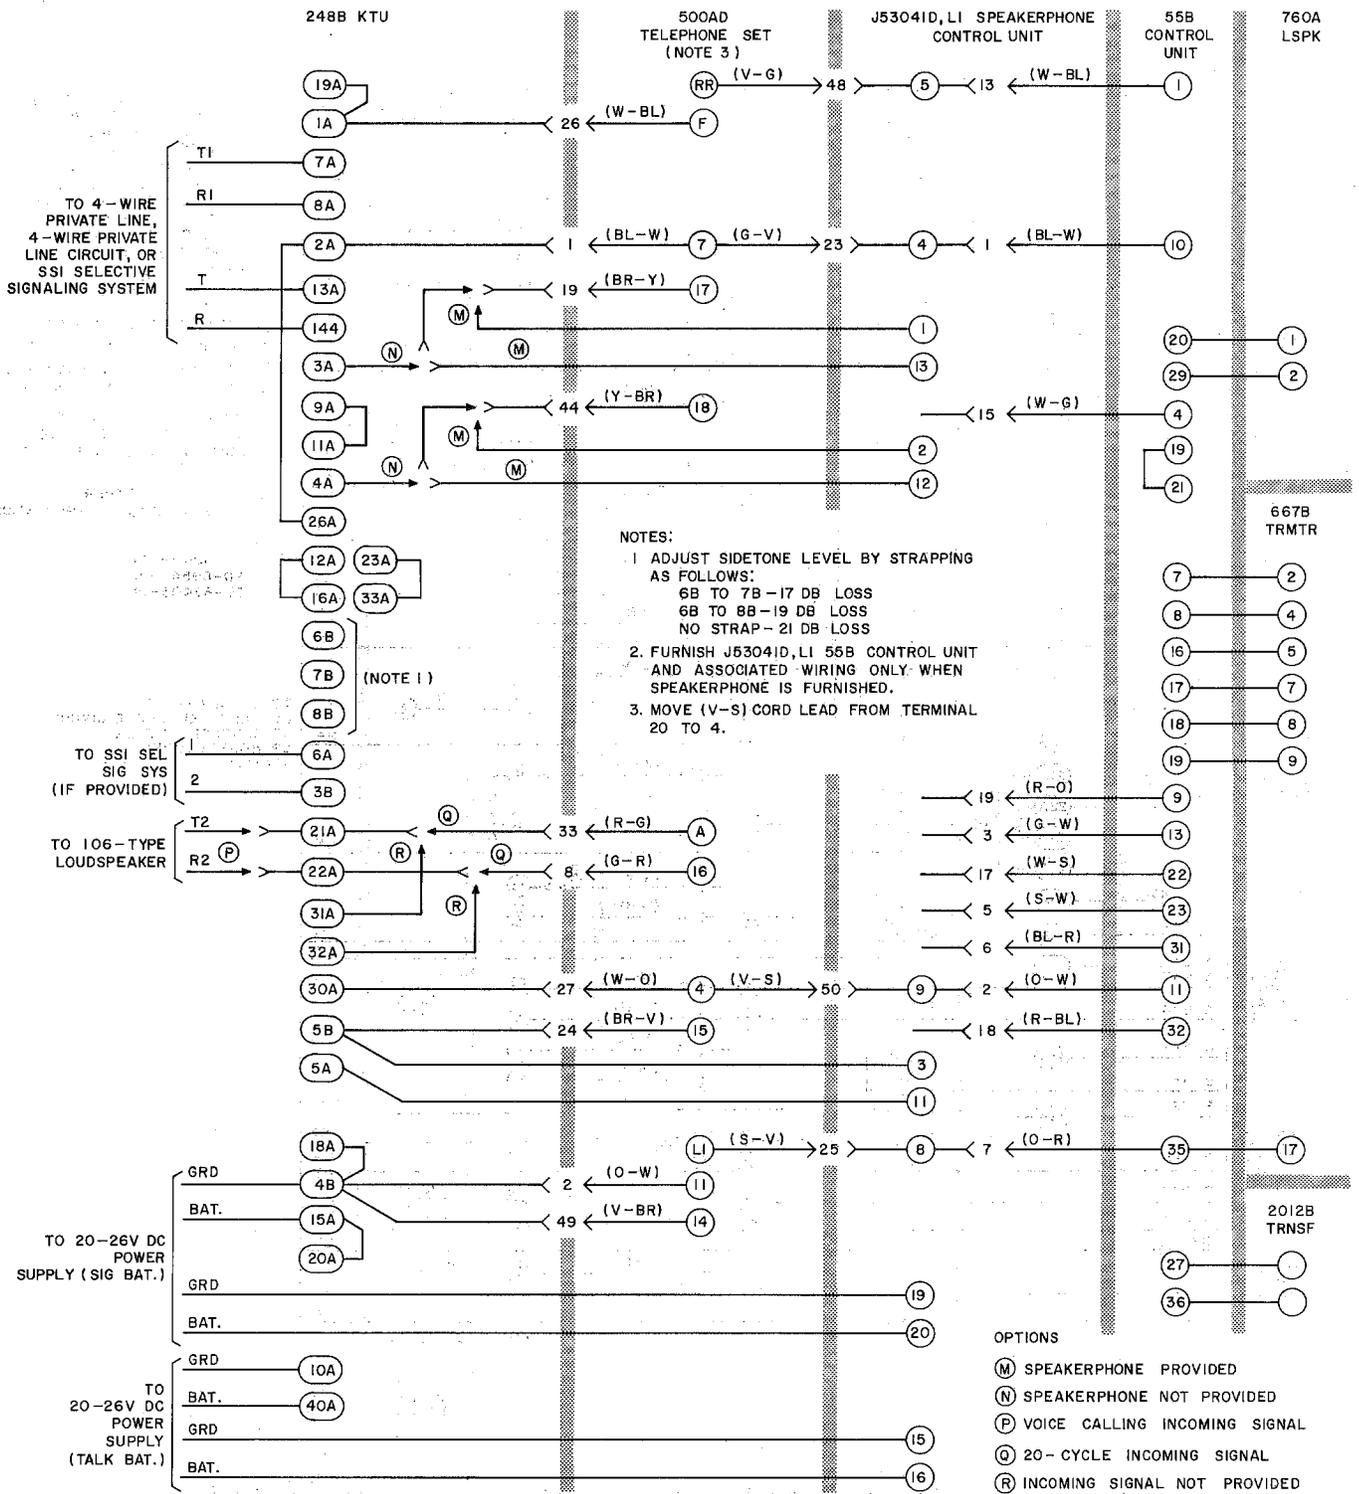


Fig. 1 - Connections for 4-Wire Service - Single Line Telephone Set

SECTION 518-610-401

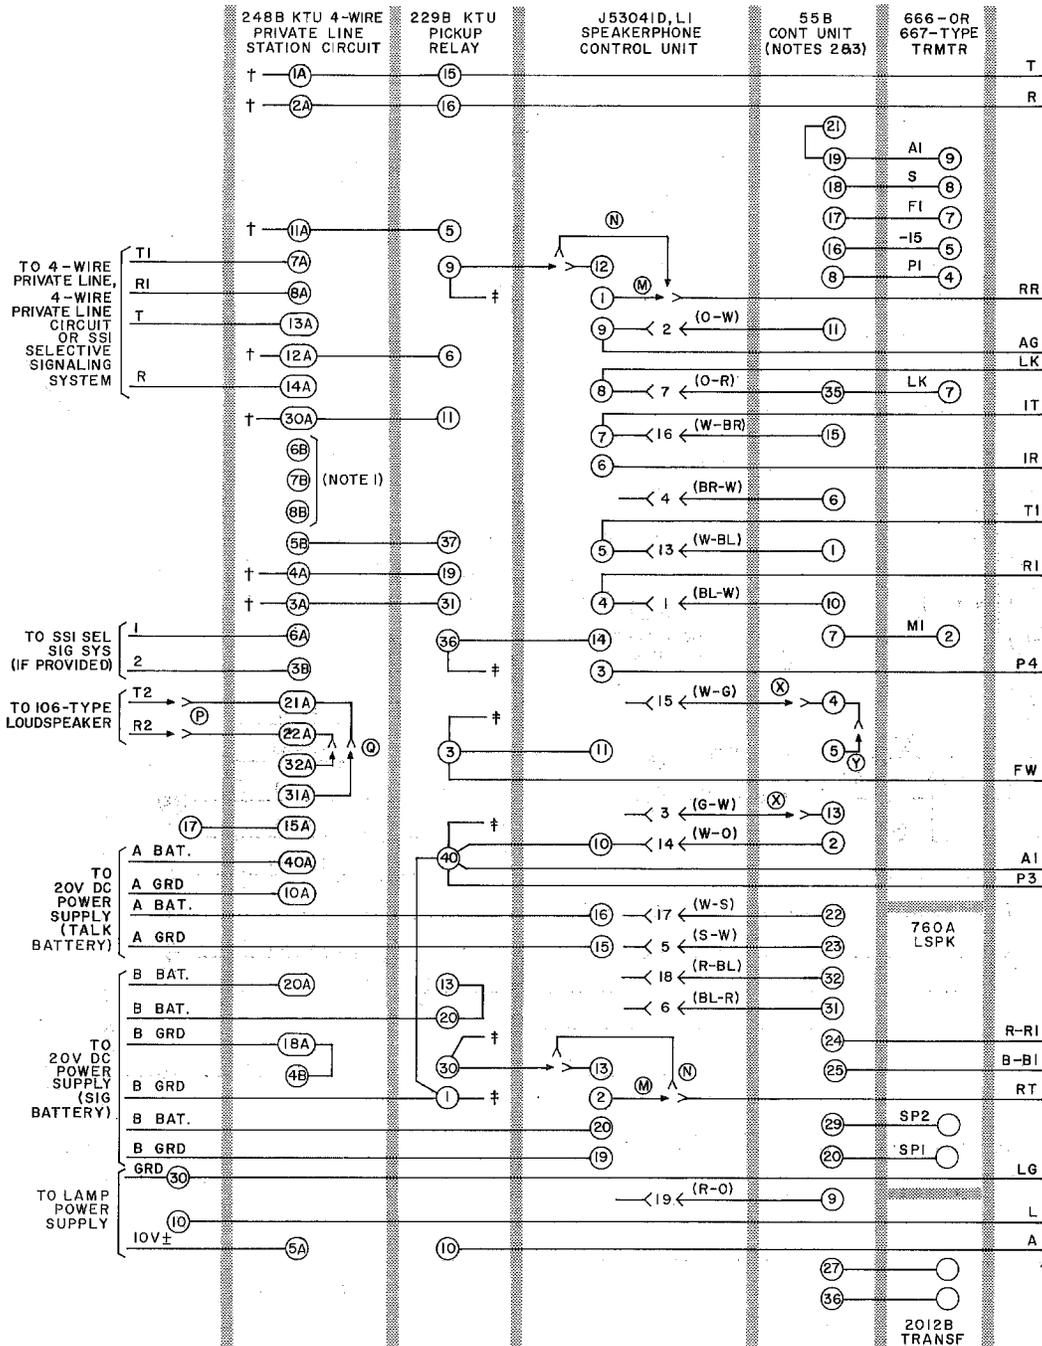

- NOTES:
- ADJUST SIDETONE LEVEL BY STRAPPING AS FOLLOWS:
6B TO 7B-17DB LOSS
6B TO 8B-19DB LOSS
NO STRAP-21DB LOSS
 - FURNISH J5304ID, LI 55B CONTROL UNIT AND ASSOCIATED WIRING ONLY WHEN SPEAKERPHONE OPTION IS FURNISHED.
 - MODIFY 55B CONTROL UNIT AS SHOWN IN FIGURE 10.
 - (Y) TOUCH-TONE DIAL
 - (X) ROTARY DIAL
 - (M) SPEAKERPHONE PROVIDED
 - (N) SPEAKERPHONE NOT PROVIDED
 - (P) VOICE CALLING INCOMING SIGNAL
 - (Q) VOICE CALLING NOT PROVIDED
- † MULTIPLE TO OTHER PICKUP RELAYS FOR NON-EXCLUDED STATIONS ASSOCIATED WITH SAME LINE.
 ‡ MULTIPLE TO OTHER LINES ASSOCIATED WITH SAME STATION.
- REF:
 SD-69449-01
 SD-69542-01
 SD-69403-01

TO 2- OR 4-WIRE KEY AND TELEPHONE CIRCUIT OF CONTROL STATION OR NONEXCLUDED STATION

Fig. 2 — Connections for Control Station or Nonexcluded Station Using 248B KTU