

28 SEQUENCE SELECTOR UNIT  
WIRING DIAGRAM

1. GENERAL

1.01 This section shows the wiring of the 28A and 28D sequence selector units.


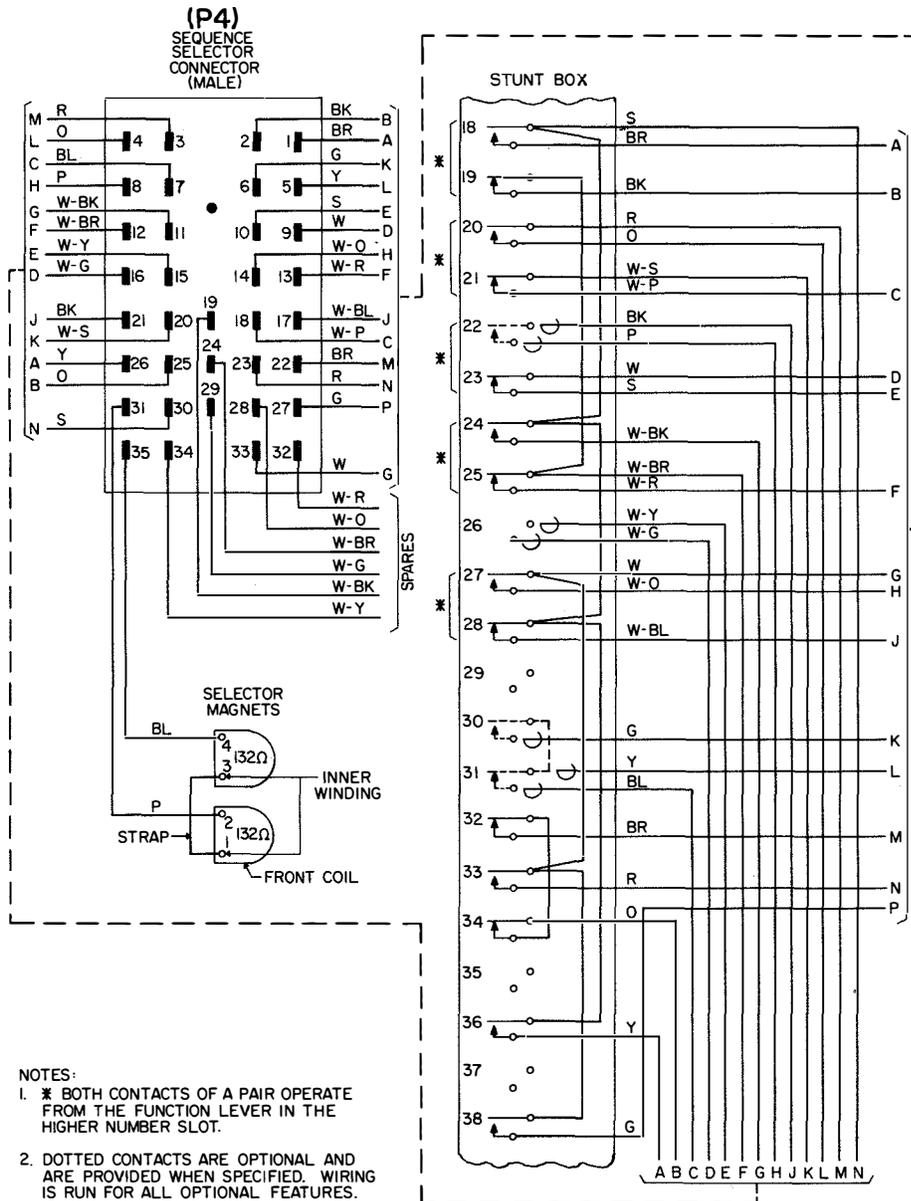


Figure 1 - 28A Sequence Selector Unit

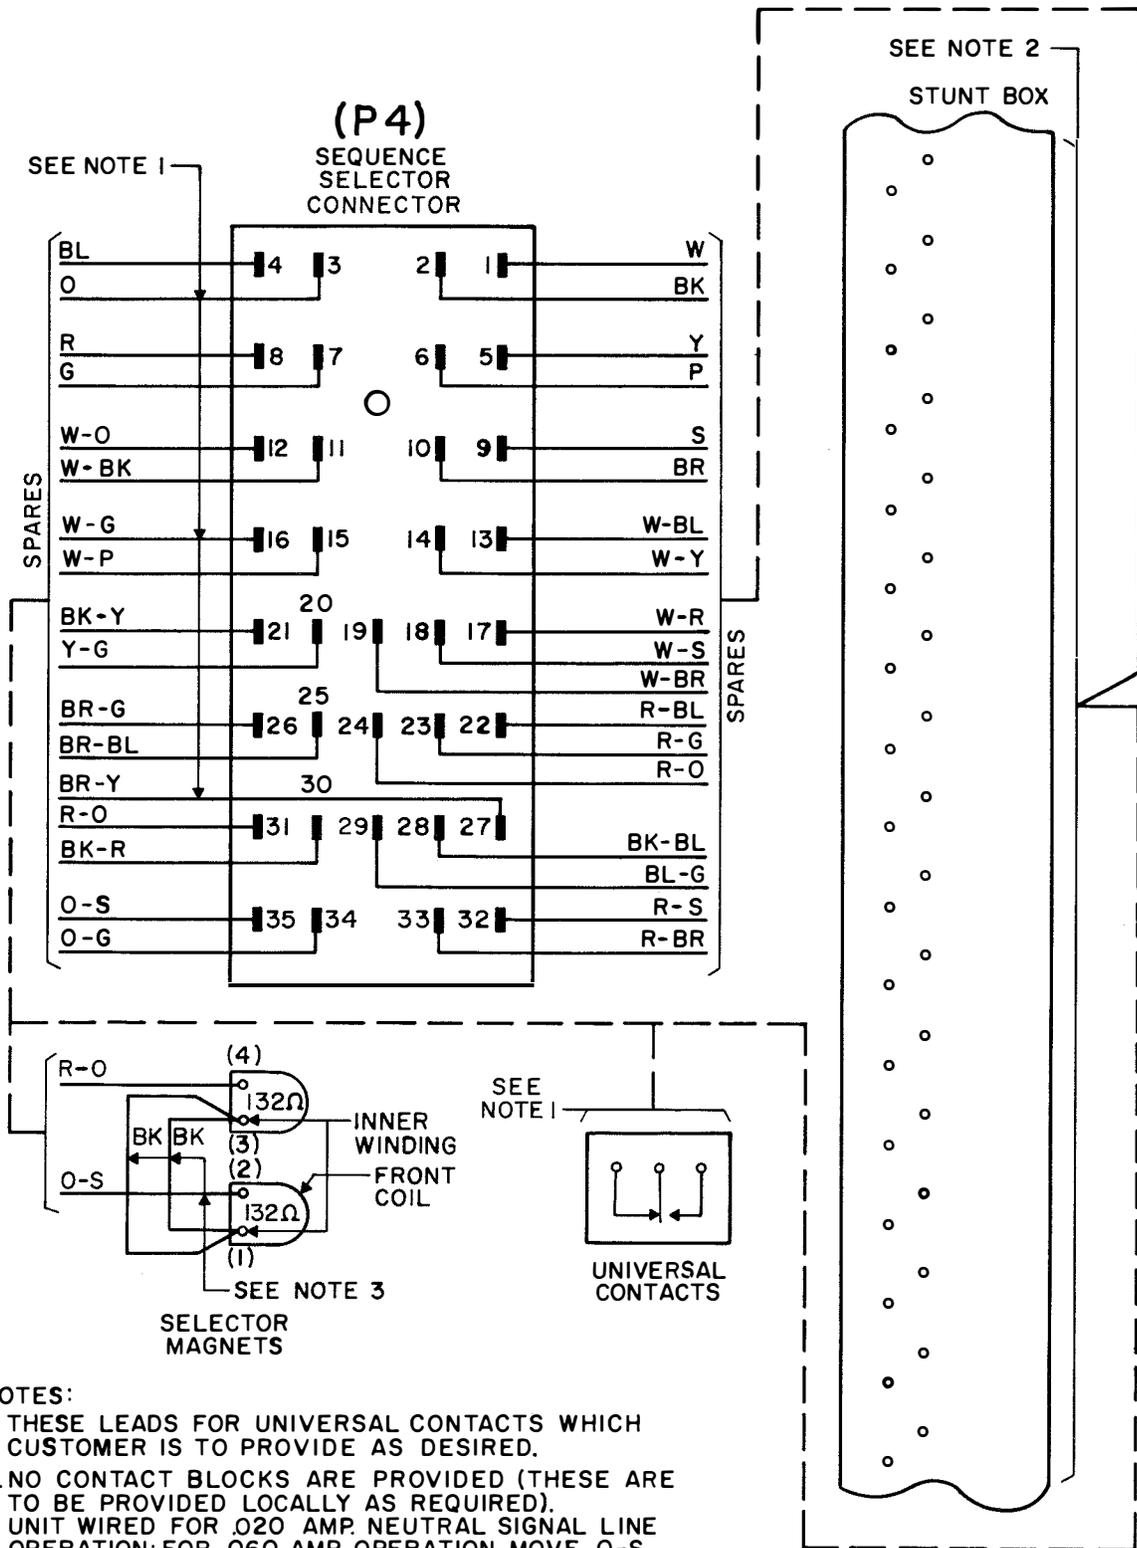

**NOTES:**

1. THESE LEADS FOR UNIVERSAL CONTACTS WHICH CUSTOMER IS TO PROVIDE AS DESIRED.
2. NO CONTACT BLOCKS ARE PROVIDED (THESE ARE TO BE PROVIDED LOCALLY AS REQUIRED).
3. UNIT WIRED FOR .020 AMP. NEUTRAL SIGNAL LINE OPERATION; FOR .060 AMP OPERATION MOVE O-S LEAD FROM TERMINAL (2) OF THE SELECTOR MAGNETS TO TERMINAL (1), ALSO MOVE ENDS OF ONE BLACK JUMPER FROM TERMINAL (1) TO (2) AND END OF OTHER JUMPER FROM TERMINAL (3) TO (4).

Figure 2 - 28D Sequence Selector Unit