

104- & 105-TYPE CABLE TERMINALS DESCRIPTION AND INSTALLATION

1. GENERAL

1.001 This addendum supplements Section 631-250-100, Issue 2. Place this sheet ahead of Page 1 of the Section.

1.002 This addendum is issued to include information on the 105A2B-10 cable terminal.

2. CHANGES TO SECTION

2.001 On Page 2, change paragraph 2.01 to read as follows: Figure 1, 2, 2A, and 3 illustrate the 104A2-12, 105A2-25, 105A2B-10, and 105A1-25

cable terminals, respectively. Table A lists the 104- and 105-type cable terminals and their features.

2.002 On Page 3, after Fig. 2, add Fig. 2A—105A2B-10 Cable Terminal.

2.003 On Page 5, change Table A to include the 105A2B-10 cable terminal.

TABLE A

104- AND 105-TYPE CABLE TERMINALS

CABLE TERMINAL	RATING	MAXIMUM ¹ CABLE DIAMETER (INCHES)	NO. OF PAIRS IN STUB CABLE	NO. OF BINDING POST (PAIRS)
104A2-12	STD	1.8	12	12
105A2-12	STD	1.8	12	12
105A2-25	STD	1.8	25	25
105A2B-10	STD	1.8	10	10 ²
104A1-12	MD	1.8	12	12
105A1-12	MD	1.8	12	12
105A1-25	MD	1.8	25	25

Note 1: When these terminals are to be used with cables larger than 1.8 inches od, 1A1 or 1B1 terminal stubs must be used in conjunction with the terminal as covered in Section 631-240-211.

Note 2: The 105A2B-10 cable terminal is equipped with 2A1B protector units.

NOTICE

Not for use or disclosure outside the Bell System except under written agreement

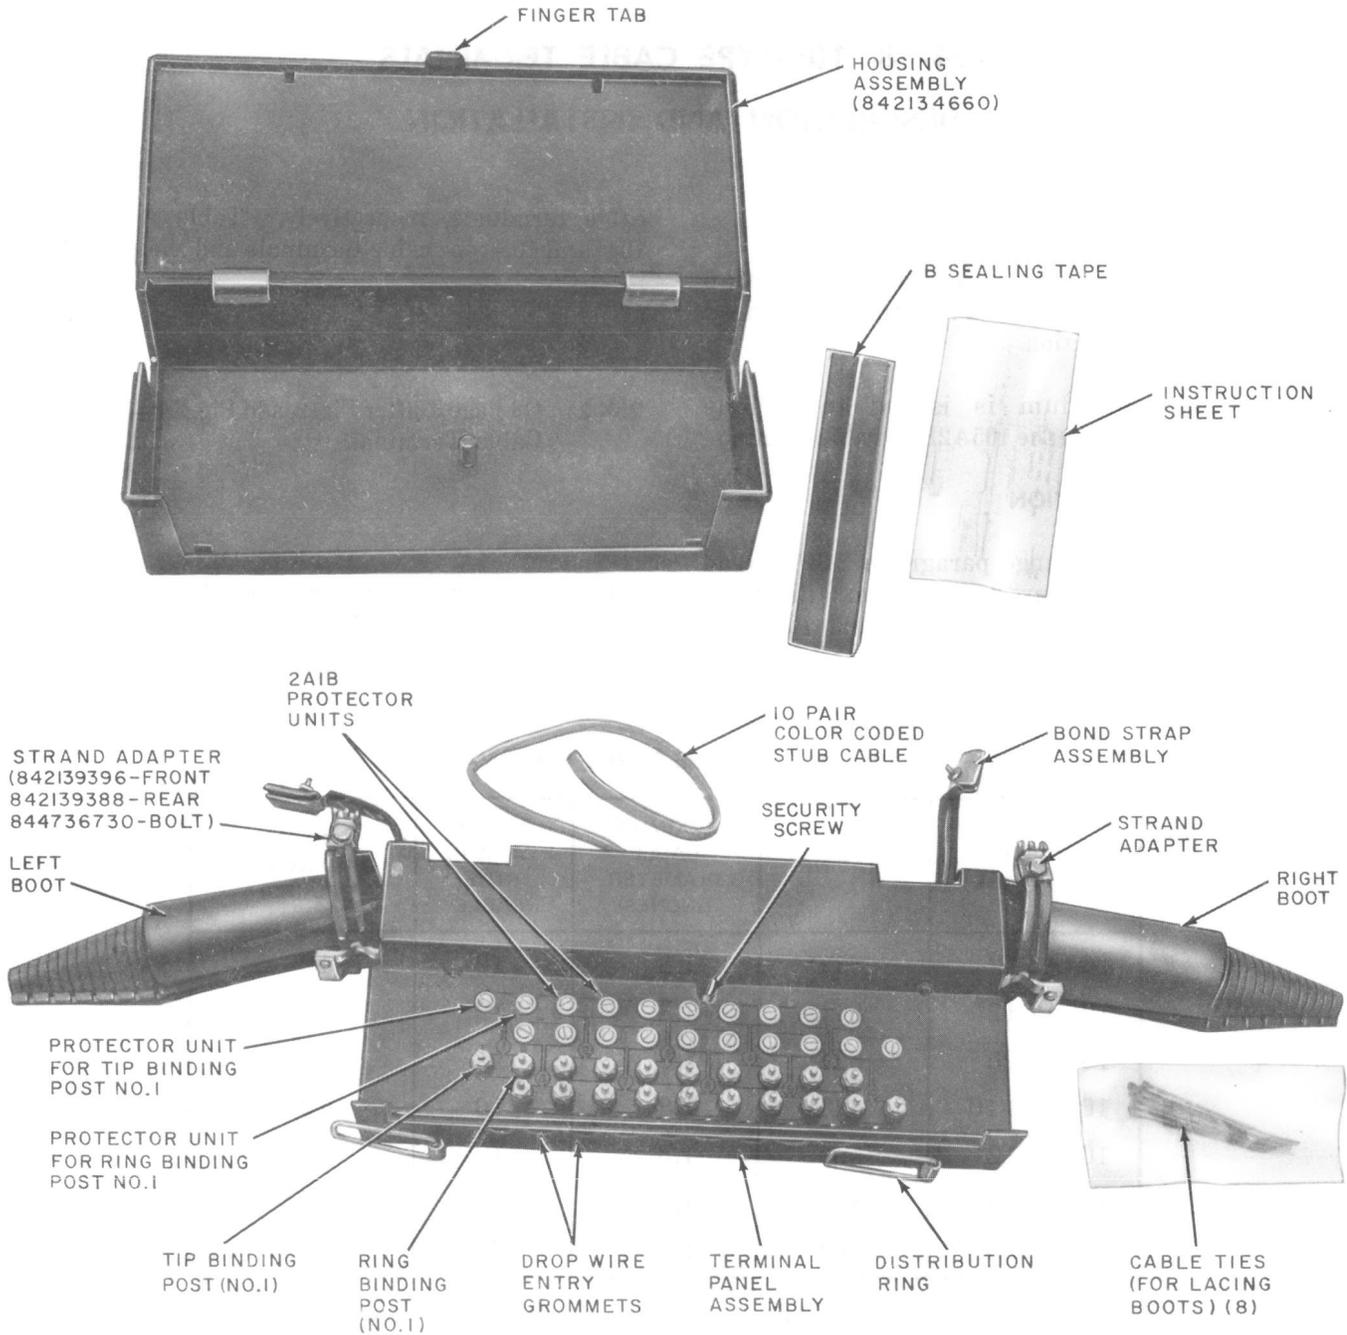


Fig. 2A—105A2B-10 Cable Terminal