

NOTES:
FOR UNITS SMALLER THAN 10 TONS PROVIDE
ONLY CAPPED BRASS WELLS FOR THERMOMETER
AND TAPS FOR PRESSURE GAUGE

1. PROVIDE CAPPED THERMOMETER WELLS ON ALL
INSTALLATIONS.

WATER CHILLER CONNECTIONS


Bell System Standard Detail

A.T.& T. Co.
195 Broadway, N.Y.

SCALE-NONE

ISSUED - 1970

SD - 37

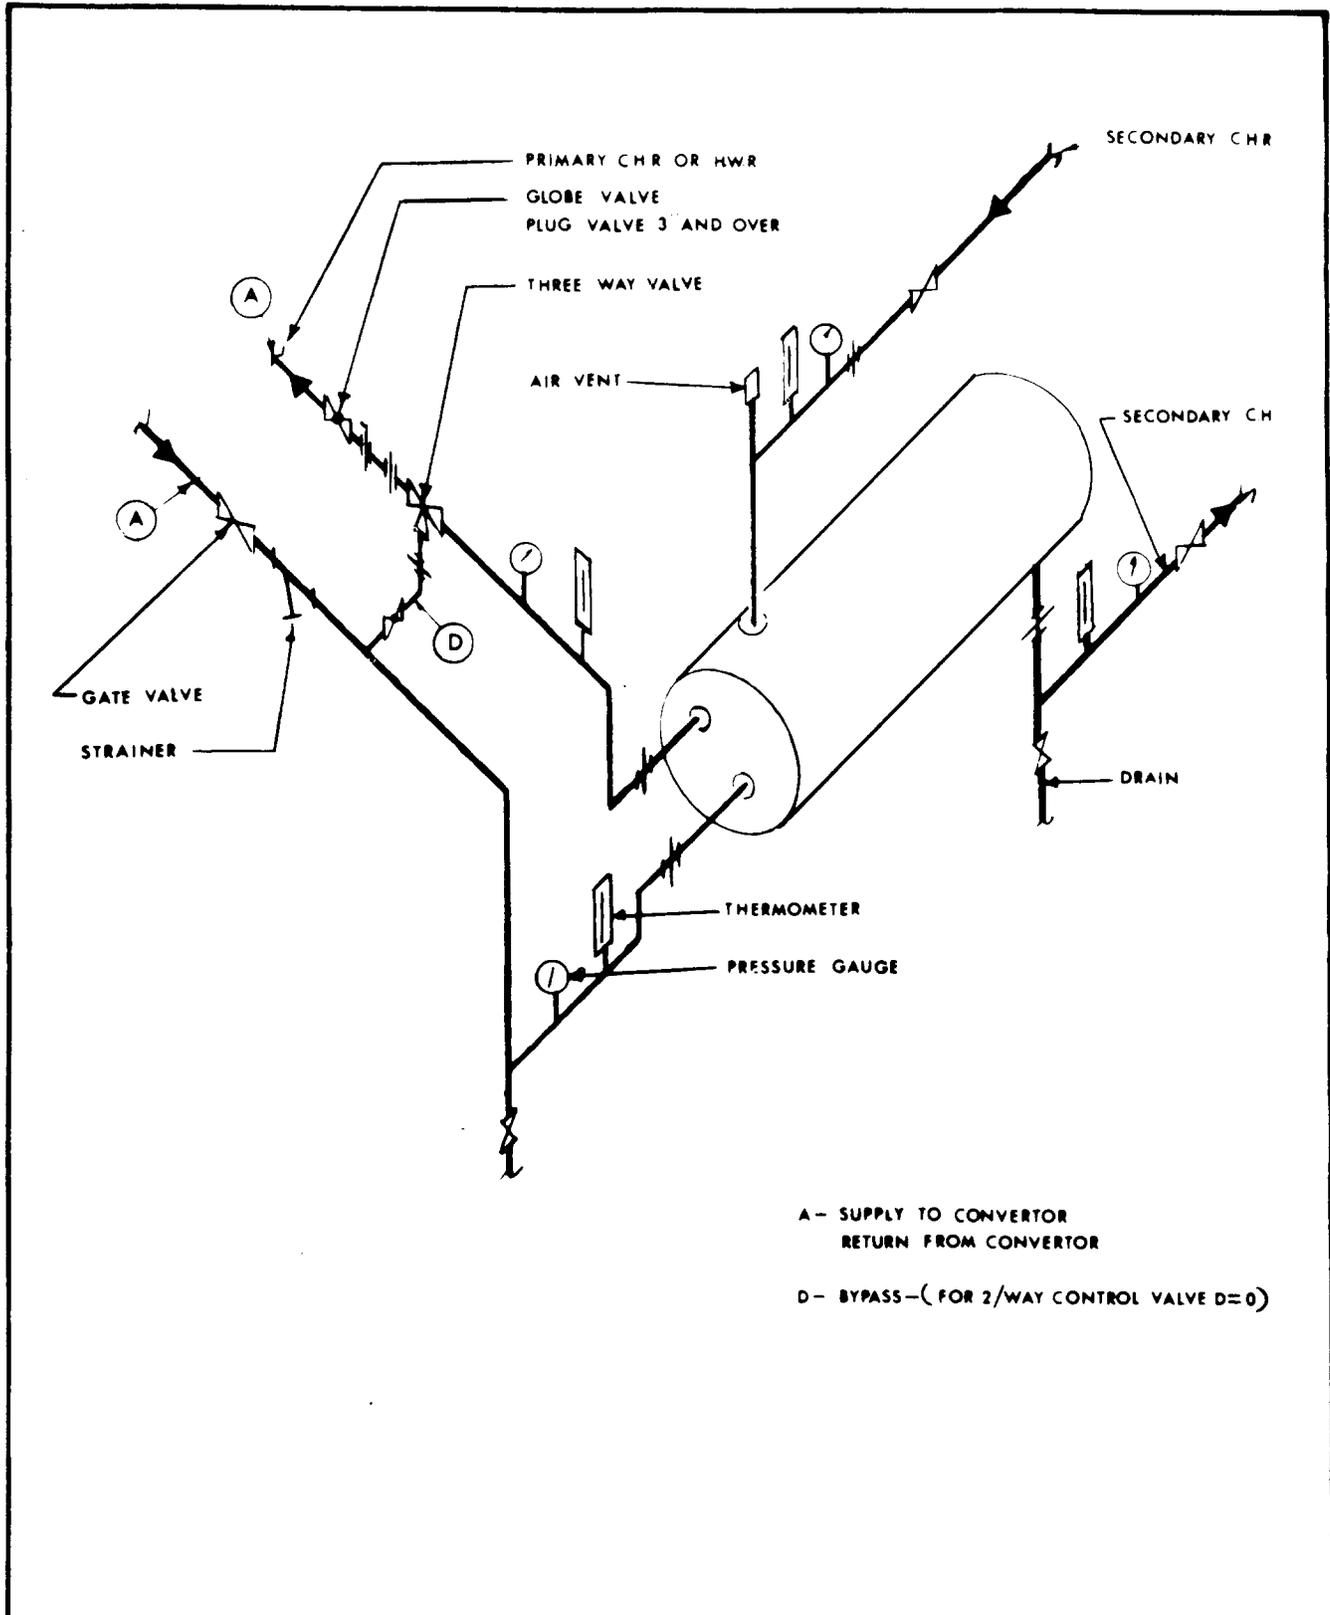

<p>WATER TO WATER HEAT EXCHANGER</p>	<p>Bell System Standard Detail A.T. & T. Co. 195 Broadway, N.Y.</p>	
	<p>SCALE-NONE</p>	<p>SD- 38</p>
	<p>ISSUED - 1970</p>	