

## FIRE PROTECTION APPARATUS ROUTINE INSPECTION AND MAINTENANCE

CONTENTS	PAGE
1. GENERAL . . . . .	1
2. HYDROSTATIC TESTING . . . . .	1
3. MAINTENANCE OF CARBON DIOXIDE FIRE EXTINGUISHERS . . . . .	2
4. MAINTENANCE OF WATER-FILLED STORED PRESSURE FIRE EXTINGUISHERS .	3
5. MAINTENANCE OF ASBESTOS GLOVES .	4
6. MAINTENANCE OF TARPAULINS . . . .	4
7. MAINTENANCE OF FIRE HOSE AND STANDPIPE SYSTEMS . . . . .	4

### 1. GENERAL

**1.01** The purpose of this section is to provide the necessary information for the building service or other forces charged with the responsibility for routine inspection and maintenance of fire protection apparatus.

**1.02** This section covers the carbon dioxide cylinder-type, and the stored pressure water-type extinguishers.

**1.03** Complete descriptions of the fire protective apparatus covered in this section are given in the following sections:

- 770-330-150 Water-Type Fire Extinguishers
- 770-330-152 Carbon Dioxide-Type Fire Extinguishers
- 770-330-160 Asbestos Gloves for Extinguishing Small Fires in Telephone Equipment
- 770-330-161 Tarpaulins for Protection of Telephone Equipment From Water Damage
- 760-620-151 Standpipe and Hose Systems

### 2. HYDROSTATIC TESTING

**2.01** The National Fire Protection Association Pamphlet No. 10A recommends that the water-filled extinguishers (carbon dioxide cartridge-propelled types, stored pressure types, and foam type) and the carbon dioxide cylinder-type extinguisher must be given a hydrostatic pressure test at least once every five years.

**2.02** With respect to the water-filled fire extinguisher, the hydrostatic tests may be made by a qualified contractor, either on the premises, in a suitably equipped truck at the building site, or at the contractor's service station. All tests shall be carried on in accordance with the procedures given in the above-mentioned Pamphlet No. 10A.

Hydrostatic tests for carbon dioxide-type extinguisher cylinders shall be made in accordance with test procedures and apparatus set forth in the regulations of the I.C.C. Because of the high pressures used during the procedures of carbon dioxide-type cylinders and attendant dangers therefrom, plus the need of expensive and complex testing equipment, it is strongly urged that this testing should be done by a qualified outside service agency, laboratory, or manufacturer of this equipment.

**2.03** If any such extinguisher upon subsequent annual inspection shows evidence of mechanical damage, corrosion, or distortion of the shell as from freezing temperatures or from any other causes, it may be unsafe for use. Therefore, regardless of the date of the last hydrostatic test, the extinguisher is again given a hydrostatic pressure test before being returned to service.

**2.04** Each extinguisher which favorably passes the hydrostatic test shall have a record tag Form E-5962, attached to it on which the

**SECTION 770-340-503**

following will be noted, in the appropriate spaces:

- (a) Date of test
- (b) Test pressure
- (c) Name of person and concern making the test

All carbon dioxide-type fire extinguishers which favorably pass the hydrostatic test shall have the date of that test (month and year) permanently stamped on the dome of the cylinder. This is always done by the testing agency.

**2.05** Each water-filled extinguisher less than 5 years old that is subject to periodic hydrostatic testing should have a record tag Form 5962 attached to it. The year of installation should be posted on the tag.

All carbon dioxide-type fire extinguishers less than 5 years old shall have a date (month and year) stamped on the dome of the extinguisher indicating the date of the initial hydrostatic test. Cylinders more than 5 years old since the previous test will be stamped (month and year) again if they successfully pass the hydrostatic test. The service agency keeps detailed records of the hydrostatic test made on each properly identified carbon dioxide-type fire extinguisher. Your only record on hydrostatic test date will be the date permanently stamped on the dome of the cylinder which will alert you as to when the test should be performed again.

**3. MAINTENANCE OF CARBON DIOXIDE FIRE EXTINGUISHERS**

**A. Inspection**

**3.01** Carbon dioxide-type extinguishers should be inspected for the following items when placed in service and at least once each year thereafter:

- (a) 10 and 15 POUND: That the wire seal is not broken. If broken, extinguisher should be weighed.
- (b) Hose is in good condition especially at couplings, and that couplings are dated for determination of 14-year safe hose life.
- (c) Nozzle is not broken and orifice is unobstructed.
- (d) Hose coupling is wrench tight at cylinder outlet and at nozzle.

(e) Hose is looped back over valve handle and held in place by clip on side of extinguisher in such a way that lower edge of nozzle pointing downward is slightly above bottom of extinguisher.

(f) Finish is in good condition.

(g) Mounting bracket is securely fastened to wall.

(h) Record tag is attached and extinguisher has been weighed within the required time.

**B. Weighing**

**3.02** Extinguishers should be weighed at least once a year to make sure they are in proper condition for immediate use. An inspection of the items mentioned in 3.01 should also be made at this time.

**C. Method**

**3.03** Weighing of an extinguisher should be done with a suitable scale such as one marketed by Badger, Catalogue #CS 34. The spring scale should be supported by a weighing bracket arranged to be attached to the extinguisher mounting bracket.

**3.04** All extinguishers are marked with the cylinder weight and the horn and hose-assembly weight so that the weight of gas can be checked without dismantling the parts. To determine that the extinguisher is in proper condition for immediate use, the following conditions should be met:

The total weight (by spring scale) should be not less than:

STAMPED CYLINDER WEIGHT  
PLUS  
STAMPED HOSE ASSEMBLY WEIGHT  
PLUS  
4-1/2 POUNDS FOR 5-POUND  
EXTINGUISHER  
9 POUNDS FOR 10-POUND  
EXTINGUISHER  
13-1/2 POUNDS FOR 15-POUND  
EXTINGUISHER

The above method of determining if extinguishers meet the weight requirements shall be used irrespective of any conflicting instructions that may be on the extinguisher nameplate.

**Recording Weight**

**3.05** If the extinguisher is within the required weight limit and otherwise satisfactory, it should be returned to its mounting bracket and the weight recorded on the tag Form E-5962 provided for this purpose.

**3.06** Extinguishers which do not meet weight requirements should be carried to a suitable location in building service quarters, where the noise of discharge would not be distracting, or outside the building, and discharged. Where feasible, the discharging may be done for training. The extinguishers should then be forwarded for recharge in accordance with local instructions.

**3.07** Extinguishers which develop a leak such as may be evidenced by a hissing sound or the presence of frost about the valve assembly should be immediately replaced. The leaking extinguisher should be discharged, repaired, recharged, and inspected as outlined in 3.01.

**3.08** Although the extinguishers are designed with an ample factor of safety and will withstand a reasonable amount of rough usage, care should be exercised while weighing or otherwise handling them to avoid dropping or subjecting the cylinder or valve to an excessive strain.

**3.09** The hose assemblies for the 10-pound trigger control and the 15-pound extinguishers are not interchangeable with any other extinguishers. When ordering hose, specify model number and manufacturer.

#### **4. MAINTENANCE OF WATER-FILLED STORED PRESSURE FIRE EXTINGUISHERS**

##### **A. Inspection**

**4.01** Stored pressure fire extinguishers should be inspected for the following items when placed in service and twice a year thereafter:

- (a) Stored air pressure registers in the operating area on the gauge or around 100 pounds.
- (b) Safety pin is not fouled.
- (c) Hose is in good condition.
- (d) Nozzle opening is not obstructed.

(e) Hose coupling is tight at tank outlet.

(f) Dents are not evident on the extinguisher body. Dents at the seams are particularly important as they tend to weaken the seams: extinguishers so damaged should be emptied, removed from service, and immediately replaced. Discarded extinguishers should be classified as "junk" and arrangements made for disposition through the usual lines of organization.

(g) Finish is in good condition and no exterior corrosion has taken place.

(h) Mounting bracket is securely fastened to wall.

(i) Record label Form E-5962 is up to date and check whether a hydrostatic test, which is given every 5 years, will be due during the current 6-months period. If so, report it to supervisor.

(j) If all items are satisfactory, enter date and signature on Form E-5962.

##### **B. Maintenance Procedure**

**4.02** If air pressure is low or refilling is required, remove the extinguisher from its mounting and carry it to a location where the tank can be emptied, cleaned, and refilled. Only one extinguisher per floor should be taken out of service at one time, unless replacements are installed.

**4.03** Release the remaining air pressure in the extinguisher at the tire-type air valve. **ALL AIR PRESSURE MUST BE RELEASED FROM THE EXTINGUISHER BEFORE THE HEAD ASSEMBLY IS REMOVED.** Remove the head assembly, completely flush out, and clean the tank and examine the interior for any corrosion. Examine the head assembly and siphon to insure that it is clean and free from damage.

**4.04** The tank should be filled to the fill mark with clean cold water. Calcium chloride must never be used in this unit to prevent freezing. The O ring or head gasket should be replaced with a new gasket and the threads of the head assembly lightly coated with vaseline before the unit is assembled. Care should be used in replacing the head assembly to insure that the threads engage properly. The head assem-

## SECTION 770-340-503

bly of one extinguisher must not be interchanged with another extinguisher.

**4.05** The finish of the extinguisher should be examined and cleaned (not painted) to restore good appearance, as required.

**4.06** Air pressure should be released and extinguishers emptied before shipping to other locations.

### 5. MAINTENANCE OF ASBESTOS GLOVES

#### A. Inspection

**5.01** Gloves and container should be inspected for the following items when placed in service and at least once each year thereafter:

- (a) Container cover opens freely.
- (b) Gloves should be removed from container, inspected, and returned folded together, with fingers up. They should be loose enough to be easily removed.
- (c) Container finish is in good condition. Container should be painted, if required.
- (d) Mounting bracket is securely fastened.

### 6. MAINTENANCE OF TARPAULINS

#### A. Inspection

**6.01** Portable tarpaulins and container should be inspected annually for the following items. (See Fig. 1).

- (1) Bottom door of container opens freely.
- (2) Tarpaulins should be removed from container and inspected for possible defects. They should then be properly folded and rolled and replaced in the container. A check should be made to insure that they are loose enough to be easily removed.
- (3) Container finish is in good condition. Container should be painted, if required. It should not be painted same color as background.
- (4) Container is securely mounted.

#### B. Folding and Rolling Portable Tarpaulins

**6.02** When tarpaulins are placed in the storage container, they must be folded and rolled in the proper manner to permit them to

be placed and removed easily. The proper method for folding and rolling is shown in Fig. 3.

## 7. MAINTENANCE OF FIRE HOSE AND STANDPIPE SYSTEMS

### 7.01 Tests and Inspection:

(a) While the data given herein represents current views as to procedures and recommendations it is understood that they may be altered to meet differing local fire code regulations and conditions but only when the latter one is more stringent.

(b) Each standpipe station and associated equipment, whether capped or equipped with hose valves, etc, is inspected annually. Should any defects be found in the course of the inspection or during the performance of regular duties they should be remedied. If the defects or faults can be taken care of at the time they are found, this should be done. Otherwise, the defects are reported for prompt attention.

(c) A fire hose is not to be used, under any circumstances, for other than fire fighting purposes. Violation of this rule may result in hose being missing, defective, or useless in case of fire.

(d) Fire hose stations should be free of any obstacle and nothing is permitted to obscure hose racks or to block the door of a hose cabinet or closet. Inspection is made to see that doors open readily.

### 7.02 Fire Hose Inspection:

(a) Inspection of fire hose is made annually, checking points noted in the following subparagraphs (d) through (i).

(b) When unlined linen hose becomes wet for any reason it deteriorates rapidly. For this reason, hydrostatic testing of the hose is not recommended.

(c) Should a hose become wet, it should be replaced with Underwriters Laboratories approved unlined linen hose unless the procedure for drying is followed as outlined in the directions given in the latest issue of pamphlet No. 198, "Care of Fire Hose," issued by the National Fire Protective Association.

(d) The exterior of the hose is cleaned by vacuuming. The hose rack, pipe fittings, and hose cabinets are wiped clean with a damp or treated dustcloth.

(e) Indications of moisture are looked for, giving special attention to the loop close to the point where the hose is connected to the valve. If there is discoloration of the hose at the valve, such as would occur from water leakage, twisting of the hose by hand at the point of connection may cause it to tear indicating need for removal of the defective section and resetting of the coupling.

(f) The threads of the couplings are inspected and any injured or defective couplings are replaced. They are so adjusted that they can be easily tightened by hand. Oil or grease is not used, as they are likely to cause deterioration of hose and rubber washers. Threaded fittings are cleaned of any corrosion or foreign matter. Where couplings are polished, care is taken to keep the polish from coming in contact with the hose as the chemicals in metal polishes can damage it.

(g) The rubber washers, both at the hose valves and at the nozzles, are examined and any that are lacking in strength or elasticity are replaced.

(h) The date of the inspection and inspector's name or initials should be entered in the tag Fig. 2 (Form E-5962, "Fire Hose Inspection") attached to the rack. Inspection should include assurance of the Underwriters Laboratories approval label which should be affixed to the hose, the date of the manufacture of the hose, and manufacturer's identification.

(i) Unlined linen hose on exposed racks should be considered for replacement after 12 years and on enclosed racks after 15 years. Replacement may be required at shorter intervals depending on hose location, its exposure to sunlight, or other conditions which would cause more rapid deterioration.

### 7.03 Standpipe Systems Inspection:

(a) Standpipe systems should be visually inspected annually. This is to include any tanks, where employed, and all valves and hose stations. Piping should be inspected where it is accessible.

(b) The National Fire Protection Association Pamphlet No. 14 entitled "Standpipe and Hose Systems" specifies that hydrostatic testing of dry standpipe systems be done at intervals of not less than 5 years. This also applies to the dry portion of piping in a wet standpipe system between the check valve in the fire department inlet pipe and the outside multiple connection.

(c) Dry standpipes over 10 years old should be tested with air at a pressure not exceeding 25 pounds per square inch to determine their tightness before water is turned into them for hydrostatic test.

(d) Hydrostatic testing of wet standpipes, except for dry sections, is not considered essential.

(e) Fire pumps are usually turned over at weekly intervals with capacity tests made yearly in accordance with N.F.P.A. pamphlet No. 20. It is desirable that fire pump capacity test be tied in with hydrostatic standpipe tests when required by local authorities. After the yearly capacity test, the roof hose outlet should be opened to permit a limited flow through this highest outlet to insure an unobstructed standpipe before the system is returned to service.

(f) The main gate valve in the water supply (sealed open) is checked to ascertain that it is in the proper open position.

(g) At the Fire Department connections, the check valves are inspected to determine that they are in working condition.

(h) The valves at hose connections are checked to insure that they are closed tightly to prevent leakage of water. The drip connections (where installed) at hose valves are checked to determine that they are open. This is done to avoid the possibility of any water that may leak past the valve from getting into the hose.

(i) All check valves throughout the standpipe system should be examined to make sure they are in proper working order.

**Note:** Check valves should be located on all supply lines from each separate water supply serving the standpipe system including the Fire Department (multiple) connections.

(j) The end valve of each standpipe system, located, for example, on the roof in the case of buildings over three stories in height, is opened to establish that there is a free flow of water. Adequate provision is made for carrying off the water to avoid water damage.

(k) Test procedures may differ with each installation and it is recommended that lo-

cal fire departments be asked to cooperate with Telephone Company personnel in carrying on inspections of standpipe systems.

(l) Where frequency of routine is suggested, appropriate records should be maintained to make sure that such routines are being performed.

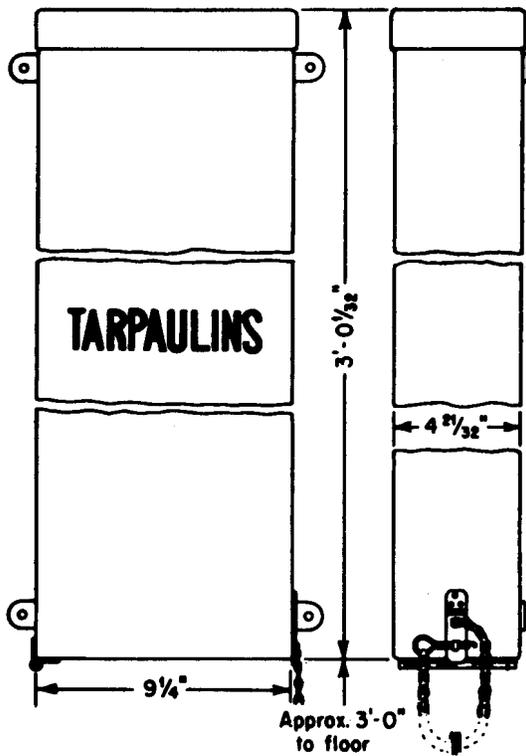


Fig. 1

**BELL SYSTEM  
FIRE EXTINGUISHER  
ALL TYPES**

E-5962  
11-70

<b>BLDG. NO.</b>		<b>SERIAL NO.</b>		
<b>EXT. LOC.</b>		<b>TAG NO.</b>		
Charged Weight of Cartridge (STAMPED ON CARTRIDGE)		Weight of Empty Extinguisher . . . lbs.		
Replace Cartridge when on inspection its loss in weight is found to exceed ounces.		Min. Allowable Weight of Gas . . . lbs.		
		Min. Allowable Total Weight . . . lbs.		
		Recharge Extinguisher when on inspection its weight is found to be less than allowable minimum.		
DATE	DATE RECHARGED	WEIGHT	HOSE REFOLDED AND/OR INSPECTED	INSPECTOR

Fig. 2

HYDROSTATIC TEST RECORD			
DATE	PRESS	COMPANY	PERSON

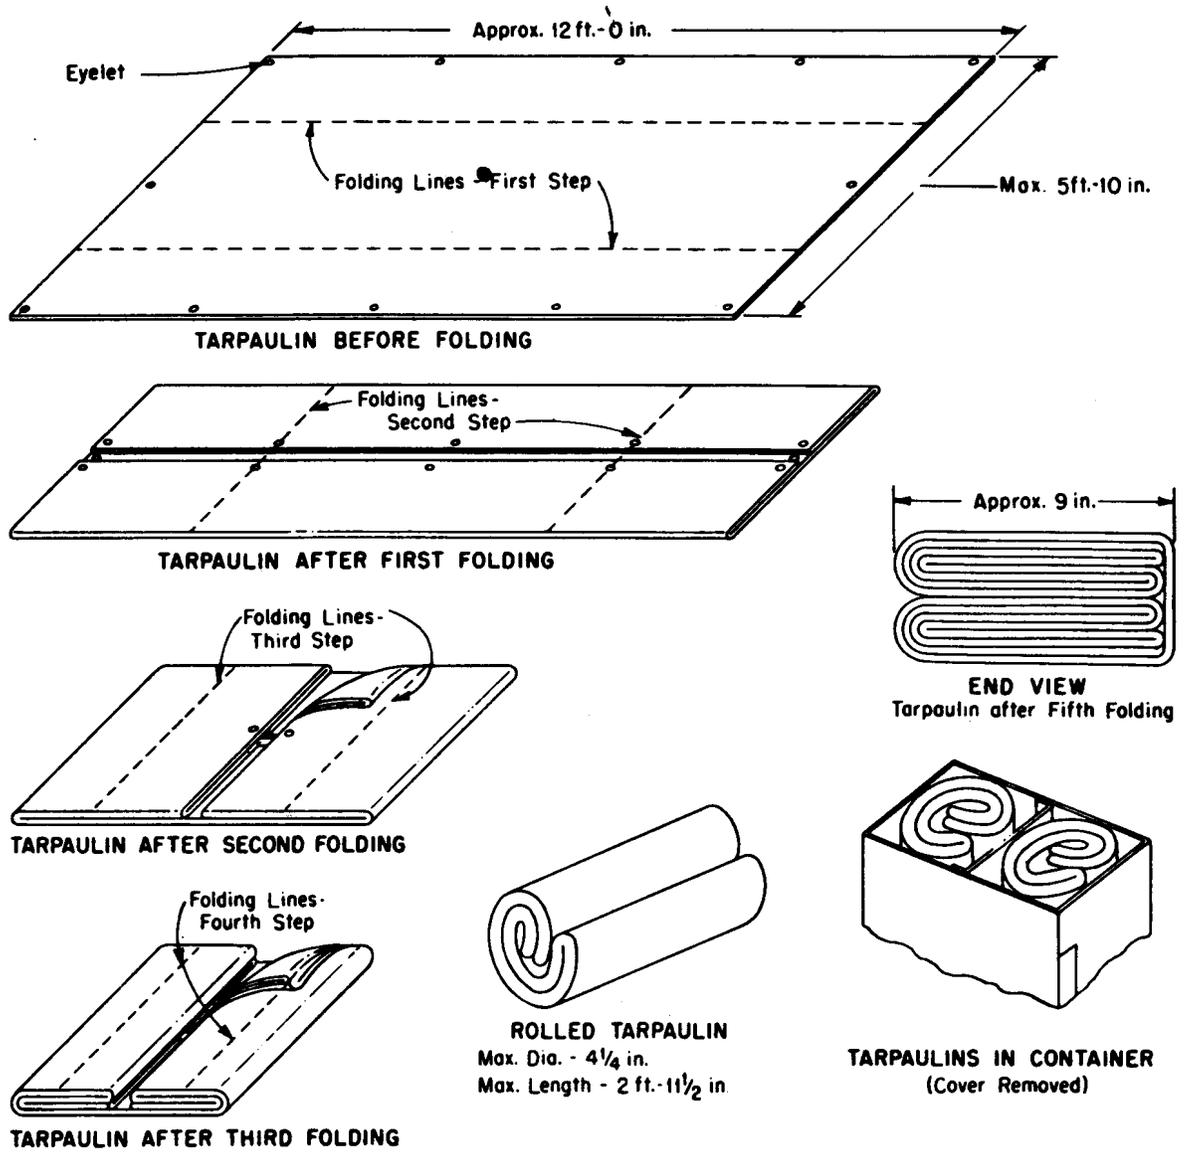


Fig. 3