

U S WEST, Inc.
Technical Publication

**Specification Standards For
Antenna And Waveguide
Installation, Removal And
Tower/Antenna Maintenance**

77360
Issue D
January 2000

U S WEST, Inc.
Technical Publication

**Specification Standards For
Antenna And Waveguide
Installation, Removal And
Tower/Antenna Maintenance**

**Copyright 1984, 1996, 2000
Printed in U.S.A.
All Rights Reserved**

**77360
Issue D
January 2000**

NOTICE

This Technical Publication is intended to outline performance standards for Service Suppliers performing installation, maintenance, rearrangement or removal work at U S WEST radio locations. It establishes guidelines for installation and removal of antennas, transmission lines and for testing and pressurization of same. Guidelines for conducting work operations at U S WEST sites, including provisions for safety, continuity of service and compliance with Federal Communications Commission (FCC) and FAA OSHA requirements are also outlined. This Technical Publication applies to any Service Supplier or Subcontractor performing such work either on behalf of U S WEST or a tenant organization at U S WEST radio tower locations. As used in the publication, the term "Supplier" shall mean "Service Supplier".

U S WEST, Inc. reserves the right to revise this document for any reason, including but not limited to, conformity with standards promulgated by various governmental or regulatory agencies; utilization of advances in the state of the technical arts; or to reflect changes in the design of equipment, techniques, or procedures described or referred to herein.

Liability to anyone arising out of use or reliance upon any information set forth herein is expressly disclaimed, and no representation or warranties, expressed or implied, are made with respect to the accuracy or utility of any information set forth herein.

This document is not to be construed as a suggestion to any manufacturer to modify or change any of its products, nor does this publication represent any commitment by U S WEST, Inc. to purchase any specific products. Further, conformance to this publication does not constitute a guarantee of a given supplier's equipment and/or its associated documentation.

Ordering information for U S WEST Publications can be obtained from the Reference Section of this document.

If further information is required, please contact:

U S WEST
Manager - Writing Services
700 W Mineral Ave., Room IA B13.34
Littleton, CO 80120
(303) 707-7454
Fax: (303) 707-9414
E-Mail: soverma@uswest.com

COMMENTS on PUB 77360

PLEASE TEAR OUT AND SEND YOUR COMMENTS/SUGGESTIONS TO:

U S WEST
Manager - Writing Services
700 W Mineral Ave., Room IA B13.34
Littleton, CO 80120
(303) 707-7454
Fax: (303) 707-9414
E-Mail: soverma@uswest.com

Information from you helps us to improve our Publications. Please take a few moments to answer the following questions and return to the above address.

Was this Publication valuable to you in understanding
the technical parameters of our service? YES _____ NO _____

Was the information accurate and up-to-date? YES _____ NO _____

Was the information easily understood? YES _____ NO _____

Were the contents logically sequenced? YES _____ NO _____

Were the tables and figures understandable and helpful YES _____ NO _____

Were the pages legible? YES _____ NO _____

What format do you have? Paper ____ IBM Disk ____ Mac Disk ____

If you answered NO to any of the questions and/or if you have any other comments or suggestions, please explain:

(Attach additional sheet, if necessary)

Name _____ Date _____

Company _____

Address _____

Telephone Number _____

E-Mail _____

CONTENTS

Chapter and Section	Page
1. Introduction.....	1-1
1.1 General.....	1-1
1.2 Reason For Reissue.....	1-1
2. General Provisions	2-1
2.1 U S WEST Representative.....	2-1
2.2 FCC Permit	2-1
2.3 Surveying	2-1
2.4 Installation and Removal Requirements.....	2-1
2.5 Precautions	2-2
2.6 Radiation Hazard on Working Systems	2-2
2.7 Transportation	2-3
2.8 Materials	2-3
2.9 Substitutions Or Variations.....	2-3
2.10 Documentation.....	2-3
2.11 Cleaning	2-4
2.12 Temporary Toilets.....	2-4
2.13 Welding.....	2-4
2.14 Cut, Welded Or Damaged Surfaces	2-4
2.15 Surplus Material.....	2-4
2.16 Storage of Material on the Site.....	2-5
2.17 Protection of the Public.....	2-5
2.18 Overtime Work	2-5
2.19 Safety	2-5
2.20 Pre-construction Conference.....	2-5
2.21 Use of Sub-contractors.....	2-5
3. Antennas Installation.....	3-1
3.1 General.....	3-1
3.2 Antenna Installation (Horn, Parabolic, And Yagi/Whip).....	3-2
3.3 Antenna Heater Circuit.....	3-4

CONTENTS (Continued)

Chapter and Section	Page
4. Transmission Lines.....	4-1
4.1 General.....	4-2
4.2 Waveguide	4-2
4.2.1 Bent Circular Rigid Waveguide	4-2
4.2.2 Rigid Circular Waveguide.....	4-2
4.2.3 Rectangular Waveguide.....	4-2
4.2.4 Flexible Rectangular and Circular Waveguide	4-2
4.2.5 Rigid Rectangular Waveguide.....	4-2
4.3 Weather Seals.....	4-3
4.4 Transmission Line Installation (General)	4-3
4.5 Elliptical Waveguide and Coaxial Cable Installation.....	4-5
4.5.1 Elliptical Waveguide Installation.....	4-5
4.5.2 Coaxial Cable Installation.....	4-7
4.6 Miscellaneous Waveguide Components.....	4-7
4.7 Waveguide/Antenna Leakage Test	4-8
4.8 Electrical Tests	4-8
4.9 Waveguide/Transmission Line Grounding	4-9
5. Pressurization Systems	5-1
5.1 General.....	5-1
5.2 Components	5-1
5.3 Installation.....	5-3
5.4 Turn Up.....	5-4
5.5 Operation and Maintenance	5-5
5.6 Use of the Antenna/Waveguide/Pressurization Checklist.....	5-6
6. Removal Guidelines.....	6-1
6.1 General.....	6-1
6.2 Transportation	6-1
6.3 Precautions	6-1
6.4 Transmission Line Removal.....	6-2
6.5 Antenna, Antenna Mounts, Support Rings, and Ice Protection.....	6-2

CONTENTS (Continued)

Chapter and Section	Page
7. Tower & Antenna Maintenance.....	7-1
7.1 General Maintenance	7-2
7.2 Emergency Work	7-4
7.3 Safety	7-5
7.4 Precautions	7-5
7.5 Types of Structures.....	7-6
7.6 Initial Inspection	7-6
7.7 Subsequent Inspections	7-7
7.8 Tower Inspection Report	7-8
8. Definitions.....	8-1
8.1 Acronyms	8-1
8.2 Glossary	8-1
9. References.....	9-1
9.1 American National Standards Institute Documents	9-1
9.2 U S WEST Technical Publications.....	9-1
9.3 Ordering Information	9-1
9.4 Trademarks.....	9-2

Figures

7-1 Tower Inspection Report	7-9
5-1 Dry Air System Block Diagram.....	5-6
5-2 Air Manifold Systems.....	5-7
5-3 Pressure Monitor/Alarm Assembly.....	5-8
5-4 Portable Pressure Gauge For Turn-up and Maintenance	5-9
5-5 Installation and Removal Checklist.....	5-10

Tables

7-1 Routine Maintenance Items	7-4
-------------------------------------	-----

CONTENTS

Chapter and Section	Page
1. Introduction.....	1-1
1.1 General.....	1-1
1.2 Reason For Reissue.....	1-1

1. Introduction

1.1 General

This Technical Publication outlines performance standards for Suppliers performing installation, rearrangement or removal work, and tower/antenna maintenance at U S WEST radio locations. This Technical Publication applies to any Supplier or subcontractor performing such work either on behalf of U S WEST or a tenant organization at U S WEST radio tower locations.

1.2 Reason For Reissue

This reissue improves organization of the document, adds paragraph numbering for reference purposes, and updates the references to Service Suppliers doing work for US West.

CONTENTS

Chapter and Section	Page
2. General Provisions	2-1
2.1 U S WEST Representative	2-1
2.2 FCC Permit	2-1
2.3 Surveying	2-1
2.4 Installation and Removal Requirements	2-1
2.5 Precautions	2-2
2.6 Radiation Hazard on Working Systems	2-2
2.7 Transportation	2-3
2.8 Materials	2-3
2.9 Substitutions Or Variations	2-3
2.10 Documentation	2-3
2.11 Cleaning	2-4
2.12 Temporary Toilets	2-4
2.13 Welding	2-4
2.14 Cut, Welded Or Damaged Surfaces	2-4
2.15 Surplus Material	2-1
2.16 Storage of Material on the Site	2-5
2.17 Protection of the Public	2-5
2.18 Overtime Work	2-5
2.19 Safety	2-5
2.20 Pre-construction Conference	2-5
2.21 Use of Sub-contractors	2-5

2. General Provisions

This document establishes guidelines for the installation and removal of antennas, transmission lines and for testing and pressurization of same. Guidelines are also included for Tower & Antenna Maintenance. Guidelines for conducting work operations at U S WEST sites, including provisions for safety, continuity of service and compliance with Federal Communications Commission (FCC), Federal Aviation Administration (FAA) and Occupational Safety & Health Act (OSHA) requirements are also outlined.

2.1 U S WEST Representative

A U S WEST representative will accompany the Supplier during several phases of construction or removal and will inspect all work during and after its completion, as noted in this document. The representative may be a maintenance or equipment engineer, or any person so specified by U S WEST.

2.2 FCC Permit

No work shall be started on the radio site until the FCC permit is posted by the U S WEST representative in an easily accessible location on site that is protected from the weather.

2.3 Surveying

The Supplier is responsible for all construction surveying or any other surveying that may be required to complete work in the best manner possible.

2.3.1

The site shall be located according to the construction permit within the tolerances allowed by the Code of Federal Regulations Title 47 - Telecommunications (CFR47).

2.4 Installation and Removal Requirements

The Contractor shall complete all installation, removal, and maintenance work in accordance with this Technical Publication and the provisions of U S WEST Technical Publication 77350 *Telecommunications Equipment Installation Guidelines (TEIG)*.

2.4.1

The Supplier shall complete all work indicated in specifications and drawings including all work that is reasonably inferable from the specifications and drawings.

2.4.2

Unless otherwise instructed, the Supplier shall provide, furnish, pay and assume responsibility for all transportation, labor materials, tools, and other facilities required for the execution and completion of the work in a quality manner.

2.4.3

All Suppliers performing Installation or Maintenance work on antenna, waveguide and pressurization equipment and (or) systems will complete an Antenna/Waveguide/Pressurization checklist as noted in detail in Chapter 5 (Figure 5-5).

2.4.4

Only personnel knowledgeable in the installation and maintenance of antenna supporting structures, antenna systems, and radio transmission lines will perform work operations.

2.5 Precautions

When antenna or waveguide work is performed at an existing station, working equipment may be affected. Every precaution shall be taken to ensure that working equipment is protected from physical damage, misalignment, movement or interruption.

2.5.1

Special care shall be taken when hoisting materials to ensure that material is not raised in front of working antennas. The U S WEST representative shall be advised prior to the start of any work at an existing station and again advised at the completion of each days work and at the completion of the job. An "all-clear" shall be obtained from the U S WEST representative before leaving the station in each case.

2.5.2

Extreme care shall be taken during transporting, unpacking, and installation of the waveguide to prevent damage to the new waveguide components. Even minor dents and other deformations in either rigid or flexible waveguide, and the flanges thereof, as well as in the walls and flanges of the transducers or combining networks will seriously impair transmission and require replacement.

2.5.3

The following activities have historically caused damage to existing systems with resulting degradation of transmission:

- Painters pulling up paint containers on hand lines that rub against waveguide.
- Steel Contractor's pulling on waveguide networks while drilling in or around networks.
- Opening and closing cages. These cages are often so difficult to close that often the entire network mounting assembly is moved while trying to get them closed. Such difficulty should be referred to the tower Contractor for correction.

2.6 Radiation Hazard on Working Systems

Before beginning any work on a working antenna, waveguide system or structure supporting such a system, the Supplier shall review with the appropriate U S WEST representative all proposed methods and safety precautions that the Supplier shall take.

2.6.1

The U S WEST Manager shall make available to the Supplier all system power and radiation data along with various practices which outline precautions and protection for working personnel involved. These requirements are necessary because all working microwave systems may present a health hazard from Radio Frequency (RF) radiation. Final responsibility for the working safety of personnel from these hazards shall rest with the Supplier's designated safety officer.

2.7 Transportation

Approximately two weeks prior to the scheduled construction start date, a U S WEST representative will determine how much of the material order has been received.

If the U S WEST representative determines that there is sufficient material to start the project and continue it while the rest of the material is expedited, the representative will notify the Supplier to start on the scheduled date.

Before work has been started on the site, the Supplier shall check all material that is ordered for the work being performed. A written list of missing material shall be given to the U S WEST representative. The Service Supplier shall transport all material from the specified warehouse to the site and shall be responsible for this material from the time it is received until the completed work is accepted by U S WEST.

2.8 Materials

Unless otherwise specified, all materials furnished by the Supplier shall be new, of high quality and free from defects. Tower structure additions or modifications shall be performed in accordance with the latest issue of Tower Design Standard, EIA RS222D. Steel shall be galvanized per ASTM A123 and Hardware per ASTM A153.

2.9 Substitutions Or Variations

No deviations from the specifications and drawings shall be made without prior written approval from the U S WEST representative. Failure to comply with this provision shall render the Supplier liable for correction costs. The Supplier shall furnish the exact materials specified by the specifications and drawings unless changed by written approval. Where two or more materials are named, the Supplier shall have the choice of which one to use. The U S WEST representative shall determine the course of action when there are differences between job drawings and the specifications.

2.10 Documentation

The Supplier shall keep all manufacturers' installation/operation information, sweep documents, Antenna/Waveguide/Pressurization checklist and other documentation as required in the U S WEST Technical Publication 77350 in an orderly manner and shall turn this information over to U S WEST after inspection of the completed work.

2.11 Cleaning

The Supplier shall, at all times, keep the premises free from accumulations of waste material and rubbish caused by their employees or workers as outlined in U S WEST Technical Publication 77350.

2.11.1

At the completion of work, the Supplier shall remove all their rubbish from the site. In case of dispute, the U S WEST representative may have the rubbish removed at the Supplier's expense. If material or rubbish is not placed on grounds specifically designated for dumping, written permission to dump shall be obtained from the property owner and the document shall be turned over to the U S WEST representative.

2.11.2

No on-site burning will be tolerated unless the U S WEST representative and appropriate local authorities grant specific written authorization. A burning permit may be required. Toxic substances, if any, should be disposed of in accordance with current federal, state and local regulations.

2.12 Temporary Toilets

If required, the Supplier will provide portable chemical type temporary toilets. These facilities shall be approved by the U S WEST representative and shall agree with local building code requirements. The toilets shall be maintained in a neat and sanitary condition at all times. Temporary toilets and any litter shall be removed upon completion of the Supplier's work.

2.13 Welding

Where welding is required or permitted, it shall conform to all local codes and the requirements of the American Welding Society. Unless documented in the specifications and drawings, written permission for welding must be obtained from the U S WEST representative.

2.14 Cut, Welded Or Damaged Surfaces

Freshly cut surfaces or any surface where galvanizing has been damaged, such as by welding, shall be painted immediately with a zinc-rich touch-up paint. Any surface that is damp, coated with mud, greasy, etc., will be cleaned and dried before painting.

2.15 Surplus Material

The Supplier shall report, in writing, surplus suppliers' factory furnished material to the U S WEST representative. Upon receipt of shipping instructions from the U S WEST representative, the Supplier shall package and ship the surplus material as directed. The Supplier shall be responsible for transporting the surplus material to the original warehouse or to another location of equal or less distance, as determined by the U S WEST representative.

2.16 Storage of Material on the Site

The Supplier shall unload and store material in a careful, systematic manner to prevent damage from rust or other causes and to prevent loss of small pieces. Proper precautions, such as the use of skids, shall be taken to prevent material from resting on the ground or in water.

2.17 Protection of the Public

The Supplier should take the necessary precautions, as directed by the U S WEST representative; to protect the public from injury during and after the Supplier's working hours. For example, before the permanent fencing is erected, temporary fencing shall be placed around the tower at the Supplier's expense to discourage unauthorized climbing (i.e. eliminate an attractive nuisance).

2.18 Overtime Work

All work on Sunday, or at anytime that would require overtime by a U S WEST employee, is prohibited unless authorized in advance by the U S WEST representative.

2.19 Safety

Safety on the job is an important consideration for U S WEST. Responsibility rests on the Supplier to be sure that the job is done safely, but U S WEST maintains an interest in protecting telephone personnel and equipment. The Supplier shall comply with any applicable requirements as set forth by the U. S. Department of Labor, Occupational Safety and Health Administration (OSHA). The Supplier should designate a responsible employee (generally the job foreman) as "Safety Officer" and should maintain a first aid kit on job. The contents of the safety kit should include all items required by appropriate OSHA specifications.

Work aloft or on the ground by U S WEST personnel shall be performed in accordance with U S WEST Communications Safety And Loss Prevention Plan (SLLP), and all appropriate Local, City, County, Federal, State, and OSHA regulations.

2.20 Pre-construction Conference

After the contract has been awarded, the Supplier, together with sub-contractors and their supervisors, will meet with the U S WEST representative to review the plans and specifications and determine a satisfactory schedule and resolve any questions. At this meeting, the U S WEST representative will also cover "conduct of work", "sequence of work", "safety" and "overtime".

2.21 Use of Sub-contractors

The Supplier shall notify the U S WEST representative of their intention to use sub-contractors and provide a list of all sub-contractors for approval. The Supplier shall retain all responsibility for work performed by and the licensing of sub-contractors.

CONTENTS

Chapter and Section	Page
3. Antennas Installation.....	3-1
3.1 General.....	3-1
3.2 Antenna Installation (Horn, Parabolic, And Yagi/Whip).....	3-2
3.3 Antenna Heater Circuit.....	3-4

3. Antenna Installation

3.1 General

Several different types of antennas are in use throughout U S WEST. All antennas shall be inspected inside and outside for correct assembly and any possible damage immediately upon uncrating and before any further work is performed. Any damage or shortages should be reported to the U S WEST representative. The color of the antenna and antenna radome cover received should be verified against the engineering document ordering the antenna.

3.1.1

Care shall be taken at all times to avoid denting or otherwise deforming any parts, as this will impair the operations of the antenna.

3.1.2

All metal antenna surfaces and metal shrouds should be free from scratches and impressions. If scratches are minor in nature, they should be touched-up according to manufacturer's instructions.

3.1.3

All tools and materials required for the installation of the antennas shall be as specified in the individual installation instructions or equivalent.

3.1.4

If mounts and antennas are being added to an existing guyed tower, the Supplier shall record vertical tower alignment using a transit prior to installing mounts and antennas, record findings, and double check alignment at the completion of the installation. The Supplier shall forward these readings to the U S WEST representative. A copy shall be kept on site in the job package.

3.1.5

Antennas should be delivered to the site only far enough in advance of there planned installation to allow adequate assembly time. To avoid possible damage they shall not be stored at the site, either assembled or disassembled, for an extended period of time

3.1.6

The Supplier shall provide a skid or platform to form a sound working area for the assembly of parabolic and yagi antennas. Flat or gently slopping terrain near the antenna structure may also be used if precautions are taken to ensure dirt, debris, or moisture does not accumulate in or on the antenna.

3.1.7

The skid on which the horn antenna was shipped and all associated parts should be unloaded in an area where the terrain is relatively smooth and level, and as close to the base of the supporting structure as is practicable. Consideration should be given to hazards from objects that may fall or be dropped from the tower, possible interference with construction operations, etc. In no case will the horn antenna assembly be allowed directly on the ground

3.1.8

Before starting the antenna installation, inspect the interior of the antenna for the presence of water or, in cold weather, ice or frost. If moisture in any form is present, it must be removed before the antenna is installed.

3.1.9

All antenna surfaces should be free from scratches and impressions. If damages are minor in nature, use touch up paint provided by the manufacturer. If major in nature, the part(s) should be repaired or replaced at the direction of the U S WEST representative.

3.1.10

The antenna, the antenna feed horn, and the antenna feed shall be assembled according to the antenna manufacturer's instructions and recommendations. Inspect the inside of the antenna for foreign material and remove before attaching the feed horn. Appropriate care should be exercised to avoid any damage to the antenna during assembly.

3.1.11

Do not shorten the factory cabling harness on Yagi antennas. The engineer will supply element positions for directional antennas.

3.2 **Antenna Installation (Horn, Parabolic, And Yagi/Whip)**

3.2.1

The manufacturer's specifications shall be used to determine the correct rigging for hoisting the antenna. The hoisting procedures shall be reviewed with the U S West representative to ensure adequate precautions are taken to protect working service and the antenna is rigged and hoisted safely. Lines used for hoisting the antenna shall be in good repair and of sufficient size to adequately support the load with a reasonable safety margin.

*****CAUTION*****

Deploy personnel on the ground to handle the tag lines in the manner best suited to minimize erratic motion and prevent collision with the tower, other antennas, or other obstacles. Exercise extreme care to avoid contact with the guy wires when installing antennas on guyed towers.

Wind loading on the antenna can make control while hoisting the antenna difficult, especially when winds are gusting. Installation of an antenna should not be attempted unless wind velocities are calm and weather conditions are expected to remain stable.

3.2.2

Ensure that the antenna is installed at the correct transmission center line, azimuth or polarity as requested by the U S WEST representative and/or FCC documentation. The Supplier shall follow manufacturer's instructions for orienting the antenna and shall have necessary tools available for that purpose.

*****CAUTION*****

Do not leave the antenna elevation held solely by either the tubular shipping support or the tilt adjustment tool. Neither of these is designed to withstand the force created by even moderate winds blowing against the antenna. The antenna elevation must be locked in place as specified by the manufacturer for overnight or longer periods.

3.2.3

Before starting the antenna installation, inspect the interior of the antenna feed for the presence of water or, in cold weather, ice or frost. If moisture in any form is present, it must be removed before the antenna is installed.

3.2.4

Ensure that anti-seize or locking compound is applied to threads of bolts per the manufacturer's specifications.

3.2.5

The manufacturer's specifications shall be used to determine the correct rigging for hoisting the antenna. The hoisting procedures shall be reviewed with the U S West representative to ensure adequate precautions are taken to protect working service and the antenna is rigged and hoisted safely. Lines used for hoisting the antenna shall be in good repair and of sufficient size to adequately support the load with a reasonable safety margin.

3.2.6

If antennas are to be reused, ensure that the covers and cover hardware, shroud, feed, and all support hardware are available and in “like new” condition.

3.2.7

If the antenna has been in-service at another location and uses stainless steel cover hardware, new cover hardware should be used when the cover is installed (stainless steel hardware threads will bind and gall, preventing the nuts from being loosened or tightened correctly).

3.2.8

Antenna covers should be installed according to the manufacturer's specifications.

3.2.9

Parabolic antenna covers (radomes) shall be of polymer-coated material if they are available for the type of antenna being installed.

3.2.10

Use manufacturer approved mounting hardware kits, as supplied by U S WEST. Align Yagi's under the direction of U S WEST.

3.2.11

Connect transmission lines per Chapter 4.

3.2.12

Perform pressurization tests per Chapter 5

3.3 Antenna Heater Circuit

Conduit for antenna heater circuits shall be installed in accordance with the most current issue of the National Electric Code (NEC) and local electrical codes.

CONTENTS

Chapter and Section	Page
4. Transmission Waveguide	4-1
4.1 General.....	4-1
4.2 Precautions	4-1
4.3 Circular Waveguide	4-3
4.3.1 Bent Circular Rigid Waveguide	4-3
4.3.2 Rigid Circular Waveguide.....	4-3
4.3.3 Installation.....	4-3
4.4 Rectangular Waveguide.....	4-3
4.4.1 General.....	4-3
4.4.2 Flexible Rectangular Waveguide.....	4-4
4.4.3 Rigid Rectangular Waveguide.....	4-4
4.4.4 Weather Seals.....	4-4
4.4.5 Installation.....	4-4
4.5 Elliptical and Coaxial Waveguide.....	4-7
4.5.1 General.....	4-7
4.5.2 Installation.....	4-7
4.5.3 Installation - Coaxial Waveguide Only	4-10
4.6 Miscellaneous Waveguide Components.....	4-10
4.7 Waveguide Leakage Test	4-10
4.8 Electrical Tests	4-11
4.9 Waveguide Grounding	4-11

4. Transmission Waveguide

4.1 General

The types of Transmission Lines found in U S WEST Communications include, but are not limited to; Elliptical, Coaxial, Rigid, or SemiRigid. These transmission lines can be either pressurized or non-pressurized. The transmission line connects the antenna to the radio transmitter/receiver, is supported at correct intervals, and may have additional protection from ice or falling objects. Working transmission lines should not be moved or opened without approval of the U S WEST Antenna or Operations Manager. A through knowledge of the radio system, type of transmission line, and manufacturer specifications is required before performing any work on transmission lines.

Circular, rectangular, elliptical and coaxial waveguides are available for connecting the antenna to the radio equipment. The circular waveguide is capable of carrying horizontally and vertically polarized signals. Rectangular and elliptical waveguides carry only one polarization of a frequency band and a different size guide is required for each frequency band.

In order to make the transition from circular to rectangular or elliptical guides, and when required to separate the frequency bands and polarization with the frequency band, a combination of networks and/or transducers is installed.

4.1.1

Waveguide should be delivered to the site only far enough in advance of their planned installation to allow adequate assembly time. They shall not be stored at the site for any extended period of time. The Supplier shall provide a storage area, which will protect the waveguide from the weather. In no case will the waveguide be allowed to be stored directly on the ground, or in areas where standing water is present.

4.1.2

Ensure the transmission line or waveguide is of the type and quantity ordered. Waveguide labels should be removed and given to the U S WEST representative at the completion of the installation.

4.1.3

Rigid and elliptical waveguide between the antenna and pressure window shall be installed without "drip loops".

4.2 Precautions

All Suppliers shall take precautions to protect workers from hazards posed by Radio Frequency (RF) radiation. See Chapter 2.5

4.2.1

When antenna or waveguide work is performed at an existing station, working equipment may be affected. Every precaution shall be taken to ensure that working equipment is protected from physical damage, misalignment, movement or interruption.

4.2.2

Special care shall be taken, when hoisting materials, to ensure that material is not raised in front of working antennas. The U S WEST representative shall be advised prior to the start of any work at an existing station and again advised at the completion of each days work and at the completion of the job. An "all-clear" shall be obtained from the U S WEST representative before leaving the station in each case.

4.2.3

Extreme care shall be taken during transporting, unpacking, and installation of the waveguide to prevent damage to the new waveguide components. Even minor dents and other deformations of both rigid and flexible waveguide, and the flanges thereof, as well as in the walls and flanges of the transducers or combining networks will seriously impair transmission and require replacement.

4.2.4

Suppliers shall ensure that all coaxial or waveguide connections meet manufacturer specifications and that all hardware, including gaskets, are installed correctly.

4.2.5

Suppliers shall ensure that no foreign material is introduced into, or remains inside the waveguide system when the installation is complete. Serious impedance discontinuity may result if this condition is not scrupulously observed. This includes nuts, bolts, putty, metallic filings, solder runs or water.

4.2.6

If required, the equipment shall be cleaned with solvent applied with cloth, drawn through the waveguide with a string or chain, being careful not to scratch the inner surface.

The following activities have historically caused damage to existing systems with resulting degradation of transmission:

- Painters pulling up paint containers on hand lines and rubbing against waveguide.
- Steel Contractor's pulling on waveguide networks while drilling in or around networks.
- Opening and closing cages. These cages are often so difficult to close that often the entire network mounting assembly is moved while trying to get them closed. Such difficulty should be referred to the tower Contractor for correction.
- Removing and replacing circular flexible waveguide. Circular flexible waveguide should not be left in place as part of a final installation, but should only be used for alignment. If a system is encountered that still uses flexible circular waveguide, the U S WEST representative should contact the responsible engineer for replacement. If any work is done on the flexible circular waveguide, a measurement of the cross-polarization discrimination must be made afterward.
- Removing and replacing the antenna feed horn. The cross-polarization discrimination should be measured after any work on the feed horn, or after antenna alignment.

- Loose bolts in circular waveguide flange. All flanges must be tight to maintain adequate discrimination, return loss and pressure.

4.3 Circular Waveguide

4.3.1 Bent Circular Rigid Waveguide

This waveguide has the same physical characteristics as the rigid circular waveguide, except that one flange is fixed and one flange rotates. The waveguide will be precision bent as required on site by the U S WEST representative or Contractor. The Contractor will install the waveguide, hanger plate and support rods per this document.

4.3.2 Rigid Circular Waveguide

The circular waveguide assemblies have flanges on each end of the tubing. The circular flange has an O-Ring groove for a gasket, thereby ensuring a pressure-tight waveguide run. This waveguide is installed between the bent rigid waveguide at the top of the tower and the system combining networks at the bottom of the tower.

4.3.3 Installation

The installation of the circular waveguide shall be performed per manufacturer's specifications.

Unpack and arrange in sequence of installation all rigid circular waveguide sections. Inspect all sections for damage and cleanliness and clean if necessary.

The following steps shall be used to assemble waveguide sections:

- Install adjoining waveguide sections in the normal manner, inserting all bolts. Tighten nuts slightly. Circular rigid waveguide flange bolts should be installed with the nuts up.
- Follow manufacturer's instructions to ensure that the flanges from the adjoining sections are fully aligned.
- All waveguide bolts should be tightened to the torque listed in the manufacturer's specifications.

4.4 Rectangular Waveguide

4.4.1 General

Rectangular waveguide is used between either a parabolic antenna or system combining network and the radio equipment inside the building. Since rectangular waveguide is capable of carrying only one polarization of a frequency band, a different size guide is required for each frequency band and a separate guide is required for each polarization.

4.4.2 Flexible Rectangular & Circular Waveguide

This assembly consists of convoluted interlocking flexible metal hose of essentially rectangular cross-section covered with a rubber protective jacket. This assembly mates mechanically with the gasket equipped flanges attached to the rigid waveguide. Where circular waveguide is found in a working radio system, it should be referred to the US West Radio Design Engineer.

4.2.2.1

The flexible waveguide must be handled carefully, as dents or other deformations may greatly impair transmission. The specified bending radius shall not be exceeded.

4.4.3 Rigid Rectangular Waveguide

The rigid rectangular waveguide assemblies are made in cross-sectional sizes as noted above. They are made of copper rectangular tubing with brass flanges soldered onto each end of the tubing.

4.4.4 Weather Seals

A weather seal arrangement is required for waveguide or transmission line entering a building through the roof or a side wall. Where waveguide or coaxial transmission line enters through the roof, a galvanized steel hatch cover plate is used to seal the roof opening.

4.4.4.1

Where waveguide or coaxial transmission line enters the building through a side wall, either galvanized steel, plastic PVC pipe or aluminum panel will be used to seal the wall opening.

4.4.4.2

Waveguide hatches or entries should be grounded in accordance with the grounding provisions described in U S WEST PUB 77355, *Grounding-Central Office and Remote Equipment Environment*.

4.4.5 Installation

Extreme care should be taken in handling and installing of waveguide. Each piece should be examined closely for dents or other deformations on both the waveguide and the flanges.

4.4.5.1

Any piece that has been damaged, regardless of how minor, should not be used in a system, since it may degrade the quality of transmission. Under no circumstance should waveguide ever be walked on, stood on, sat on or used as a support, such as for a ladder.

4.4.5.2

Care should also be taken to ensure that no foreign material is introduced into, or remains inside the waveguide system when the installation is completed. Serious impedance discontinuity may result if this precaution is not observed scrupulously.

4.4.5.3

Reference should be made to all associated drawings for specific mounting arrangements and instructions. Deviations from the site drawings should not be made without prior approval of the U S WEST representative.

4.4.5.4

Protective covers should be kept on the waveguide flanges until that particular flange is to be assembled to an adjoining flange. The hardware furnished with the protective covers shall be used in the waveguide installation, unless otherwise specified. Tools, hardware, etc., should never be allowed to enter the waveguide.

4.4.5.5

All cap screws and nuts shall be tightened securely, with the lock washers adjacent to the nuts, in such a manner as to be drawn up evenly. Care should be taken to ensure that there is no undue stress or strain placed upon the waveguide flange joint. In vertical runs of waveguide, all bolts should be installed in the nut-up position.

4.4.5.6

Waveguide should be properly aligned and never "Forced" to make flanges meet, as the flange faces may not be parallel, resulting in distortion or damage to the waveguide.

4.4.5.7

In the pressurized runs, gaskets are furnished for each connection. Follow the manufacturer's instructions for installation. The flange face must be free of any foreign matter both internally and externally, at all times.

4.4.5.8

Flexible waveguide must never be positioned in such a manner as to violate the manufacturer's bend and twist requirements of each individual section of waveguide.

4.4.5.9

A waveguide run must never be pulled to gain an extra inch. Stretching the flexible waveguide may cause serious damage both internally to the metal tubing and at the junction of the tubing and the flanges.

4.4.4.10

When an entire installation cannot be completed, care must be taken to ensure that there are no waveguide flanges without protective covers. Protective covers must be assembled on the open flanges in the run and on the piece of waveguide removed from the run.

4.4.4.11

Kits are available for field flanging of rectangular waveguide. Tests of the waveguide should be performed. If any field flanges are found to be below standards, the waveguide section should be replaced. A field-applied flange in a vertical run shall be installed at the lowest point in the run. A modification should not be made without the prior approval of the U S WEST representative.

4.4.4.12

When installing waveguide on towers, follow the manufacturer's guidelines to ensure proper alignment and mating of the waveguide sections and to avoid damage to the waveguide sections. Long sections of horizontal waveguide should be adequately supported or restrained. The flanges should not be expected to carry a "Twist" load.

4.4.4.13

Adequate protection should be provided to avert damage that could occur due to falling ice or other debris, particularly where the waveguide is run in a horizontal path.

4.4.4.14

When flexible waveguide is used, it should be run in a smooth bend, avoiding low spots where condensation could collect. Grounding across outdoor flexible waveguide sections should be maintained in accordance with the guidelines in U S WEST Technical Publication 77355 *Grounding-Central Office and Remote Equipment Environment*.

4.4.4.15

The Supplier shall pressure test each waveguide run for leakage by applying a dry gas under pressure to each run. If leaking is encountered, check each flange by using a soap solution. The pressure shall not exceed the manufacturer's specifications nor the U S WEST pressurization specifications listed in chapter 5 of this publication.

4.4.4.16

When installing the building entrance, the Supplier shall apply caulking or other means to ensure a watertight fit.

4.5 Elliptical and Coaxial Waveguide

4.5.1 General

Elliptical waveguide is similar to rectangular waveguide in that it is made in different sizes for each frequency band, and each waveguide can transmit and receive only one polarization of a frequency band.

A major advantage of elliptical waveguide is that it can be installed in one continuous length from the antenna to the radio equipment. Elliptical waveguide is usually shipped on a reel. The waveguide may be shipped with or without factory-installed connectors.

Coaxial cable is recommended for microwave systems operating in the 2 GHz and lower bands. A major advantage of coaxial cable is that it can be installed in one continuous length from the antenna to the radio equipment. Coaxial cable is shipped on a reel or in a box.

4.5.2 Installation

4.5.2.1

The transmitting equipment and antenna should be installed prior to the waveguide. Inspect the waveguide for possible shipping damage and pressure loss. If the waveguide has a pressure loss, check all joints for possible leaks.

4.5.2.2

Factory attached connectors are shipped with a blank flange attached to maintain pressure during shipment. Do not remove the blank flange until after the waveguide is installed, as it also affords protection to the connector face and prevents accidental entry of foreign matter.

4.5.2.3

When bulk waveguide is used, field attachment of the connector at the antenna end must be completed before hoisting. Remove the pressurizing cap just prior to use. Attach the connector to the end of the bulk waveguide in accordance with the connector instructions received. Be very careful to keep all connector parts perfectly clean. Pressure test the assembly.

4.5.2.4

Provide a strong pulley high enough on the tower to allow the waveguide to be raised sufficiently to make a proper antenna connection. The pulley should be positioned on the tower where the weight being hoisted will not damage, bend or deform the tower horizontal or diagonal cross members. Most lengths can be hoisted manually; however, a winch is recommended for lifting several hundred feet of the larger waveguides. Additional tying is done above and below the cable grips to keep the weight on the hoist line and to avoid unnecessary stresses on the waveguide.

4.5.2.5

Make certain to allow slack in the waveguide when tying, and that slack is maintained during hoisting. Tying is accomplished with a strong, fiber-reinforced tape or similar material applied generously at 15 or 20 foot intervals as the waveguide is raised. Follow the manufacturer's instructions to ensure that the waveguide is not damaged as it is pulled from the reel.

4.5.2.6

Hoist the waveguide slowly. To prevent kinking, rotation of the reel must be retarded to control payout of the waveguide as required.

4.5.2.7

During installation of the waveguide, no bend of the waveguide should exceed that recommended by the manufacturer. It is recommended that the waveguide be bent with bending tools obtained from the manufacturer.

4.5.2.8

After the waveguide has been raised to the correct height, use the cable grip as a temporary anchor to support the waveguide until the connector has been properly mated with the antenna input. Provide sufficient slack to permit an easy flange alignment. Remove the protective covering and blank flange from the connector and connect the waveguide to the antenna. Maintain hoist line tension until anchoring is completed. Waveguide grips, used to hoist elliptical waveguide, should be left in place on the waveguide and secured to the tower structure.

4.5.2.9

All waveguide is subject to vibration from wind and shall not be left unsupported.

4.5.2.10

Hot dipped galvanized square support rails or leg clamps are approved for elliptical or coaxial line support and should be attached uniformly at five-foot intervals to the vertical angle iron runs or diagonal cross members. A minimum of three attachments in a 20 foot section of square support rail is allowed only where the square support rail is being attached to diagonal cross members and the five foot spacing cannot be maintained. Galvanized square support rail that is cut shall be coated per Chapter 2, Paragraph 2.14.

4.5.2.11

Waveguide and coaxial line supports should be installed per the manufacturer's instructions unless local conditions dictate more stringent requirements. Position the hangers to hold the waveguide away from tower members. Rubbing against edges could cause damage later. If adding or changing waveguide clamps, the U S WEST representative should specify the type of clamps to be used. In most cases, the new clamps should match those being used on existing waveguide runs.

4.5.2.12

Be very careful not to tighten the hangers excessively to avoid deforming the waveguide.

4.5.2.13

Dents or deformations can cause degradation in the electrical performance. Follow the hanger instructions included with the hangers. As the hangers are attached, the entire length of waveguide should be inspected for possible damage.

4.5.2.14

The top (within 3 feet of the antenna) and bottom (of the vertical run) of the waveguide should be grounded to the tower by using approved grounding kits which have low impedance conductors. Grounding kits should not be placed in a bend of waveguide. In addition, the waveguide should be grounded at a point where it enters the building, using approved grounding kits, 2-hole #2 American Wire Gauge (AWG) crimp connectors and bolting directly to the hatch, or ground buss at the hatch, using stainless steel bolts and nuts, per the requirements in U S WEST Technical Publication 77355, *Grounding-Central Office and Remote Equipment Environment*.

4.5.2.15

Attach all ground wire connections on coaxial and elliptical waveguide to a horizontal support member using the same type hangers and intervals as in the vertical run.

4.5.2.16

Exposed horizontal runs must be protected from the weight of accumulated ice and damage from falling ice or other objects.

4.5.3 Installation - Coaxial Waveguide Only

4.5.3.1

Coaxial cables may be supported on cable ladders, buried, or suspended from the messenger support cable from the tower to the transmitter building. Jacketed coaxial cables can be buried if approved by the manufacturer. The minimum bending radius of the coaxial cable shall never be exceeded.

4.5.3.2

Do not trim off any cable (even if it looks extra) from an antenna or array feed harness.

4.5.3.3

When installing mobile radio antennas, the cable harness must be assembled according to the manufacturer's specifications, with radiating elements in proper phase.

4.5.3.4

Coaxial cables should be grounded as outlined in U S WEST Technical Publication 77355, *Grounding-Central Office and Remote Equipment Environment. Lightning Arrestors may also be used and should be installed to agree with the Grounding Technical Publication mentioned above.*

4.6 Miscellaneous Waveguide Components

Various networks and components have been developed so that radio relay systems can be used with the horn reflector antenna and its associated circular waveguide. The networks are attached to the circular waveguide to separate the frequency bands and the polarization's within the frequency bands.

4.6.1

Installation of miscellaneous waveguide components shall be in accordance with the manufacturers' instructions.

4.6.2

The Supplier shall make final tests to ensure that the polarization's comply with the construction permit and that the isolation between polarization's meets the manufacturer's specifications.

4.7 Waveguide Leakage Test

Overall leakage tests shall be performed to ensure the integrity of the complete antenna system, including the antenna, waveguide and connectors. These tests shall be made in accordance with the manufacturers' specifications and shall be made from the pressure

window. The test results should be recorded on the Antenna/Waveguide/Pressurization Checklist (see Chapter 5).

4.8 Electrical Tests

Elliptical or coaxial transmission line shall be transmission tested to meet the performance specified in the Radio Transmission Design document or as specified in the U S WEST Equipment Order. These tests shall be performed: (1) While the waveguide is still on the reel (before hoisting into place), and (2) after the waveguide or transmission line is hoisted and secured into its final position.

4.8.1

All antenna and transmission line systems are to be tested for loss, return loss, and cross-polarization discrimination (where appropriate) from the radio bay to the antenna. The antenna should be included in the measurement of return loss. The specific objective values for each parameter will be specified by the design engineer. A printed copy of these tests should be forwarded to the U S West Design Engineer and a copy left in the Job Package at the completion of the job.

4.9 Waveguide/Transmission Line Grounding

Outdoor waveguides and/or transmission lines are subject to being struck by lightning and must be well grounded due to the large currents which are setup during a lightning strike. These currents are rendered relatively innocuous through the paralleling of multiple paths. This is especially important where links in the conductive path, such as the flex waveguide, have smaller current carrying capacity and higher impedance than other portions of the path, such as the rigid waveguide. All outside waveguide, transmission line, and associated support structures shall be bonded and grounded in accordance with requirements specified in U S WEST Technical Publication 77355, *Grounding-Central Office and Remote Equipment Environment*.

4.9.1

The top (within 3 feet of the antenna) and bottom (of the vertical run) of the waveguide or transmission line should be grounded to the tower by using approved grounding kits which have low impedance conductors. Grounding kits should not be placed in a bend of waveguide or transmission line. In addition, the waveguide and transmission line will be grounded using approved grounding kits per the requirements in US WEST Technical Publication 77355, *Grounding-Central Office and Remote Equipment Environment*.

4.9.2

Attach all ground wire connections on elliptical waveguide and coaxial transmission lines to horizontal support members using the same type ground kits, specifications, and intervals as in the vertical run.

CONTENTS

Chapter and Section	Page
5. Pressurization Systems	5-1
5.1 General.....	5-1
5.2 Components	5-1
5.3 Installation.....	5-3
5.4 Turn Up	5-5
5.5 Operation and Maintenance	5-5
5.6 Use of the Antenna/Waveguide/Pressurization Checklist.....	5-6

Figures

5-1 Dry Air System Block Diagram.....	5-7
5-2 Air Manifold Systems.....	5-8
5-3 Pressure Monitor/Alarm Assembly.....	5-9
5-4 Portable Pressure Gauge For Turnup and Maintenance	5-10
5-5 Installation and Removal Checklist.....	5-17

5. Pressurization Systems

5.1 General

All air dielectric transmission lines and antenna systems used outdoors in U S WEST will be pressurized using dry air or nitrogen. The purposes of the pressurization system are to:

- Prevent condensation and corrosion inside the antenna and transmission lines.
- Prevent entry of foreign material into the antenna or transmission lines.
- Provide a method to alarm the antenna system if it is mechanically breached.

Wet air inside a transmission line will condense in cool weather. Even if the condensed water is not of sufficient quantity to cause immediate transmission impairments, the dampness will cause the copper transmission lines to corrode, seriously degrading transmission performance.

Small holes in an antenna system without pressure will allow the entry of significant amounts of water during storms. Small insects are also noted for their ability to find these tiny holes.

Large holes, such as those caused by bullets, can cause the pressure in a system to drop to nothing and leave a convenient opening for even fairly large insects and lots of water. A pressure monitor and alarm system is used to give the alarm center immediate indication if the pressure drops below a predetermined level.

Some manufacturers recommend supplying dry gas to the indoor waveguide in wet climates. The equipment engineer will determine whether inside air is required. The indoor portion of elliptical waveguide runs and coaxial transmission lines will be pressurized because the pressure window is located at or near the radio equipment.

Pressurization systems are of two main types, high volume or low volume. High volume systems operate at low pressure and are typically used for horn antenna systems, but can be used for parabolic dish systems. Older low volume systems typically operate at pressures substantially higher than the high volume systems, but can be regulated to operate at lower pressures if desired. Low volume systems are for use with parabolic dish or UHF/VHF systems only. All new low volume systems will operate at low pressure approximately equal to 9 Inches of Water Column (IWC).

5.2 Components

Air pressure systems consist of three major subsystems:

- Air dryer or compressed nitrogen bottle.
- Air/gas distribution system. (See Figure 5-1).
- Pressure monitor/alarm system (see Figure 5-3).

5.2.1

Dry nitrogen is commercially available, but is used only for temporary arrangements, or at solar-powered repeater sites where ac power is not available.

5.2.2

An air dryer filters ambient air, compresses and cools it, and then sends the cool air through a desiccant tower or drying membrane where it is dried, and on to the distribution system. Two basic types of air dryers are available, automatic and manual.

5.2.3

Automatic air dryers automatically regenerate the desiccant in the towers. Manual dryers require periodic replacement of the desiccant. Only automatic air dryers shall be used by U S WEST. High volume air dryers typically use turbine or rotating vane compressors and exhaust wet air outside. In dry climates, the wet air can be exhausted into the building.

5.2.4

The U S WEST Communications engineer or their authorized representative and the U S WEST real estate representative will make the wet air exhaust determination.

5.2.5

Low volume air dryers typically use piston compressors and external regulating tanks. Small air dryers are available with or without regulating tanks (reservoirs). Low volume air dryers used by U S WEST must be supplied with regulating tanks.

5.2.6

If sufficient capacity and pressure regulation is available, the air dryer used for cable pressurization in central offices can be used to supply dry air for the antenna systems. The U S WEST representative will specify the size and type of dryer to use, with consideration for size, capacity, location, spare parts, maintenance, and approved product availability.

5.2.7

Distribution systems provide a means to distribute and turn on or off the dry air to the antenna systems. Dry air is fed from the air dryer system through a pressure regulator to a manifold. The pressure regulator controls the pressure in the entire system. A separate feed line, with shut off valve at the manifold, is routed to each point needing air. The size of the line from the air dryer to the manifold is determined by the equipment engineer (see Figure 6-2).

5.2.8

The monitor/alarm system constantly monitors the pressure in each antenna system and provides an alarm (dry contacts) if the pressure drops below a preset level. Pressure monitors are not to be connected using a Tee fitting off of supply lines (see Figure 5-3).

5.3 Installation

The Installation Supplier is to maintain all manufacturer installation, operation, and maintenance literature in an orderly manner. This information will be used during an acceptance inspection. Deviations from instructions will be corrected by the Supplier or accepted by the U S WEST representative, with concurrence from the acceptance engineer/operations supervisor, prior to final acceptance.

5.3.1

The air dryer is to be mounted on the floor or stand inside the building under the waveguide hatch per manufacturer instructions. A plywood mounting board for pressure monitors is to be mounted on the inside wall above the air dryer. Large manifolds are to be mounted on the wall beside the waveguide hatch. Small manifolds for low volume systems may be mounted on the mounting board.

5.3.2

Pressure monitors are to be mounted on the board and labeled, per the equipment engineer, as "transmit to" or "receive from" the next site. Do not label polarity; it is the antenna system that is alarmed, not individual transmission lines (see Figure 6-1).

5.3.3

Supply lines from the manifold to the individual transmission lines are to be equipped with shut off valves at the manifold. Parabolic and VHF/UHF antenna systems are to be fed with 0.25-inch (minimum) tubing. Conical horn antenna systems are to be fed with a minimum of two feeds of 3/8-inch (minimum) tubing. Pyramidal horn antenna systems are to be fed with one 3/8-inch (minimum) tubing.

5.3.4

Pressure monitor lines are to be connected to the pressure monitor from a different waveguide run than the feed line, unless there is only one transmission line. Bulkhead style pressure windows provide two openings to the pressurized side of the window. Where these type windows are used, it is acceptable to feed air into one fitting and monitor pressure off of the other fitting.

5.3.5

Elliptical waveguide connectors are equipped with one air fitting. In the case where only one run of elliptical waveguide is provided to an antenna system, or when only two runs of elliptical waveguide are provided to an antenna system, or when only two runs of elliptical waveguide feed a horn antenna system, air feed spacers are to be used to provide extra air fittings for the pressure monitor or supply lines. The size of pressure monitor lines is not critical, so 3/8-inch tubing should be used, though 1/4 inch tubing is allowed. A shut off

valve is to be provided at the pressure switch before the monitor fitting/gauge and switch (see Figure 5-3).

5.3.6

Plastic tubing is to be used on all new installations in U S WEST. Plastic tubing comes in flexible and semi-rigid types. UV resistant tubing is also available for the rare occasions where airlines need to be run outdoors. The type used is to be specified by the U S WEST representative.

5.3.7

Push on connectors are available for the flexible tubing, and compression connectors are available for the semi-rigid tubing. The proper size and type of connectors are to be used in all installations. The use of adapters is acceptable only to change the size of the pipe threads at the manifold or pressure windows. The use of these adapters is to be kept to a minimum.

5.3.8

All pipe threads are to be coated with pipe dope or seamless non sticking tape wrapped in the proper direction.

5.3.9

Separate alarms are to be provided from each pressure monitor and the air dryer to the site or office alarm unit. Alarms are to be tested for proper operation into the responsible alarm center prior to system turn up.

5.3.10

Horn antenna system water traps have a built-in leak to continuously purge the system. In order to prevent high-pressure buildup due to temperature changes, horn antenna systems are to be equipped with pressure relief valves (pop off valves). Feed lines from the transmission line to the relief valve are to be 0.50 inch (minimum). It is permissible to use a Tee connection for the relief valve off of the pressure monitor line; however, if this method is used, the air line from the transmission line to the relief valve must be 0.50 inch tubing. The relief valve is to be mounted indoors as close as possible to the pressure window.

5.3.11

High volume dryers operate continuously, but low volume systems operate intermittently and need to be prevented from short cycling. If a low volume air dryer doesn't run at about a 20 percent duty cycle, the inactive drying tower will not be able to regenerate the desiccant.

5.3.12

Use of a reservoir tank is the easiest method of preventing short cycling, but some manufacturers also offer a bypass kit that allows the duty cycle to be increased. If difficulty in obtaining a proper duty cycle is encountered with a reservoir tank system, then controlled leakage plugs can be installed in one or more transmission lines. The controlled

leakage plugs should be installed on the return (monitor) side of the system. The easiest installation point for the plugs is in a Tee at the pressure monitor. The controlled leakage plugs leak approximately 7 Standard Cubic Feet per Hour (SCFH). If difficulty is encountered obtaining controlled leakage plugs, they may be made by having a local shop drill a countersunk 0.060 inch orifice (#60 drill) in a pipe plug.

5.4 Turn Up

Turn up of the dry air system must be coordinated with the turn up of the antenna systems on new installations. Operating specifications are to be provided by the U S WEST representative. The following turn up procedure shall be used:

- Turn off all supply line valves.
- Turn on and test dehydrator operation per manufacturer's instructions.
- Check operation of remote alarms.
- Check manifold pressure and adjust if necessary.
- Turn up and purge antenna systems one at a time. Purge antenna systems by loosening a flange or monitor at the farthest possible point from the supply fitting.

Note: For coaxial and/or single transmission line antenna systems, this point will be at the antenna.

- Open the supply valve and allow dry air to blow through the system for one hour. Close the opened connection after purging.
- Check and set the pressure alarm point by placing a pressure gauge on the monitor fitting, (see Figure 6-4) and turning off the valve on the pressure monitor line. Pressure will fall rapidly. Note and set, if necessary, the alarm point. Newer systems operate at 9 inches Water Column (WC) and alarm at 3 inches WC. Check the antenna/transmission line system for leaks per the suppliers instructions.

5.5 Operation and Maintenance

New pressurization systems are to operate at 6-10 IWC. Older low volume systems can be found operating up to 10 Pounds per square inch (psi). The pressure should not exceed 80% of the lowest rated component in the system.

The following checks are to be performed annually:

- Physical inspection.
- Check pressure alarm operation.
- Check air dryer per manufacturer's literature.
- Quick check for leaks by plugging controlled leakage plug, shutting off air supply, and timing leakage. The leakage rate is to be per the antenna system supplier. If major leaks are suspected, the antenna and transmission lines are to be checked with soap and water solution for leaks.

- Check labeling.
- Remove or arrange for the equipment engineer to remove retired equipment.

Distribution parts, tubing, fittings, looms, and seamless, nonsticking tape are available at most hardware stores. The maintenance supervisor is to put together a kit(s) for maintenance and upgrade contents per local requirements.

For emergency operation, maintenance forces have occasionally used central office cable dehydrators or low volume, high-pressure dehydrators. **EXTREME CAUTION** must be used when this is done, to ensure the maximum allowable pressure of the antenna is not exceeded. Excessive pressure to a horn antenna will cause expensive damage and may cause sudden catastrophic failure (explosion).

5.6 Use of the Antenna/Waveguide/Pressurization Checklist

5.6.1

All contractors' performing Installation/Maintenance of Antenna, Waveguide and Pressurization Equipment and/or Systems will complete a checklist form during or at the completion of the job. This will ensure that all work items are complete as requested in the Installation or Maintenance Work Order, and that the quality of the work performed meets Specifications and/or local conditions.

5.6.2

The form shall be reviewed at the initial Method Of Procedure (MOP) meeting or prior to actual job start. The Service Supplier/Contractor will complete the form during the job or at job completion, and present it to the U S WEST representative performing the final inspection.

5.6.3

The final inspection will be performed with the Service Supplier/Contractor, using the checklist as a reference. The completed copy of this checklist will be included in the Job Package as part of the Installation or Removal process. A copy of the Antenna/Waveguide/Pressurization Checklist is enclosed in this section (Figure 5-5) and may be copied for use as needed.

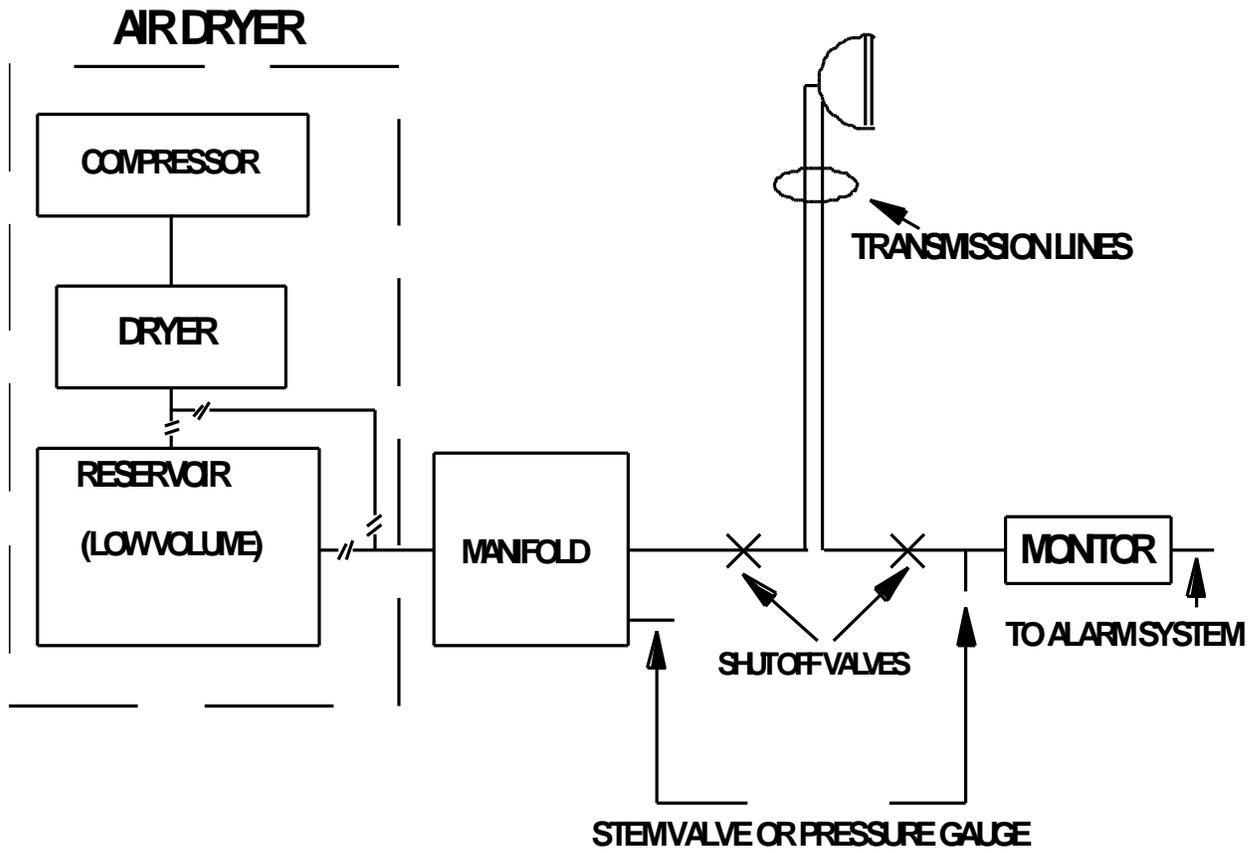


Figure 5-1: Dry Air System Block Diagram

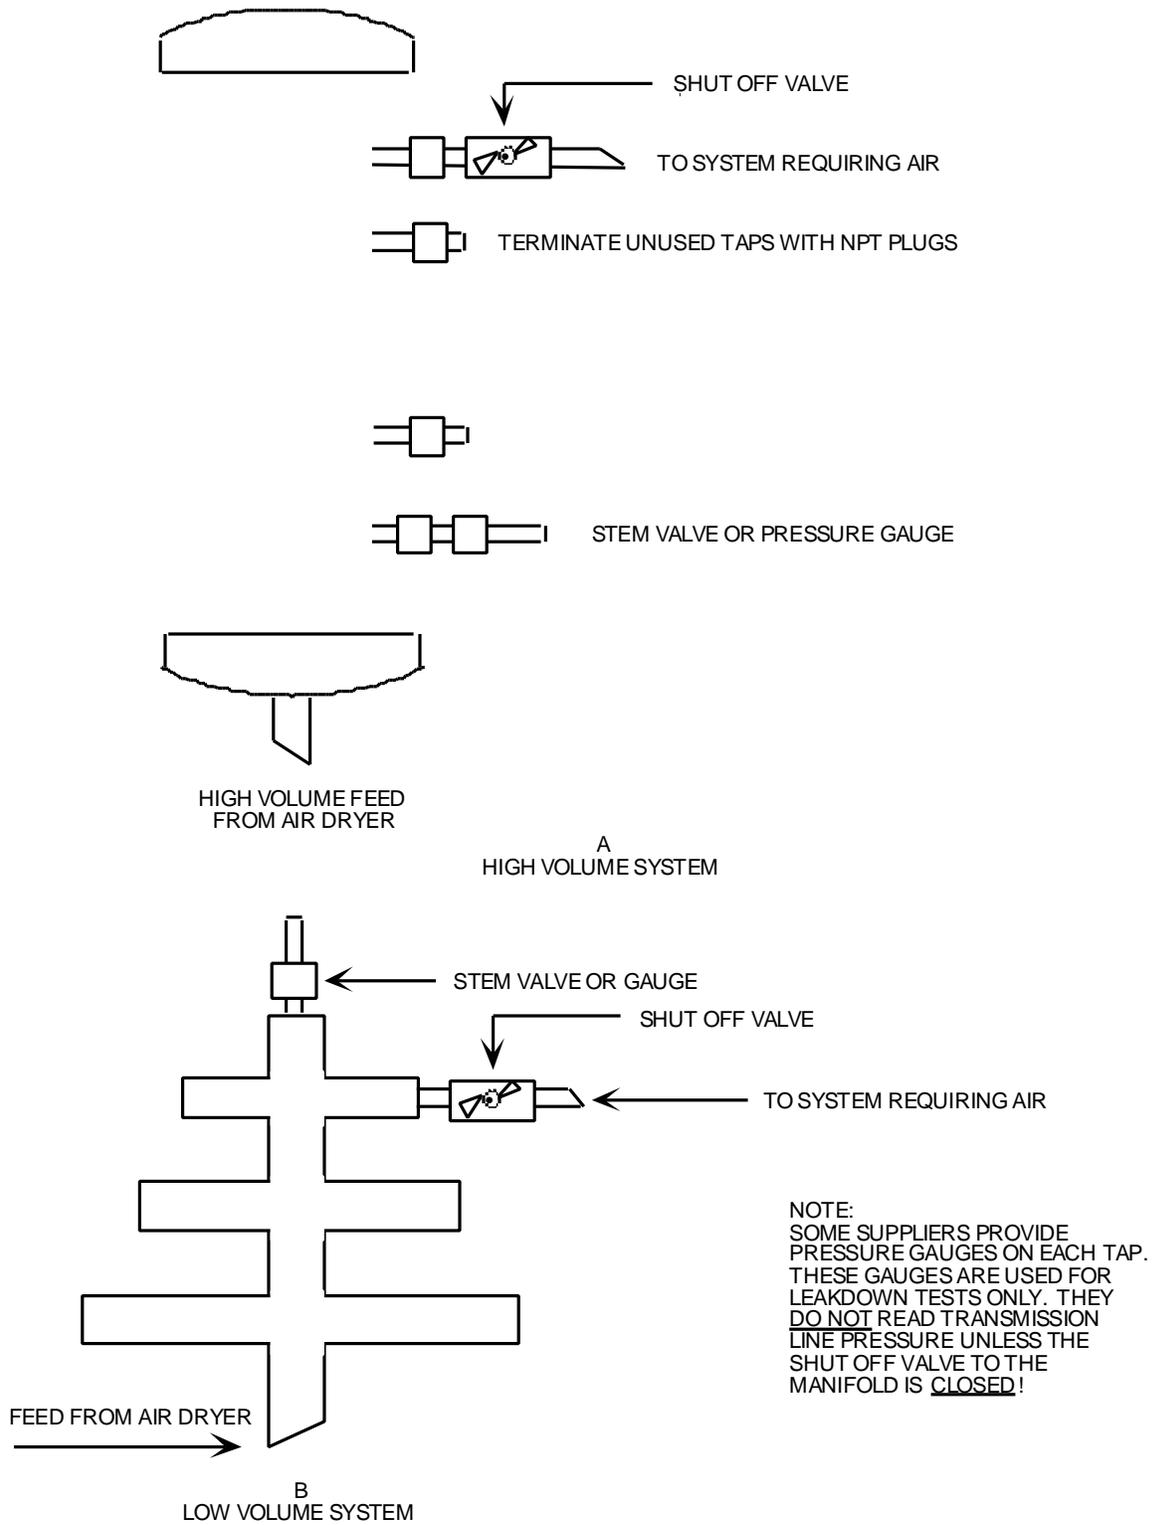


Figure 5-2: Air Manifold Systems

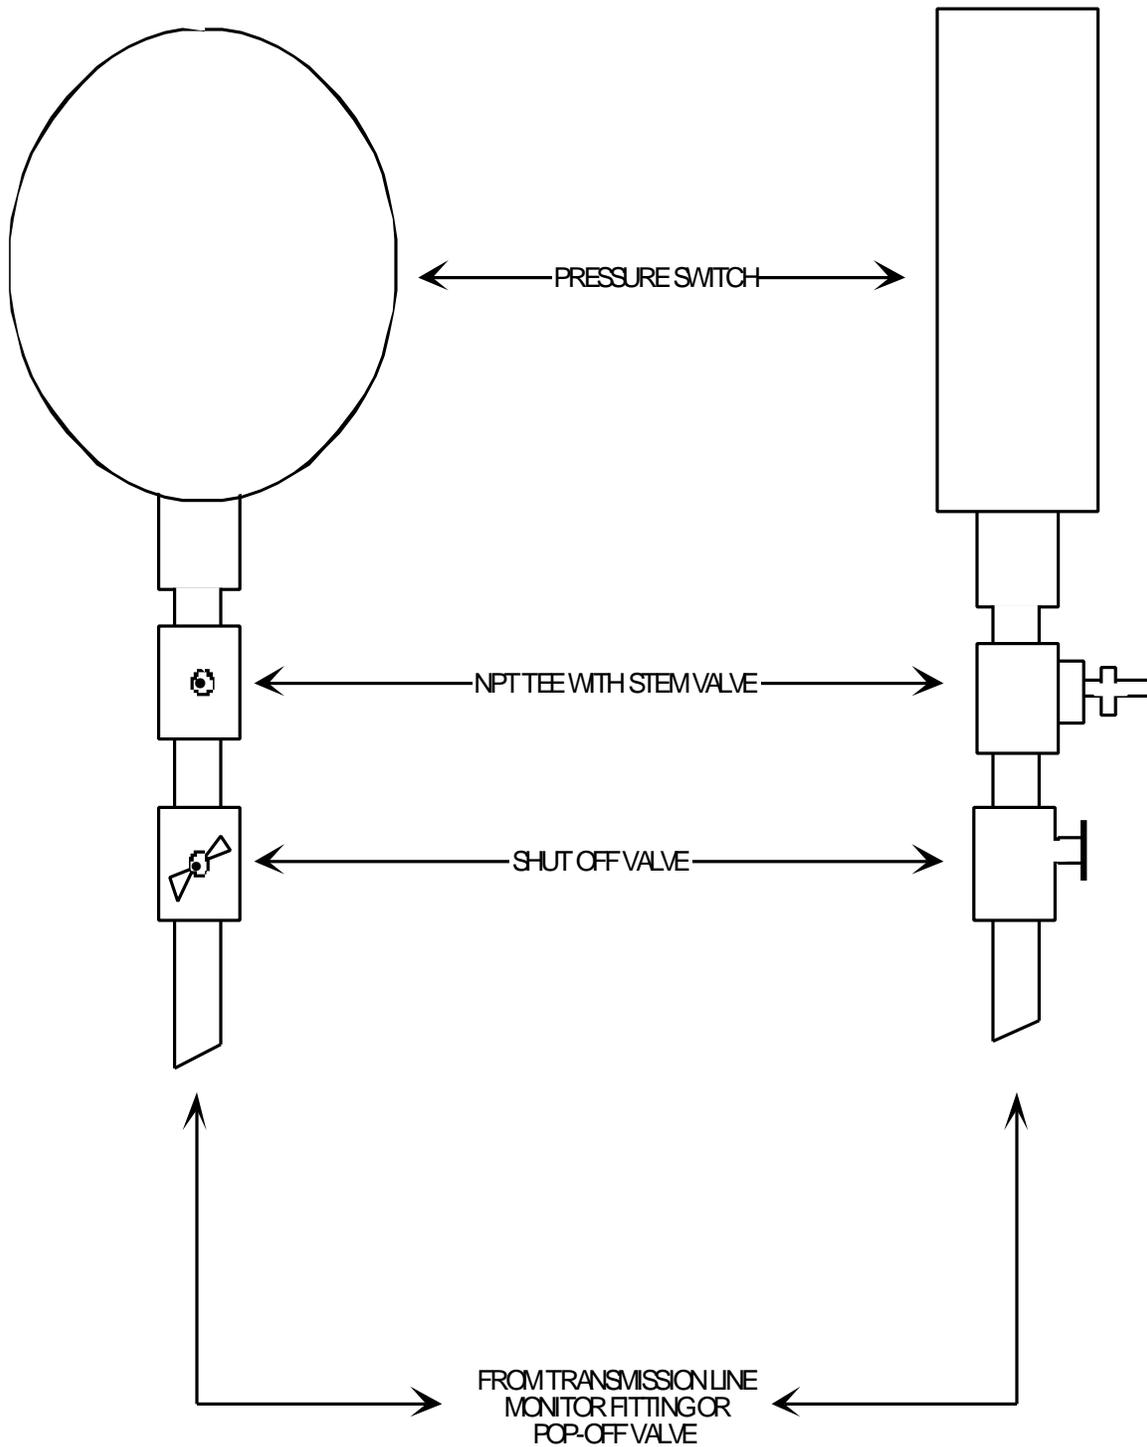


Figure 5-3: Pressure Monitor/Alarm Assembly

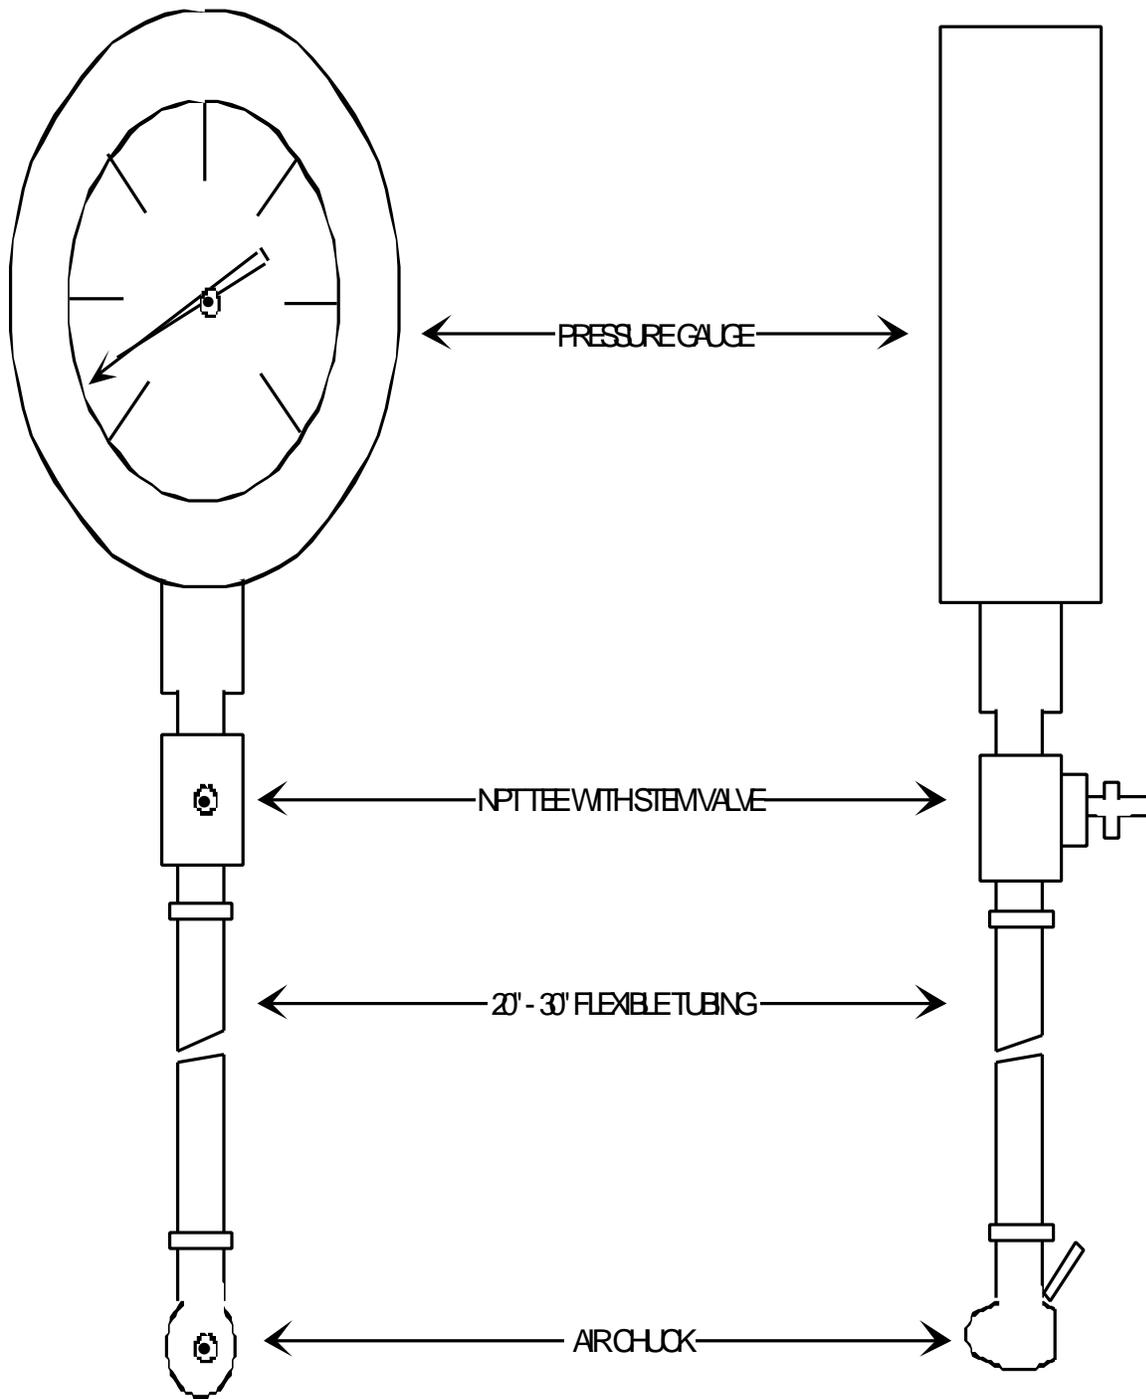


Figure 5-4: Portable Pressure Gauge For Turnup and Maintenance

ANTENNA/WAVEGUIDE/PRESSURIZATION INSTALLATION CHECK LIST

Date Of Inspection: _____

Project Name: _____

Site Name: _____

Job Number: _____

Supplier: _____

Name of Person(s) that installed the equipment:

Before performing the inspection, obtain all manufacture documentation and instruction sheets, waveguide tags attached to the reel, and drawings associated with this job.

Use the REMARKS column when; explanation is required for an item, it is necessary to identify a specific antenna or waveguide run, or general comments concerning the job or installation. Write NA in the Remarks column if an item does not apply. Sign the last page after the inspection is complete.

Antenna Mount Pipe

1. Is pipe mount on tower mounted to allow correct position of antenna (per installation drawing, pipe vertical with respect to tower leg or face, allows antenna mount to be clamped correctly, allows correct center line position of antenna, antenna position does not interfere with ladders, other antennas, etc.)?
2. Were drilled holes cold galvanized? (remove one bolt from upper and lower mount bracket to tower leg or face and inspect/replace and tighten)

OK DEV REMARK

OK	DEV	REMARK

**

Antenna (Horn/Parabolic/Collinear)

REMARK	OK	DEV
1. Is this the correct Antenna (by model and manufacture) for this location? ()		
2. Exterior of Antenna Parabola/Horn not dented or scrapped?		
3. RF Shield in place between parabola and shroud?		
4. Shroud mounted with correct hardware?		
5. Shroud not dented or scratched?		
6. Is cover installed with TOP up?		
7. Cover (if equipped) torn or damaged?		
8. Cover bolts (on cover) in place and locked (lock washers or lock tight depending on manufacture of antenna)?		
9. Cover J-Bolts and Springs in place and at correct tension?		
10. Cover J-Bolts double nutted if required?		
11. Was Never Seize used on Stainless J-Bolts?		
11. Conical cover not damaged?		
12. Conical cover mounting hardware in place and tight?		
13. U bolts at Figure 4 (A frame) mount in place, tight, locked? - Vertical Clamps? _____ - Azimuth Clamps? _____ - Azimuth adjustment rod (at antenna and tower) _____?		

Antenna (Horn/Parabolic/Collinear) (Continued)

OK DEV REMARK

14. Stiff Arm(s) and Azimuth Rods in place with correct hardware, hardware tight and locked? ? (Nuts DOWN on Stiff Arm(s) and Azimuth Rods only)			
15. Is antenna feed positioned correctly in vertex place and locked down?			
16. Is the antenna feed positioned in the antenna parabola with the correct hook (Left or Right per Design Document)?			
17. Are antenna feed bolts missing, locked, tightened to correct torque?			
18. Are antenna feed support wires in place and tensioned correctly?			
19. Are unused ports on the antenna feed terminated? (shorting plates are not allowed).			
20. Is correct hardware used on antenna feed port terminations.			
21. Is antenna installed at correct Center Line per FCC License (+/- 1 ft)?			
22. Is Antenna Center Line Height in reference to AGL or ATB? AGL _____ ATB _____			
23. Were cross polarity tests made, documented, and acceptable? (provide documentation)			

Waveguide/Coax (Continued)

OK DEV REMARK

13. Was the waveguide and antenna tested together and is the sweep document available and acceptable (return loss with the antenna feed)?

--	--	--

**

Pressurization

OK DEV REMARK

1. If a new dehydrator was installed:

- Is it the correct model? _____
- Is it installed in the correct location? _____
- Is AC Power run correctly, and unit grounded to internal ring ground system? _____
- Are the high/low pressure values of the dehydrator set correctly? _____
(High Press. line value = 4 PSI)
(Low Press. line value = MIN 7 to MAX 11 IWC)
- Are the alarm leads connected and function correctly? _____
- Does this dehydrator require a bleed orifice and is it installed? _____

--	--	--

2. If a new pressure alarm switch (high or low press.) was installed for the waveguide:

- Is it the correct model for the type of pressure system (i.e. high or low)?
- Is it installed in the correct location and grounded to internal ring ground system?
- Is the alarm value set correctly?
(High Press. = 3 PSI, Low Press. = 3 IWC)

--	--	--

--	--	--

--	--	--

3. Does the pressure system have the correct shut off valves, nipples, etc. per spec.?

--	--	--

4. If a single waveguide was installed, is there a separate port at the connector for pressurization and pressure alarming?

--	--	--

--	--	--

Pressurization (Continued)

5. Is the pressure and pressure alarm switch tubing supported correctly with the correct hardware, connectors, and was Teflon tape used?
6. Perform a pressure leak down test on the antenna/waveguide system and record the results below:
 -Type of pressure system (high or low) HIGH ___ LOW ___
- IF LOW PRESS: Initial Pressure of 5.5 Inches Of Water Column.
 Less than 1 inch of pressure loss in 4 minutes.
- IF HIGH PRESS: Initial Pressure of 8 PSI.
 Less than 1 pound of pressure loss in 5 minutes.
- Note: Ensure that the system (manifold) pressure is set to its normal value after the test is performed. See item 1 above.

SYSTEM (A) TOWARD (_____) SYSTEM (B) TOWARD (_____)
 Duration of test (minutes) _____ Duration of test (minutes) _____
 Pressure at start of test _____ Pressure at start of test _____
 Pressure at end of test _____ Pressure at end of test _____

OK DEV REMARK

Drawings

1. Were the drawings corrected to show this equipment addition/removal?
2. Were two copies made and one left at the site?

OK DEV REMARK

ADDITIONAL REMARKS OR COMMENTS:

CONTENTS

Chapter and Section	Page
6. Removal Guidelines.....	6-1
6.1 General.....	6-1
6.2 Transportation	6-1
6.3 Precautions	6-1
6.4 Transmission Line Removal.....	6-2
6.5 Antenna, Antenna Mounts, Support Rings, and Ice Protection.....	6-2

6. Removal Guidelines

6.1 General

The general requirements described in Chapter 2 also apply to removal operations. The following additional requirements shall also apply.

6.1.1

The weight of the antenna and equipment to be removed shall be obtained by the Supplier, with the concurrence of the U S WEST representative, to determine the appropriate equipment and method needed to hoist and lower it safely to the ground.

6.1.2

All bolt holes in the tower structure that are left open by the removal process will be cleaned and coated with two coats of Zinc Rich Cold Galvanization paint.

6.2 Transportation

The Supplier shall assume responsibility, unless otherwise outlined in the job specification, for the removal and transportation of all material removed from the radio site or tower.

6.3 Precautions

The US West Engineer shall identify working and non-working equipment and this list verified with the responsible US West Radio Site representative before any removal activity takes place. Every precaution shall be taken to ensure that working equipment is protected from physical damage, misalignment, movement or interruption. Special care shall be taken when hoisting or lowering materials to ensure that material is not raised or lowered in front of working antennas. A U S WEST representative will be on site during the removal process to ensure that working service is not affected.

6.3.1

The work being performed will be done in such a manner as not to damage the existing facilities. No equipment or material shall be removed from an existing radio tower that will cause a reduction in structural strength. No equipment, hardware, or object shall be thrown or dropped from the tower or support structure during the removal process.

*****CAUTION*****

Removal of an antenna, antenna mount, or ice protection should not be attempted unless wind velocities are gentle and weather conditions are expected to remain stable. Wind loading on the antenna, mount, or ice protection can make control while lowering this equipment difficult, especially when winds are gusty.

6.4 Transmission Line Removal

The non-working transmission lines shall be removed before the transmitting equipment and antenna. The non-working transmission lines to be removed will be detailed in the removal specification for each antenna. Extreme caution must be exercised when working near in-service transmission lines to prevent service interruption or transmission impairment. Transmission line and support hardware should be removed as detailed in the removal specification for each antenna.

6.4.1

Where necessary to close openings in hatches or terminate unused ports or transmission lines, hatch plate covers, pressure windows, and/or termination's shall be installed.

6.4.2

Where necessary, all designations shall be removed and records updated that are associated with the equipment being removed.

6.5 Antenna, Antenna Mounts, Support Rings, and Ice Protection

After the non-working transmission lines have been removed, the antenna(s), antenna mounts, support rings, and antenna ice protection shall be removed as detailed in the removal specification.

6.5.1

New grating shall be installed to cover the hole left by the removal of horn type antennas after the ring mount is removed.

6.5.2

No pulley, hoist or other means of lifting and lowering shall be placed on the tower where the weight being lifted or lowered will damage, bend, or deform the tower structure, horizontal, or diagonal cross members.

CONTENTS

Chapter and Section	Page
7. Tower & Antenna Maintenance.....	7-1
7.1 General Maintenance	7-1
7.2 Emergency Work	7-3
7.3 Safety	7-4
7.4 Precautions	7-4
7.5 Types of Structures.....	7-5
7.6 Initial Inspection	7-5
7.7 Subsequent Inspections	7-6
7.8 Tower Inspection Report	7-7

Figures

7-1 Tower Inspection Report	7-8
-----------------------------------	-----

Tables

7-1 Routine Maintenance Items.....	7-3
------------------------------------	-----

7. Tower & Antenna Maintenance

Persons knowledgeable in the installation and maintenance of antenna supporting structures, antenna systems, and radio transmission lines should carry out Work operations mentioned in this chapter. In certain instances it will be necessary to contract out certain work operations and/or repair. In all cases a knowledgeable U S WEST person should oversee the maintenance process to ensure satisfactory performance.

7.1 General Maintenance

With proper installation and maintenance, most antenna supporting structures and antenna systems now in use in U S WEST can be expected to give long and satisfactory service. Without proper maintenance, the performance of the associated radio system may be impaired or disrupted even though the structure itself appears intact. Additionally, its physical life will be greatly reduced.

7.1.1

Regulations of the Federal Communications Commission (FCC) and/or Federal Aviation Agency (FAA) may require painting the structure and operation of an obstruction lighting system. Local governments, Parks Service, Forest Service, Bureau of Land Management (BLM) or other agencies may also require painting the tower structure and antenna (including specific colors of radomes).

7.1.2

In preparation for the inspection, the following documents should be obtained before the inspection:

- Drawings for the site
- Tower drawings
- Blue prints of the original tower installation and subsequent changes and/or modifications.
- Previous Tower Inspection Reports for this site.

Other publications used as reference are:

- U S WEST Technical Publication 77350 "*Telecommunications Equipment Installation Guidelines (TEIG)*", latest issue
- U S WEST Technical Publication 77355 "*Grounding - Central Office and Remote Equipment Environment*", latest issue
- Manufacturer installation manuals and reference material for the equipment being inspected or corrected. Inspection teams need a working knowledge of ASTM Specification A123 & A153 and EIA RS222D.

7.1.3

Inspections should be scheduled with the appropriate U S WEST representative who has area Antenna or Radio Operations Supervisory responsibilities. The inspections will cover the actual inspection and minor repairs only. Major repair items are to be identified and documented with sufficient detail on the accepted inspection form and include photographs of the defective item(s). The inspection identification and documentation must include unsafe work areas or structures and missing or damaged vertical safety climbs and/or horizontal safety cables (see Table 7-1).

7.1.4

The Tower Inspection Report (Figure 7-1) shall be returned to the U S WEST representative who has area Antenna or Radio Operations Supervisory responsibilities, who will determine if the repair should be performed immediately, within one year or be done during the next scheduled inspection. The U S WEST Antenna or Operations Manager will review and schedule the repair or request a contract for items to be repaired using the correct account coding.

Table 7-1: Routine Maintenance Items

CLASS I	
(CORRECTED DURING INSPECTION VISIT)	
(01)	Incorrect guy tension; loose guy clamps, rods, wire rope serving, jam nuts, turnbuckles; all exposed ground connections.
(02)	Base Plate: Loose nuts, bolts, general condition of grout.
(03)	Loose and Missing parts: All accessible bolts, nuts, washers, ring fills and palnuts on towers, stub towers or antenna support standoffs, waveguide runs, waveguide supports, antennas, reflectors and associated equipment.
(04)	Tower Lighting: Replace lamps in beacon and sidelights. Lighting conduit and junction boxes that may be loose, have plugged drains, or bad water seals. Test and repair if needed, photo cell, control panel operation, and alarms.
(05)	Loose Step Bolts. Ladders, and Safety Climb devices used on ladders or step bolts or safety cables on towers.
(06)	Drain holes in tubular members.
CLASS II	
(CORRECTED AS SOON AS IT CAN BE ARRANGED)	
(01)	Guy Cables: Kinks, broken, rusted, dented or broken strands, "birdcaging", etc. Any items broken, damaged or missing listed under "Minor" (1).
(02)	Component parts of any tower or associated equipment that may be broken, bent, deformed or missing.
(03)	Tower lighting: Broken or cracked lens, frayed insulation, broken or leaking conduit or exposed wiring.
(04)	Missing Step Bolts.
(05)	Foundations and Anchors: Shifting, cracking and scaling. Corrosion of guy rods below grade.
(06)	Finish -- Paint and Galvanize: Loose, scaled, peeling, absent, faded.
(07)	Tower Bow and Plumb.
(08)	Cracked tubular or angular members.

7.2 Emergency Work

Emergency work performed by U S WEST personnel should be coordinated with the radio operations personnel. All Emergency type work that will be contracted requires that sufficient detail of the work to be done be provided to the Supplier and confirmation from the Supplier of the charges including travel, labor rate, and any miscellaneous charges that may be associated with the work to be done. The Supplier shall FAX the confirmation on the Supplier's letterhead to the Antenna or Operations Manager and, if accepted, a purchase order will be provided to the Supplier. U S WEST will issue a purchase order number after proper approval of work is obtained. That order number must be listed on all invoices submitted by the Supplier. The correct account coding will be provided when the purchase order is requested, or detailed when the invoice for work done is received.

7.2.1

As with other contracted work for U S WEST, the Supplier should be approved, and is required to complete a Method Of Procedure (MOP) (form RG47-0005 & 0006) for all work to be done.

7.2.2

A detailed MOP will be required if working service will be affected. If service is degraded or interrupted due to the work operation, form RG47-0013 must be completed after the service is restored and before any work can proceed.

7.2.3

After the work is complete, a Job Completion Notice (form RG47-0002) is required from the Supplier prior to payment of the invoice.

7.3 Safety

7.3.1

Work aloft by U S WEST personnel shall be performed in accordance with U S WEST Communications Safety And Loss Prevention Plan (SLLP), and all appropriate Local, City, County, Federal, State, and OSHA regulations.

7.3.2

Work aloft or on the ground by Suppliers requires strict adherence to all Local, City, County, Federal, State, and OSHA regulations. The Supplier shall designate an on site safety person and discuss all safety precautions with the U S WEST Representative.

7.3.3

The following reminders apply to both Suppliers and U S WEST personnel:

- Persons not part of the work operation should be informed of the work to be done aloft and the need to keep a safe distance away.
- All persons on the ground and aloft must wear hard hats while work is being performed.
- Vehicles not involved in the work operation should be kept at a safe distance (minimum of 50 ft. radius from a tower where possible) or otherwise protected while work is being performed aloft to prevent damage.

7.4 Precautions

Tampering with the tower or its appurtenances, antennas, antenna mounts, waveguide or supporting structures by unauthorized persons may result in damaged bolts or turnbuckles, excessively loose or tight guys, broken or missing ground wires, misalignment of antennas, impairment of the transmission lines, life threatening safety hazards, service outages, or other damage.

7.5 Types of Structures

Antennas may be supported by several types of structures such as double wooden poles, masonry, or steel (H Fixtures), simple tubular steel poles, or fabricated steel structures consisting of members bolted, welded or otherwise joined together. All antenna support structures shall be constructed or repaired to meet current ASTM and/or EIA Standards, accept at least the number of antennas requested, and meet wind and ice loading requirements for the location they are being installed.

7.5.1

For all new tower structures, a complete set of tower drawings are to be available.

7.5.2

For additions or modifications, a set of as built drawings will be furnished to the U S WEST Representative.

7.5.3

The types of antennas found in U S WEST include but are not limited to; Horns, Parabolic, Collinear, or Yagi. These antennas will be mounted on the types of structures listed in paragraph 7.5 or can be mounted on buildings with simple pipe mount hardware.

7.5.4

Since these antennas and the associated radio systems are providing service either internally or to the general public, extreme caution must be used moving or working around these antennas. Manufacturer documentation should be obtained and available prior to inspecting or repairing any antenna.

7.6 Initial Inspection

It is desirable to make the first maintenance inspection of antenna supporting structures about six months to one year after erection. If the initial construction was correct, very little tightening of bolts or guys will be found necessary. Most of the maintenance work required at the first inspection is generally caused by faulty construction, abnormal storm loading, malicious mischief or improper design. A thorough inspection at regular intervals will prevent minor faults from developing into serious trouble.

7.6.1

Guy tension tests should allow for temperature and wind velocity differentials and should only be performed by qualified personnel. Guy tension should be checked using a Strand Tensiometer that has been calibrated.

7.6.2

It is anticipated that the items listed in Table 7-1 as Class I should be repaired during the inspection visit, while the Class II items should be noted and repaired as soon as can be arranged. Circumstances may dictate or allow the repair of class II items during the initial inspection (i.e., material is available, elimination of the mobilization charge if the work is done now, etc.).

7.6.3

Towers constructed of tubular members should be inspected for evidence of splitting. This may be caused by freezing of condensed moisture. Split tubes should be repaired by replacing the member, or if this is not practical by welding and then coating with zinc rich paint. Drainage holes shall be provided.

7.6.4

Verification of the Antenna Model and Transmission Center Line Height, Waveguide or Coax type, etc. against the FCC License and existing drawings, or past inspection reports, should be included in the initial inspection.

7.6.5

Verification of the tower structure(s) height against the FCC License and existing drawings should also be included. Documentation of this verification will be provided on the drawing for the site or on a field sketch if the drawing is not available.

7.6.6

When performing antenna leak-down tests, determine if the antenna system has control leakage plugs. The methods used to introduce controlled leakage can vary from control leakage plugs in the outdoor waveguide system to partially open valves at the manifold. Any of these methods may affect the antenna leak-down test results.

Some single waveguide run systems have leakage plugs at the network or antenna, and some antenna networks have a control leakage plug in lieu of a water trap. The controlled leakage plugs leak approximately 7 Standard Cubic Feet per Hour (SCFH). Control leakage plugs can also be made by drilling a countersunk 0.060 in orifice (#60 drill) in a pipe plug. More details of Pressurization Systems can be found in Chapter 5 of this publication.

7.7 Subsequent Inspections

The second inspection should not be necessary for about three years, with subsequent inspections at three to four year intervals. It is advisable, however, to make additional inspections after unusually heavy rain or snow storms, hurricanes, or cloudbursts. Foundations or anchorages may be subject to possible washout, large pieces or debris may have been blown into the tower or its guys, structural members may have been twisted or bent, etc.

7.7.1

Beacon and sidelights should be changed prior to the manufactures expected bulb life rating to prevent FCC/FAA notifications and possible fines should burnt out lamps not be changed within the required time frame. Beacon and sidelight socket voltages should be within 3% of the lamps rated voltage to ensure proper light output and rated bulb life.

7.7.2

In addition to the points mentioned in the preceding paragraphs, the general condition of the paint should be checked. Generally, the life of the paint film should be the controlling factor as to the interval between scheduled inspections, unless there are some special features of the installation that may require more frequent attention.

7.7.3

Guy rods should be checked for corrosion above and below grade. If corrosion is found below grade, the guy rod should be inspected down to the concrete encasement to determine the extent of the damage.

7.8 Tower Inspection Report

The Supplier shall complete a Tower Inspection Report (Figure 7.1) as the inspection is made. All entries in this report should be complete and legible. The Supplier may use their own report if approved by the US West Antenna or Operations Supervisor. The Antenna or Operations Manager should keep the Tower Inspection Report and all subsequent documentation for a period of 6 years (or two inspection cycles).

7.8.1

The Tower Inspection Report is to be completed per site or tower and returned to the U S WEST Antenna or Operations Supervisor.

If the tower/antenna inspection is contracted, the vendor may, upon approval of the U S WEST Antenna or Operations Supervisor, use their Tower Inspection Report. The Vendors Inspection Report must, at minimum, include all items identified in the U S WEST Tower Inspection Report

SITE OR OFFICE _____

DATE _____

INSPECTION CONDUCTED BY:

INDEX

Location Data
Tower Structure
Guying System
Lighting System
Waveguide and/or Coaxial Lines
Antennas
List All Repairs Made
List All Materials Used
Pictures and Major Repair Work
Specifications to be Attached

Note: Comments are added to some items below. These comments will not appear in the actual inspection booklet.

Figure 7-1: Tower Inspection Report (Example)

Page 1 of 14

LOCATION DATA
Tower Location _____ (or site name)
Tower Type _____ (guyed, self supporting, mono-pole, wood, etc.)
Tower Manuf./Model _____
Geo Code _____ (the Geographic Location Code of this site)
Measured Tower Height _____ (tower height as verified by instrument or tape)
Date Inspected _____ (the actual date of the inspection)
Inspector _____ (name of the person(s) conducting the inspection)
City _____
State _____
Company Representative _____ (the U S WEST person who is responsible for this site or for the Inspection)
Telephone Number _____ (site telephone number)
LEGEND:
Y = Yes N = No NA = Not Applicable
RM = Repair Made (This notation requires an explanation in the rear of the inspection booklet or separate written documentation)
RR = Repairs Recommended (like Repair Made, this entry requires a written explanation including measurements, etc.)

Note: A turn of a nut shall be construed to mean that a single point on the nut has traveled through 360° of arc.

A loose nut shall be one, which can be turned through more than 180 deg of arc with a wrench.

A tight nut shall be one, which cannot be turned more than 180 deg of arc with a wrench.

Figure 7-1: Tower Inspection Report (Example)

Tower Structure

1.	Is concrete foundation cracking/checking? _____ <i>(The top of the tower leg pier should be tapered away from the center to prevent standing water. If the foundation was coated, check for bubbles, cracks, or pieces of the coating that are coming off. The foundation should be checked using a Schmitt Hammer or equivalent and any deviations noted.)</i>
2.	Is there any deterioration of grout? _____ If yes, where? _____ <i>(The base plate grout should be formed to allow for water drainage.)</i>
3.	Are all Tower Base Plate anchor nuts and bolts tight and double nutted? _____
4.	Is each leg of tower grounded and secured correctly to tower leg? If not, where? _____ <i>(The ground wire should be cadwelded to the tower leg or tower base plate.)</i>
5.	Are all grounding connections tight and free of corrosion or rust? _____
6.	Are any ground wires damaged or sharply bent? _____ <i>(The ground wire should be formed in a smooth radius bend, not bent to form around square corners.)</i>
7.	Is tower base plate clean and properly drained? _____
8.	Are all tower weep holes open? _____
9.	Is there any evidence of settlement at the tower base _____? <i>(Use transit and note reference leg position (i.e. N/W leg) and deviation of other legs.)</i> REF LEG _____ LEG A _____ LEG B _____ LEG C _____ Was tower vertical alignment checked with transit? _____ Note degree deviation; between guy points () overall () and deviation in at least 2 faces of self supporting tower FACE A _____ FACE B _____ FACE C _____ FACE D _____ Is water shedding a problem, low spots _____? <i>(Elevations of tower and reflector support to be shot for signs of settling. Tower height to be verified with transit or tape measure. If transit was used, furnish field sketch showing setup, measurements, and calculations.)</i>

Figure 7-1: Tower Inspection Report (Example)

Tower Structure (Continued)

10.	Does tower have safety climb device? _____ <i>(If the tower has a vertical safety climb device, note what kind (cable, pipe, etc.. Note if there are safety cables at horizontal levels of the tower to allow safe movement around the tower.)</i>
11.	Are lightning rod(s) secure and extend at least one foot above top light fixture or highest antenna? _____
12.	Is rust evident on tower structure or nuts and bolts? _____ <i>(Note where there is rust.)</i> _____
13.	Are any structural members damaged or missing? If so, where? _____ <i>(Note location, size of member, and type/extent of damage)</i> _____
14.	How many tower bolts were checked for tightness? _____ <i>(Spray tightened bolts with cold gal spray.) (After spray has dried, put one line across head of bolt with black permanent marker).</i> QTY _____ Percent checked _____. <i>Check 10% initially. If the majority of these were loose, check 10% more on the same portion of the structure (i.e. leg splices). If more are found, notify the antenna or operations supervisor.</i>
15.	How many tower bolts were found loose? _____ QTY _____ a. Are all bolts installed with nut up or out. _____ If not where? _____
16.	Are bolts, nuts, or locking devices missing? _____ Note location(s). _____
17.	Is tower paint flaking, peeling, fading? _____ Is the tower paint visually effective? _____ Note % of flaking _____, peeling _____, fading _____.
18.	Is there undue damage or fatigue at welds? _____ Guyed: Guy lugs & torque arm lugs Equalizer plate anchor Tower cantilevered joints above guy levels Self-Supp: Pipe connection to flange plate End clips where brace connects to leg Brace clip Step bolt lugs

Figure 7-1: Tower Inspection Report (Example)

Guying System

1.	Are cable clamps malleable, dropforged or pre-formed? _____ (Perform grips should have a clip holding the end closed to prevent ice from forming inside.)	
2.	Are all clamps tight? _____	
3.	Are ice breakers securely fastened to guys having pre-form grips? _____	
4.	Are all anchors grounded above ground? _____	
5.	Are all grounding connections tight and in good condition? _____	
6.	Is there any sign of rust or damage to guy strand or guy hardware? _____	
7.	Are slippage bands in good condition? _____	
8.	Does guy show signs of slippage? _____ (Look at guy strand immediately next to grips.)	
9.	Is all hardware above ground level and free of erosion or filled in soil/gravel? _____	
10.	Is there any sign of erosion, humping, heaving or any movement in guy anchors? _____	
11.	Are guy safeties installed and correct? _____	
12.	Are cotter pins in good condition and correct size? (Check clevis at star mount if so equipped)	_____
13.	Is there any rust or corrosion on anchor bars? _____	
14.	*Were guy tensions checked and recorded? *	_____
15.	Do turnbuckle threads need to be coated? _____	

Tensions are to be checked utilizing Tensiometer.

Figure 7-1: Tower Inspection Report (Example)
Page 5 of 14

Please Document

Record Readings				
Side of Tower (Direction N,S,E,W)			_____	
Top Guy			_____	
Middle Guy			_____	
Bottom Guy			_____	
Side of Tower (Direction N,S,E,W)			_____	
Top Guy			_____	
Middle Guy			_____	
Bottom Guy			_____	
Side of Tower (Direction N,S,E,W)			_____	
Top Guy			_____	
Middle Guy			_____	
Bottom Guy			_____	
	Sunny,	Overcast,	Wind,	Temp
	_____	_____	_____	_____

Figure 7-1: Tower Inspection Report (Example)
Page 6 of 14

Lighting System

1. Check tower lighting control unit and photo cell for proper operation.
(If equipped)
(Note Model of Control Unit _____)
(Note Model of Photo Cell _____)
2. *Are conduit or junction boxes cracked, broken or rusted? _____
3. Was any water found in lighting fixture or boxes? _____
If so, where? _____
4. Is breather and drain installed on conduit and working properly? _____
5. *Are conduit clamps tight and in good condition? _____
6. Are all fixture weep holes open and fixtures clean and free of broken glass and dirt? _____
7. Are all gaskets in good condition? _____
8. Are all sockets in good condition? _____
9. *Are obstruction light globes broken or cracked? _____
10. Is there any broken or damaged glass in beacon? _____
11. Are beacon color screens in good condition and clear? _____
12. *Is beacon cord and internal beacon in good condition and weather tight? _____
13. *Change Beacon and sidelights. List manufacturer, model, and quantity of lamps used:

Manufacturer Model	Quantity
Beacon	_____/_____/_____
SideLights	_____/_____/_____
14. *Are power outlets on tower water tight, in good condition and secured correctly to tower structure? _____
15. *Are all lamp sockets within 3% of the lamp rated voltage? _____
16. Does tower lighting control unit alarm properly? _____

**Use Tower Figure To Note Location*

Figure 7-1: Tower Inspection Report (Example)

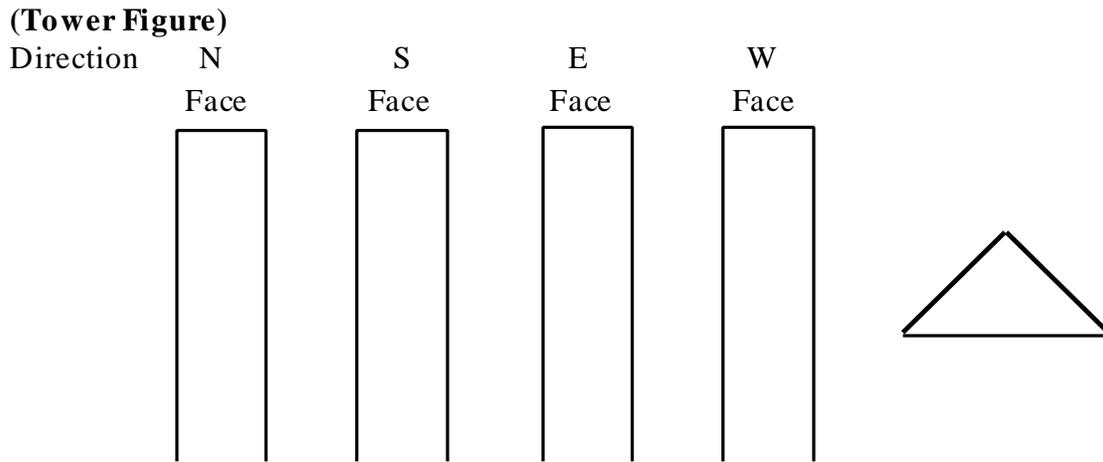


Figure 7-1: Tower Inspection Report (Example)
Page 8 of 14

Waveguide and/Or Coaxial Lines

1. Type of coaxial line (RG8-U, etc.) _____
(List all types and quantity of lines to each antenna.)
2. Types of waveguide (rigid, heliax, etc.) _____
(List all types and quantity of lines to each antenna.)
(Where circular flex is found in a working radio system, it should be referred to the Radio Operations Manager.)
3. Are all grounding connections tight and in good condition? _____
(Remember that single bolt lugs for grounding connections must have a locking device (i.e. star washer, lock washer, etc.). _____)
4. Does taped ground wire on heliax and coax connections need to be retaped? _____
(Retape and cover tape with sealer or weather coat or as required by local practice.)
5. Are all waveguides and coax lines grounded properly (most direct route to ground, minimum bending radius, not at bend in the coax or waveguide)? _____
6. Are ground crimp lugs sealed with heat shrink to #6 grd wire? _____
7. Are there any dents, cracks or damage? _____
8. Are waveguides and restrainer properly aligned? _____
9. In vertical runs of rigid waveguide, are all bolts installed with nuts up? _____ QTY _____
10. In vertical runs of rigid waveguide, how many waveguide bolts were installed with nuts down? _____ QTY _____
11. How many waveguide bolts were loose and tightened? QTY _____
(Extreme CAUTION must be used when working around ANY waveguide or networks to prevent tools from hitting it, bending or deforming in any way, or cords and ropes from rubbing against it. This inspection includes circular waveguide with all flange bolts checked for correct torque including bolts at the milk stool. NEVER tighten axial ratio compensators, or adjust the red head bolts at the network.)

Figure 7-1: Tower Inspection Report (Example)

Waveguide and/Or Coaxial Lines (Continued)

12. How many waveguide bolts were missing and installed? _____
13. Is all waveguide hardware in good condition, made of stainless steel, and free of rust and corrosion? (rigid, flex, coax) If not, note location _____
14. Are waveguide flex sections the proper length and in good condition? _____
If not, note location. _____
15. Do waveguide flex sections have #6 jumpers? _____
Are nuts on rigid side of flange? _____
(At flex sections, the bolt head should be on the flex (rubber) side of the flange and the nut on the rigid side. There are very few exceptions to this.)
16. Were any leaks found? _____ If so, where? _____
(Note that the pressure system may be either High (Max 10 PSI) or Low (Max 12 inches of water) when performing the leak down test.)
Type of pressure system: High _____ Low _____ Dehy Model No _____

IF LOW PRESS: Initial Pressure of 5.5 Inches of Water Column.
Less than 1 inch of pressure loss in 4 minutes.
IF HIGH PRESS: Initial Pressure of 8 PSI.
Less than 1 pound of pressure loss in 5 minutes.
(Reset manifold pressure to original value when test is completed.)
17. Are bolted flanges tight? (rigid, flex, elliptical). _____
18. Is waveguide or coaxial connection to antenna weather tight? _____
(Coax connector at antenna may be taped and coated. Do not remove tape. If a elliptical connector flange is taped, untape and test for air leak. Do not retape and coat.)
19. Are the tuning screws on elliptical waveguide connectors sealed? _____
20. Are hangers in need of repair? _____
Location: _____ Type: _____
21. Are protective hood and waveguide hatch(s) water tight and free of defects? _____
22. Are all flanges at pressure window grounded together and then to hatch or ground system? _____

Figure 7-1: Tower Inspection Report (Example)

Waveguide and/Or Coaxial Lines (Continued)

- | | |
|-----|--|
| 23. | Are waveguide/coax support hangers/clamps spaced correctly? _____
If not, where? _____ |
| 24. | Can network move in slot angle brackets and are they positioned correctly for movement up and down? _____ |
| 25. | Do milk stools have all bolts in place and have sufficient adjustment for vertical movement? _____ |
| 26. | Are temperature compensating rods tight? _____ Bowed? _____
Have jam nuts on turnbuckles? _____
Safeties on top attachment pin? _____
Aligned correctly? _____
<i>(Turnbuckle threads should be lubricated)</i> |
| 27. | Are bell restrainers aligned vertically with waveguide? _____ |
| 28. | Does taped ground wire on elliptical and coax connections need to be retaped? _____
<i>(If so, retape and cover tape with sealer or weather coat or as required by local practice.) (Sealer or weather coat requires a second coat within 6 months after initial installation, then as required during the normal inspection interval.)</i> |
| 29. | Do watertraps operate correctly? _____ Leak excessively? _____ |
| 30. | Are pressure relief valves for horn antennas set and operate correctly? _____
<i>(Set to 9 IWC per manufacturer specifications.)</i> |

Figure 7-1: Tower Inspection Report (Example)

Antennas

1.	Number	Model	Type	Size
	_____	_____	_____	_____
	_____	_____	_____	_____
	_____	_____	_____	_____
	<i>(Note if the antenna feed is single or dual frequency and if dual pol. This is not required if feed model is known.)</i>			
2.	Were there any loose bolts or nuts, signs of rust or cracked welds on antennas or passive reflectors and associated mountings _____ If so, where? _____			
	<i>(The azimuth adjust rod and stiff arm(s) may be attached to the antenna and/or tower with the bolt down. This is acceptable and prevents the rod or arm from falling away from the antenna if the nut comes off.)</i>			
	<i>(The azimuth and horizontal adjust rod screws should be checked for corrosion and lubricated if necessary.)</i>			
	<i>(Check casting bolts on passive reflectors for signs of rust).</i>			
3.	Do installed ice shields provide adequate protection? _____			
4.	Are there any signs of damage to radomes, or horn reflector weather covers? _____ Resin erosion? _____			
5.	Is gel-coat in good condition on antenna? _____			
6.	Are all antennas grounded properly? _____			
7.	Are all antenna stinger support wires in place, equipped with tension springs, and tensioned? _____			
8.	Do antennas or reflector show signs of damage such as dents, cracks, holes, bends or impressions? _____			
	If so, which antenna or reflector? _____			

Figure 7-1: Tower Inspection Report (Example)

CONTENTS

Chapter and Section	Page
8. Definitions.....	8-1
8.1 Acronyms	8-1
8.2 Glossary	8-1

8. Definitions

8.1 Acronyms

ANSI	America National Standards Institute
ASTM	American Society of Testing Metals
C.S.M.	Contractor Specification Manual
EIA	Electronics Industry Association
FAA	Federal Aviation Administration
FCC	Federal Communications Commission
IWC	Inches of Water Column
NEC	National Electric Code
NPT	National Pipe Thread
OSHA	Occupational Safety and Health Administration
RF	Radio Frequency
SCFH	Standard Cubic Feet per Hour
SLPP	Safety and Loss Prevention Program
TIA	Telecommunications Industry Association
UHF	Ultra High Frequency
UV	Ultra Violet
VHF	Very High Frequency
WC	Water Column

8.2 Glossary

American National Standards Institute (ANSI)

An organization supported by the telecommunications industry to establish performance and interface standards.

Bridging (MULTIPOINT-SERVICE)

Denotes the process of connecting three or more customer locations.

Carrier

An organization whose function is to provide telecommunications services. Examples are: Local Exchange Carriers, Interexchange Carriers, Cellular Carriers, etc.

Central Office (CO)

A local switching system (or a portion thereof) and its associated equipment located at a wire center.

Channel

An electrical or photonic, in the case of fiber optic based transmission systems, communications path between two or more points of termination.

End Office

A designation of a U S WEST switching system that occupies the lowest level of the public switched network hierarchy. It is the designation of a switching system that connects lines to lines, and lines to trunks (a local switching system).

Facilities

Facilities are the transmission paths between the demarcation points serving customer locations, a demarcation point serving a customer location and a U S WEST Central Office, or two U S WEST offices.

Impedance *

The total opposition offered by an electric circuit to the flow of an alternating current of a single frequency. It is a combination of resistance and reactance and is measured in ohms.

Multiplexer (Mux)

An equipment unit to multiplex, or do multiplexing: Multiplexing is a technique of modulating (analog) or interleaving (digital) multiple, relatively narrow bandwidth channels into a single channel having a wider bandwidth (analog) or higher bit-rate (digital). The term Multiplexer implies the demultiplexing function is present to reverse the process so it is not usually stated.

Ohm

The unit of electric resistance.

Point of Termination (POT)

The physical telecommunications interface that establishes the technical interface, the test point(s), and the point(s) of operational responsibility. (See Network Interface).

Premises

Denotes a building or portion(s) of a building occupied by a single customer or end-user either as a place of business or residence.

CONTENTS

Chapter and Section	Page
9. References.....	9-1
9.1 American National Standards Institute Documents	9-1
9.2 U S WEST Technical Publications.....	9-1
9.3 Ordering Information	9-1
9.4 Trademarks.....	9-2

9. References

9.1 American National Standards Institute Documents

ANSI/EIA/TIA-222-E-91 EIA/TIA, *Structural Standards for Steel Antenna Towers and Antenna Supporting Structures*, March 1991

9.2 U S WEST Technical Publications

PUB 77350 *Telecommunications Equipment Installation Guidelines (TEIG)*,
(Latest Issue)

PUB 77355 *Grounding - Central Office and Remote Equipment Environment*,
(Latest Issue)

9.3 Ordering Information

All documents are subject to change and their citation in this document reflects the most current information available at the time of printing. Readers are advised to check status and availability of all documents.

Those who are not U S WEST employees may order;

American National Standards Institute (ANSI) documents from:

American National Standards Institute
Attn: Customer Service
11 West 42nd Street
New York, NY 10036
Phone: (212) 642-4900
Fax: (212) 302-1286

ANSI has a catalog available which describes their publications.

U S WEST Technical Publications from:

Faison Office Products Company
Suite 200
3251 Revere St.
Aurora, CO 80011
Phone: (800) 777-3672
Fax: (303) 340-1905

Federal Communications Commission (FCC) documents may be obtained from:

Superintendent of Documents
Government Printing Office
Washington, D. C. 20402
Phone: 202 783-3238

Ordering information for Employees of U S WEST, Inc. Submit form RG 31-0033 to:

Central Distribution Center (CDC)
1005 17th St. S-75
Denver, CO 80202
Telephone: (303) 896-9446
Fax: (303) 965-8652

9.4 Trademarks

CLLI	Trademark of Bellcore.
COMMON LANGUAGE	Registered Trademark of Bellcore.
TIRKS	Registered Trademark of Bellcore.
US WEST	Registered Trademark of US WEST, Inc.