

A-554121


ISSUE

A-554121

ENGR	E.C. MATTHEWS	ECM	RAH
DRAWN	N. Miller	JAK	RK.
ISSUE	7L	12-9-60	CHK
DRAWN	767	WTH	WJ
ENGR.		MK	WJ
ISSUE-1		3-22-61	

NOTES:

1. KEY UNIT VIEWED FROM TOP OF KEY.
2. CONNECTIONS BETWEEN THE SPRINGS AND THE TERMINALS SHALL BE MADE WITH "H" WIRE, P-465781, 22 GA, SINGLE, BLACK.
3. ALL CONNECTIONS SHALL BE SOLDERED PER SPEC 50016, METHOD C.
4. WIRING SHALL HAVE SUFFICIENT SLACK TO PERMIT KEY UNIT TO BE REVERSED.
5. FOR INFORMATION PERTAINING TO "X" AND "R" SEE REQUIREMENTS 2A AND 28B A-165729, (2A AND 19B, LA-850016).
6. < > INDICATES BTL INFORMATION WHICH SHALL NOT BE USED FOR MANUFACTURING PURPOSES.
7. ——— DENOTES STRAPPING TO BE MADE WITH #24AWG "T" WIRE P-314954 AND SLEEVING OF VARNISHED TUBING, P-26991.

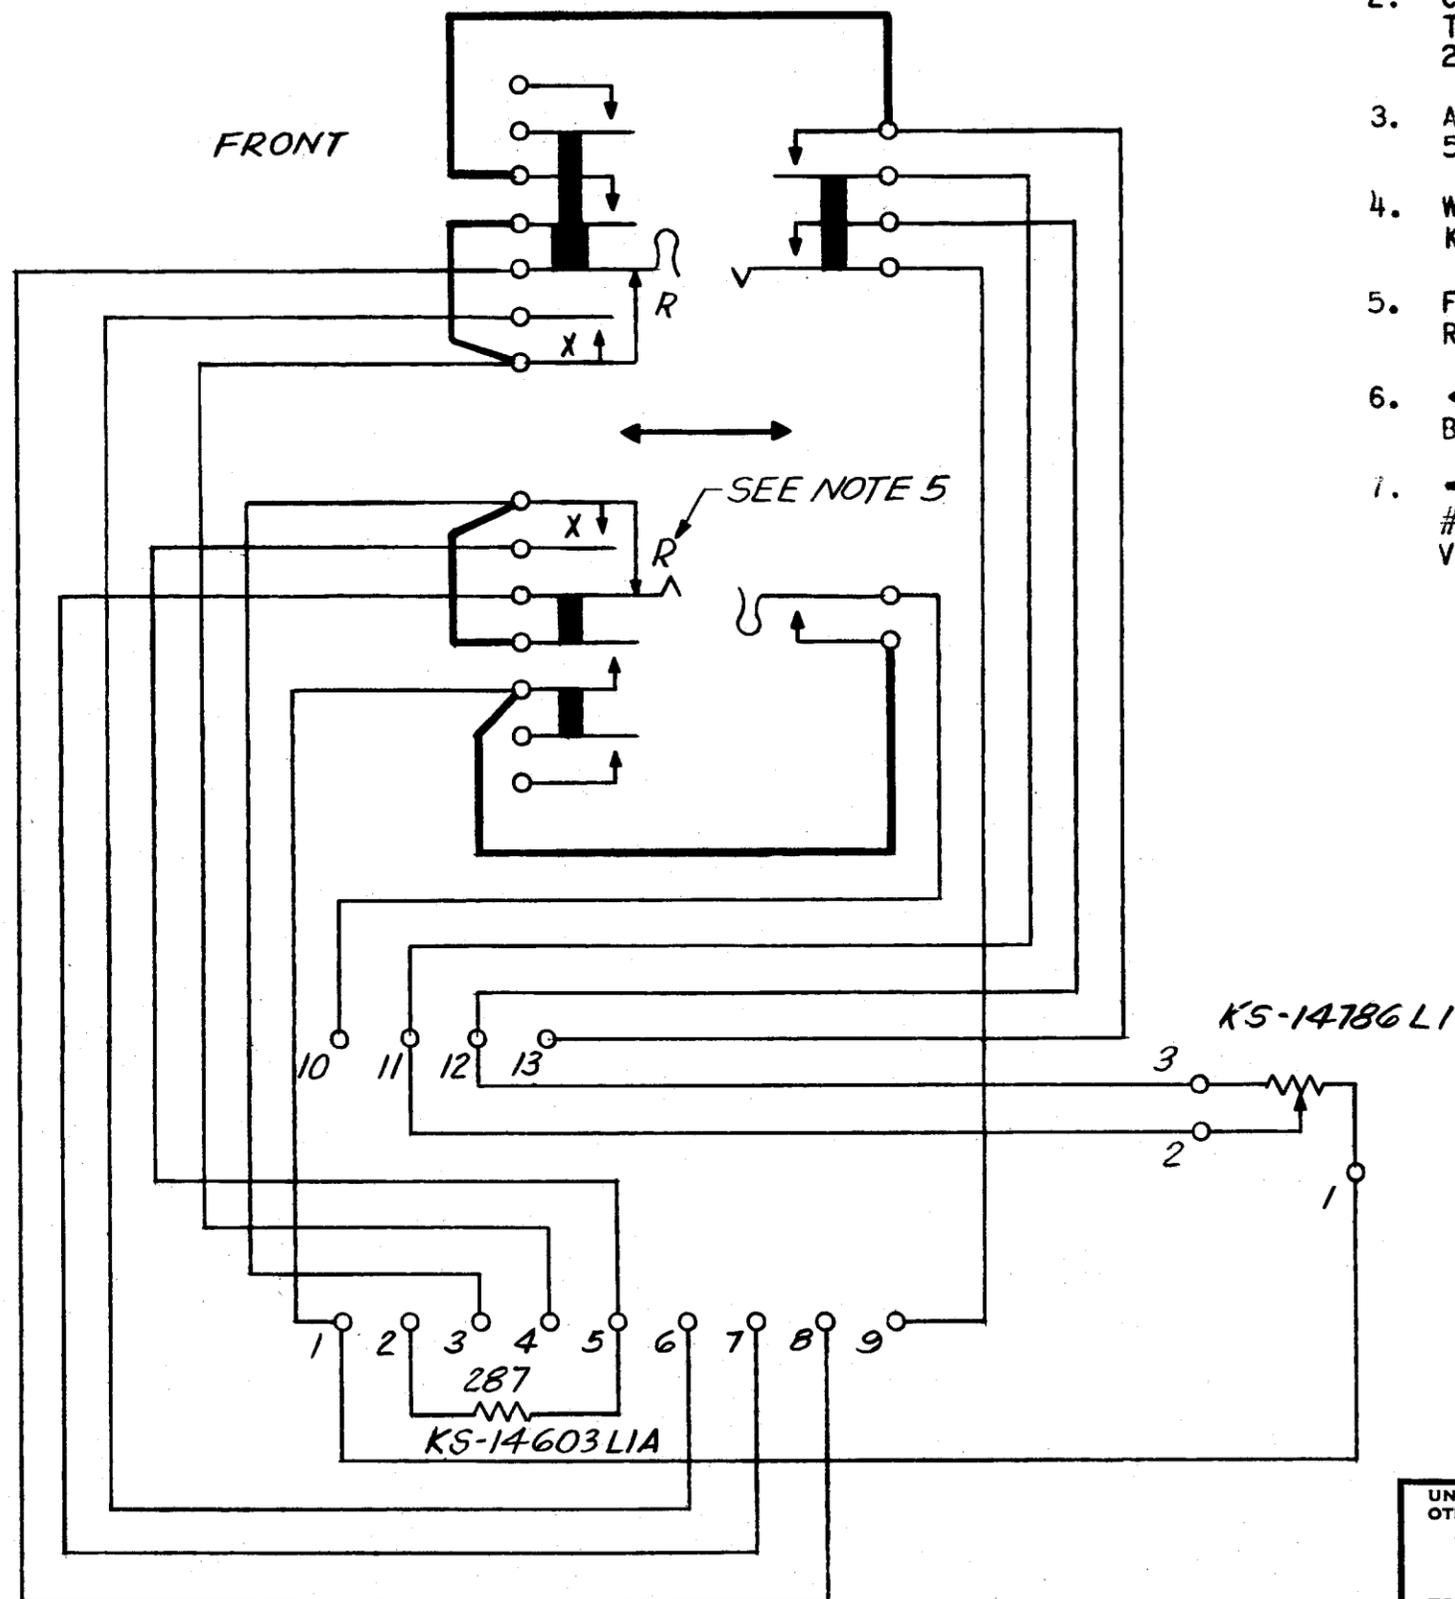

GO17AN KEY	A-553629
USED ON	DWG

GO17AN KEY
DIAGRAM OF
CONNECTIONS
SCALE NONE

WESTERN ELECTRIC COMPANY, INC.
ENGINEER OF MANUFACTURE

BELL TELEPHONE LABORATORIES
INCORPORATED

UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES. NONLIMITED DIMENSIONS OTHER THAN SIZE OF RAW MATERIAL SHALL BE HELD AS FOLLOWS WHEN EXPRESSED:
TO 2 DECIMAL PLACES ± AS ANGLES ±
TO 3 DECIMAL PLACES ±
FOR GENERAL INFORMATION ON SYMBOLS AND NOTES REFER TO MANUFACTURING STANDARD 16.003, PART 2, SECTION 227.

DWG. SIZE
2S

CDS
A-554121
SHEET