


FEATURE OR OPTION	PROVIDE	
	FIG.	QUANTITY
MANUAL RESET	S	1 PER CKT
AUTOMATIC RESET	T	1 PER CKT
AVAILABLE INPUT VOLTAGE AT INSTALLATION	+152V	U
	+130V	V
	+88V	N
	-88V	X
	+24V	Y
	-24V	Z

NOTES:
 1. UNLESS OTHERWISE SPECIFIED, RESISTANCE VALUES ARE IN OHMS, CAPACITANCE VALUES ARE IN MICROFARADS, INDUCTANCE VALUES ARE IN MILLIHENRIES.
 2. SEE STOCK LIST OF ASSEMBLY DRAWINGS B-876946 FOR INFORMATION CONCERNING COMPONENTS REFERRED TO BY REFERENCE.

REV	DATE	BY	CHKD
1	11-10-54	WJ	WJ
2	1-18-55	WJ	WJ

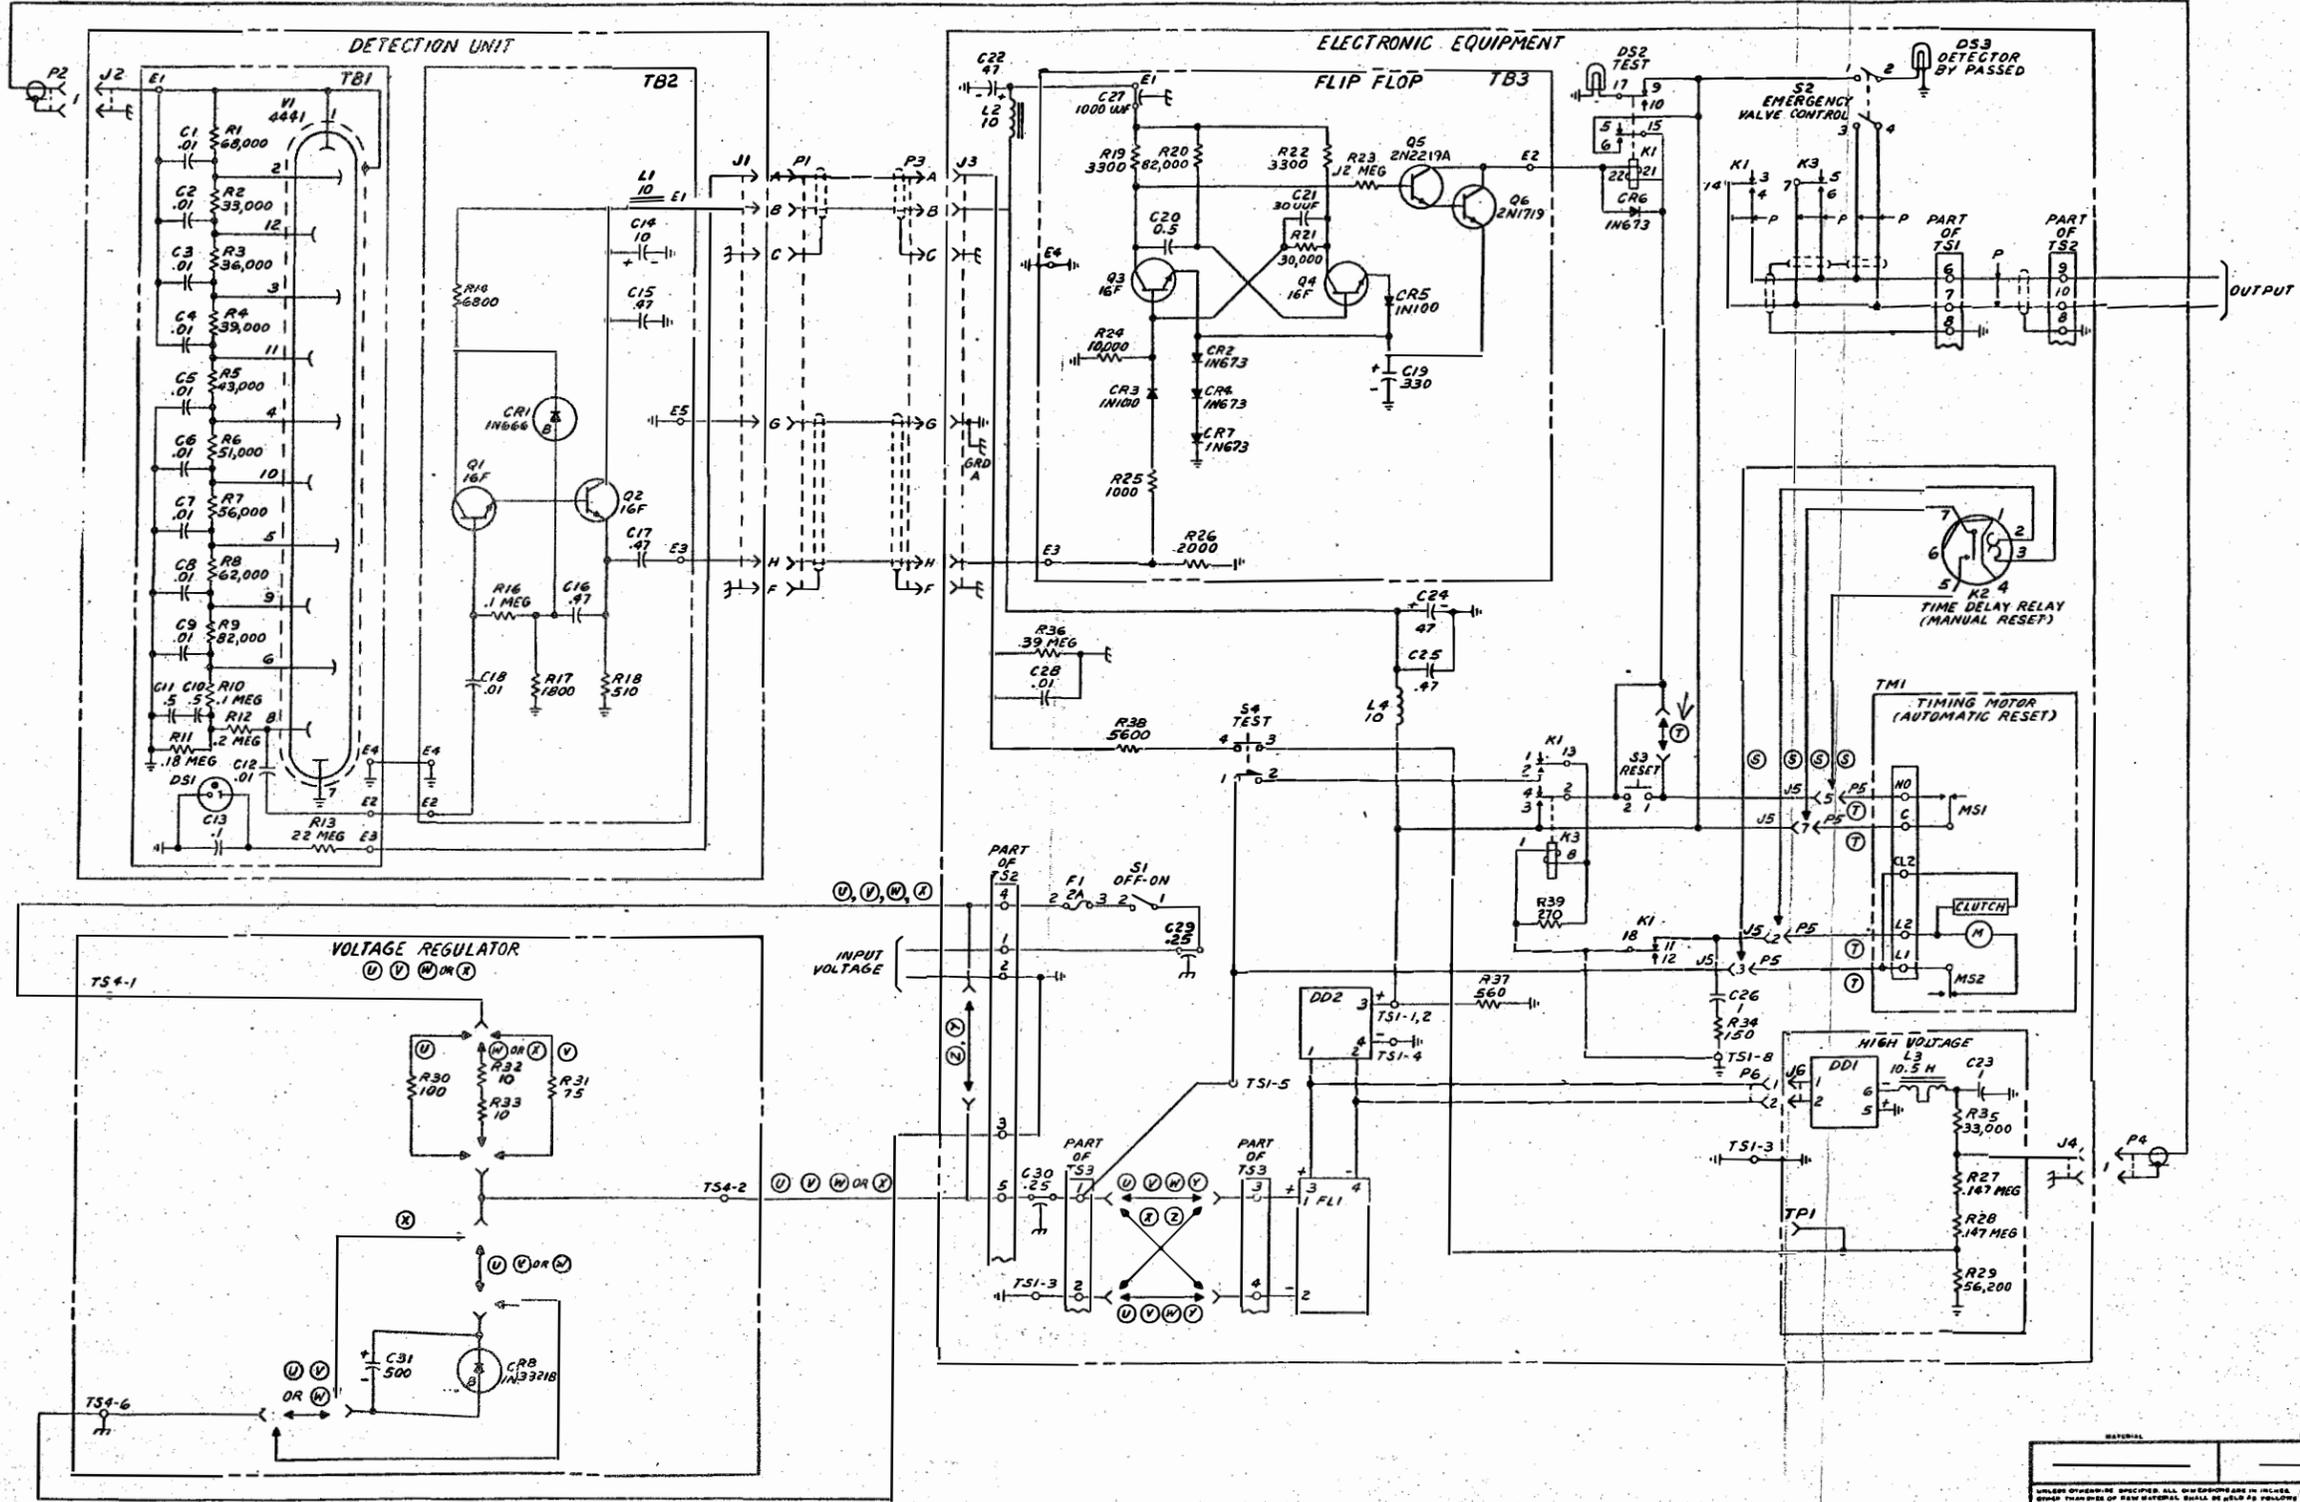

B-995320

15-19557 B-876946
 USED ON: DWD
DETECTOR (NUCLEAR BLAST) SCHEMATIC
 BELL TELEPHONE LABORATORIES
 B-995320
 X85 S.P.