

TERMINATING SIGNALING GROUND WIRE AT GROUND CONNECTING DEVICES

1. GENERAL

1.01 This section covers the methods for terminating signaling ground wires at ground connecting devices, such as ground clamps, ground strips, and protectors. This section does not, however, cover the installation of ground clamps. For such information see standard instructions covering the installation of protectors.

2. TERMINATING

Ground Clamps

2.01 Terminate signaling ground wires at ground clamps as shown in the following typical illustrations.

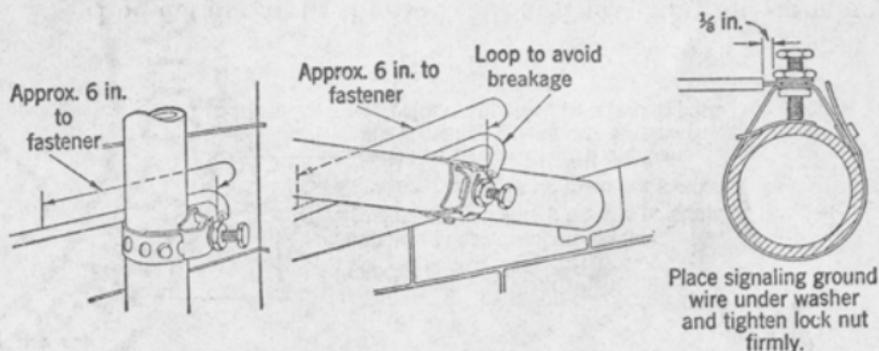


Fig. 1.

Ground Strips

2.02 Terminate signaling ground wires at ground strips as outlined in the section covering "Terminating Wire at Distributing Terminals."

Protectors

2.03 In terminating signaling ground wires at protectors, arrange connections at the ground post as indicated by Fig. 2.

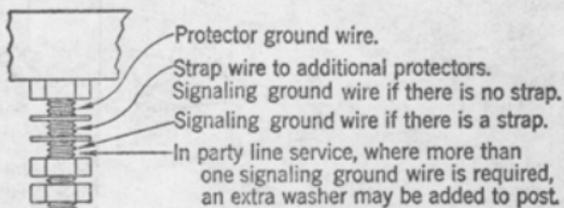


Fig. 2.

2.04 For details as to the dressing and fastening of signaling ground wires at protectors, see standard instructions covering the installation of protectors.