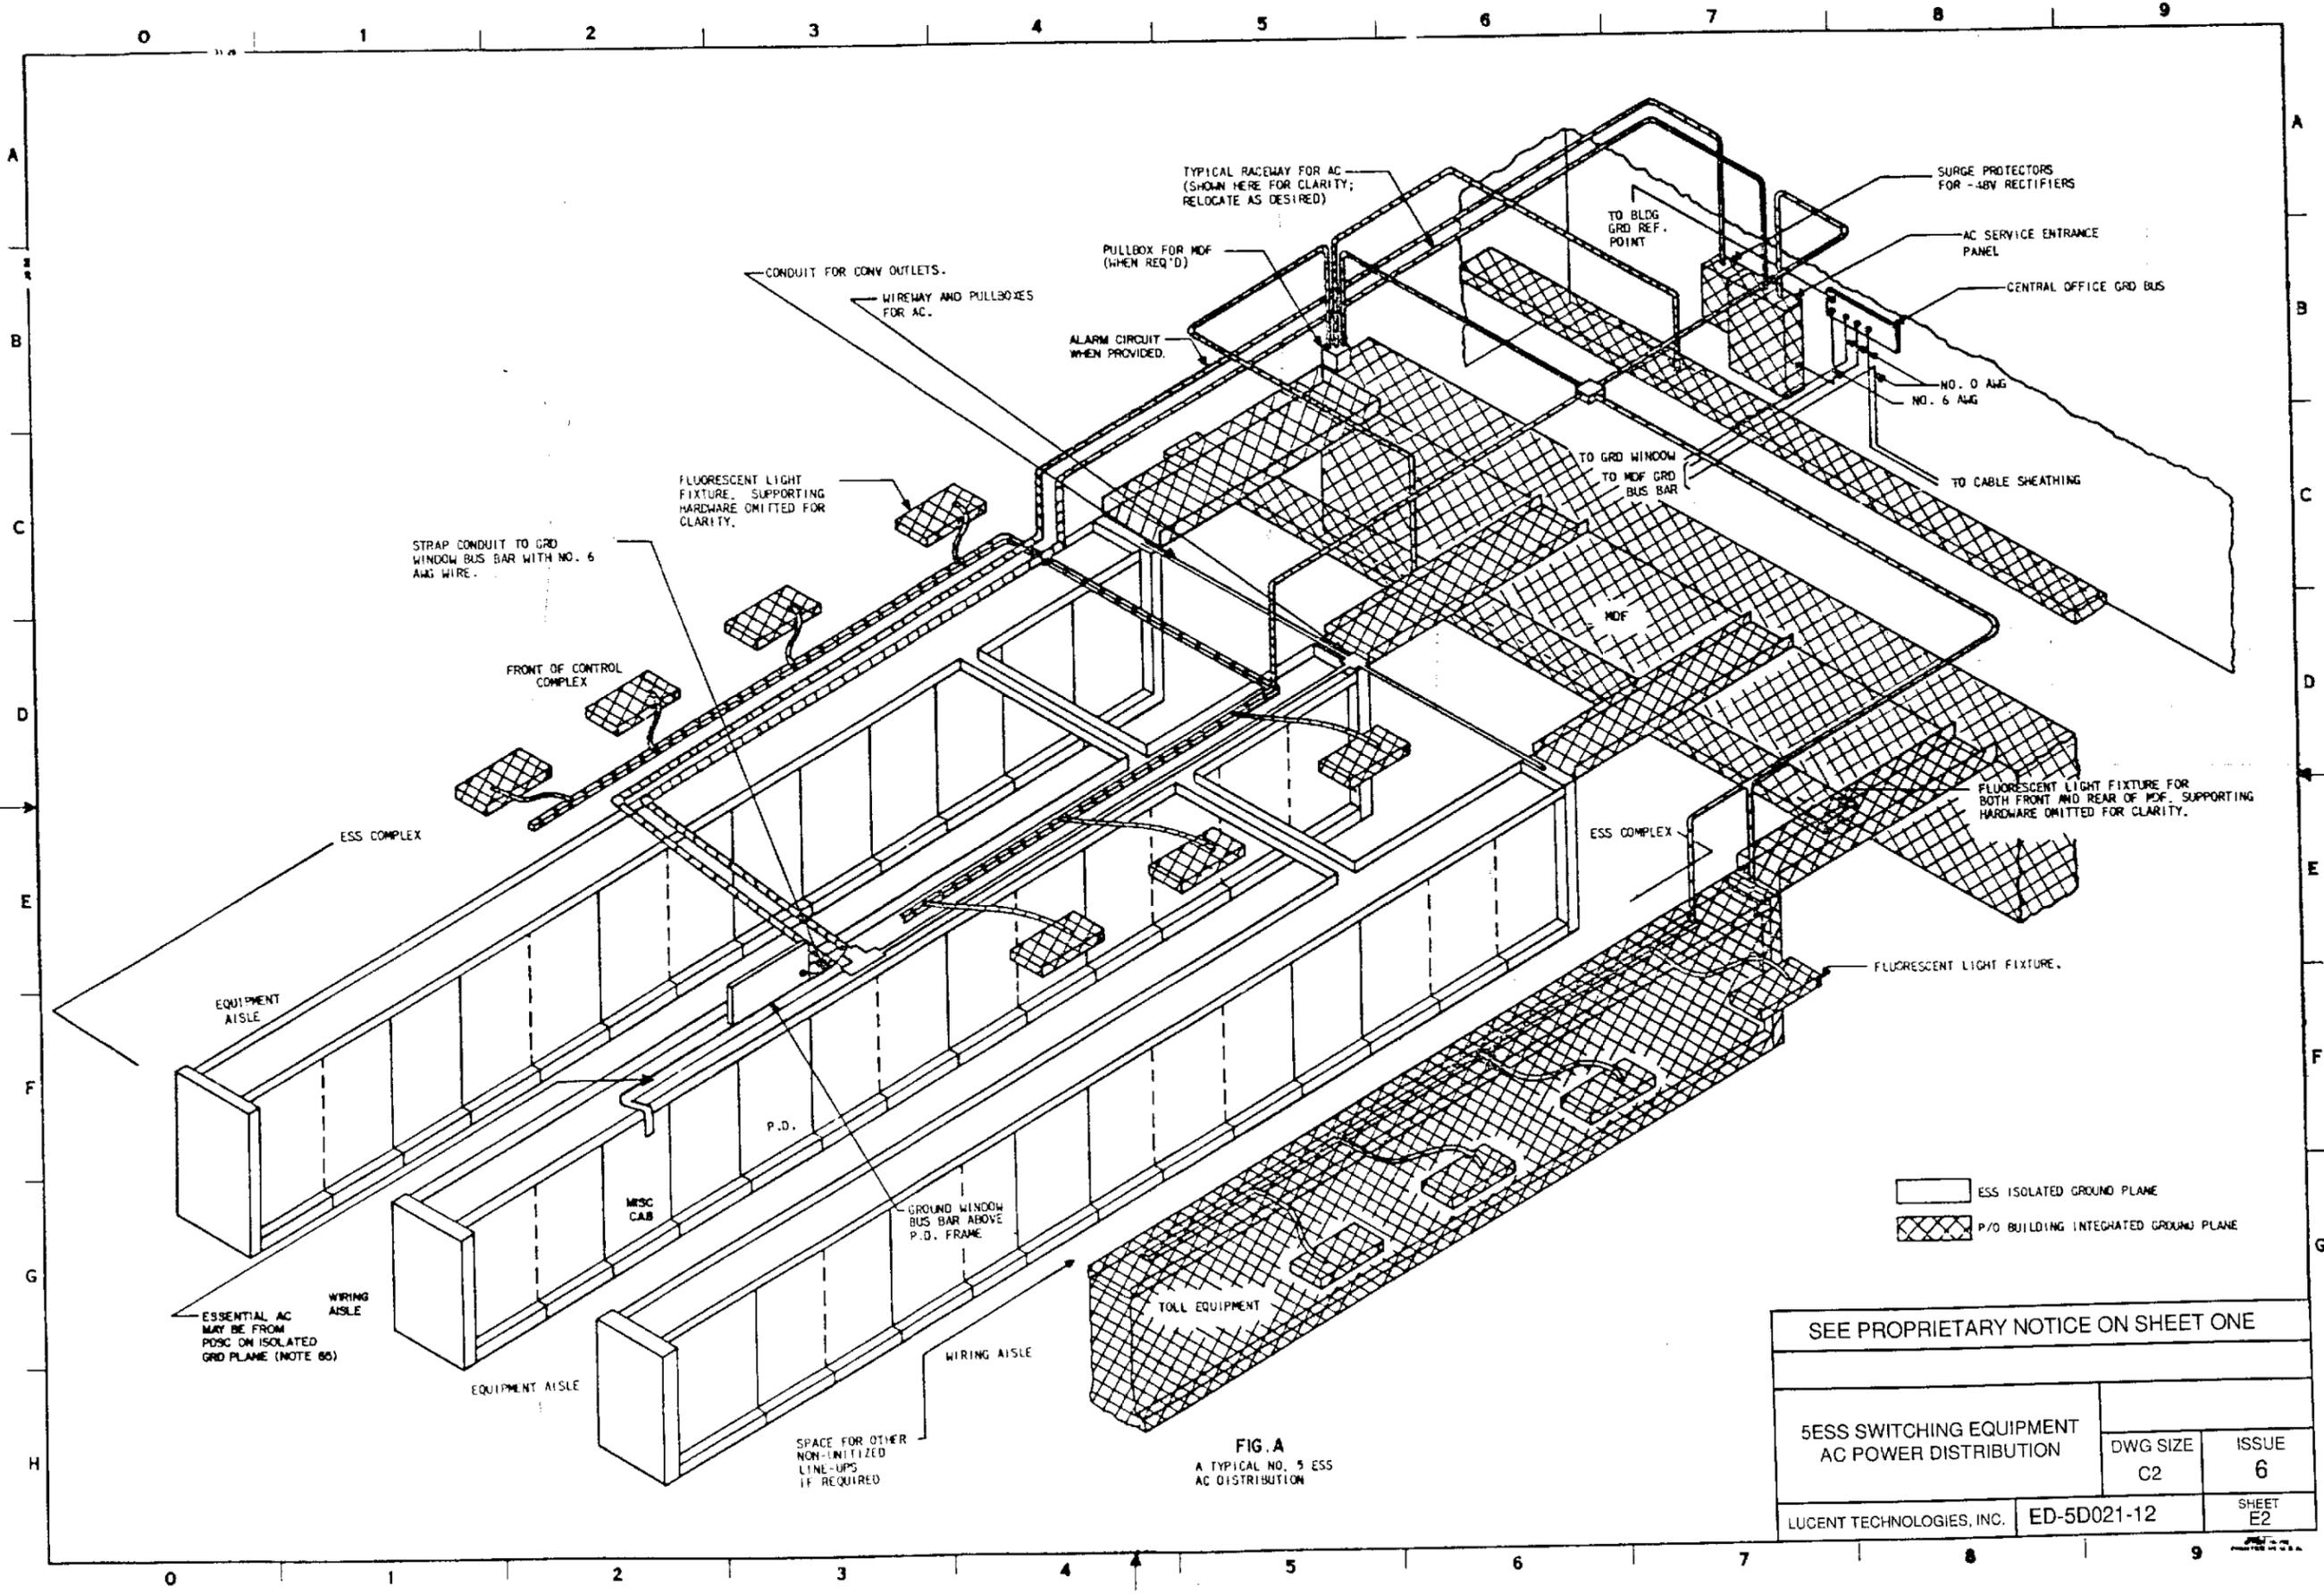


SEE PROPRIETARY NOTICE ON SHEET ONE		
5ESS SWITCHING EQUIPMENT AC POWER DISTRIBUTION	DWG SIZE	ISSUE
	C2	6
LUCENT TECHNOLOGIES, INC.	ED-5D021-12	SHEET E1



**FIG. A**  
A TYPICAL NO. 5 ESS  
AC DISTRIBUTION

SEE PROPRIETARY NOTICE ON SHEET ONE		
5ESS SWITCHING EQUIPMENT AC POWER DISTRIBUTION	DWG SIZE	ISSUE
	C2	6
LUCENT TECHNOLOGIES, INC.	ED-5D021-12	SHEET E2

SHEET NOTE:

- A. STUDS SHALL BE INSTALLED TO THE FULL DEPTH OF THE THREAD IN THE ANCHOR.
- B. THE STUD AND NUT SHALL NOT TOUCH EQUIPMENT. STUDS MAY BE CUT TO PROVIDE CLEARANCE.
- C. AFTER THE HOLD DOWN PILE-UP IS TIGHTENED THERE SHALL BE A MINIMUM OF APPROXIMATELY 1-1/2 THREADS ( OR MORE ) SHOWING ABOVE THE NUT.
- D. THE ANCHOR SHALL BE POSITIONED SO THAT IT IS FLUSH TO SLIGHTLY UNDER FLUSH TO THE WALL OR COLUMN CONCRETE SURFACE.
- E. HOLD DOWN PLATE CAN BE CUT TO AVOID OBSTRUCTIONS.

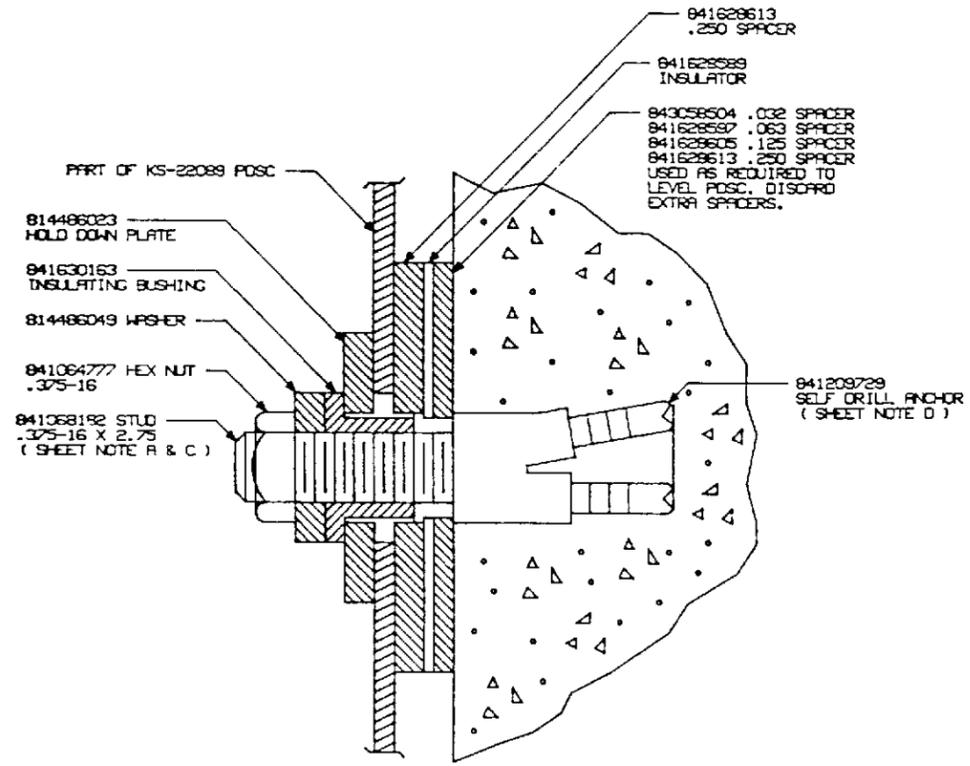


FIG. B  
 TYPICAL METHOD OF SECURING POSC TO AND INSULATING FROM CONCRETE WALL OR COLUMN. ( 4 PLACES ) HS11-049 GROUP 24 PROVIDES HOLD DOWN MATERIAL FOR ONE POSC. ( SEE SHEET NOTES A THRU D )

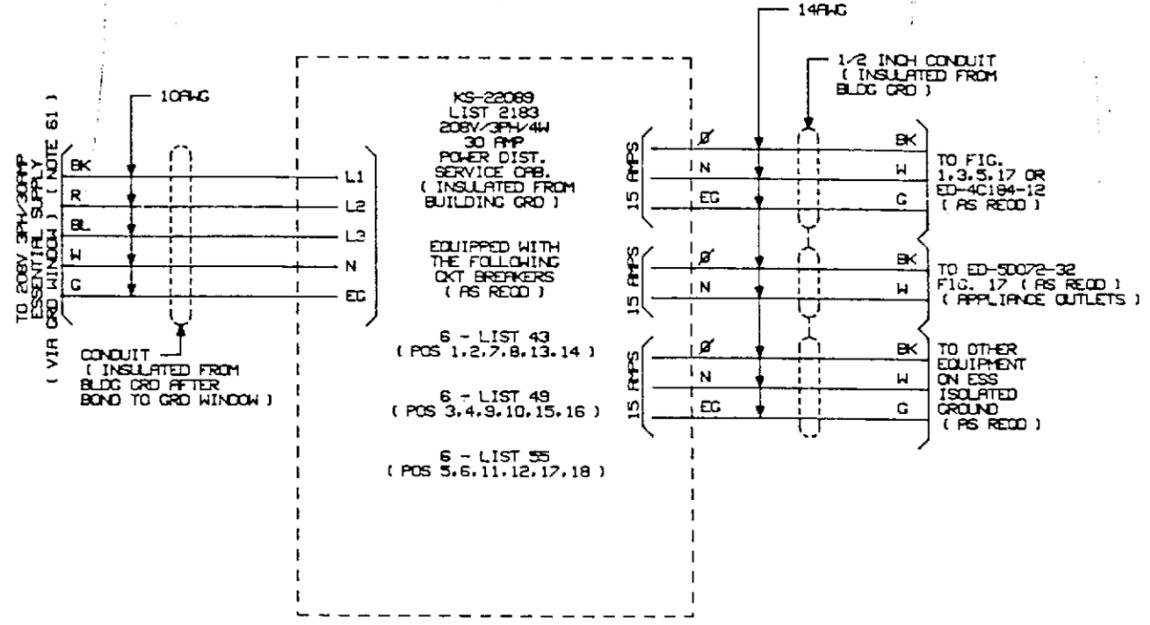


FIG. 6  
 TYPICAL ESSENTIAL AC/ISOLATED GROUND POWER DISTRIBUTING SERVICE CABINET FOR USE IN SESS SWITCH OFFICES UTILIZING A REMOTE GROUND WINDOW ( SEE NOTE 6S )

SEE PROPRIETARY NOTICE ON SHEET ONE		
5ESS SWITCHING EQUIPMENT AC POWER DISTRIBUTION	DWG SIZE	ISSUE
	C2	6
LUCENT TECHNOLOGIES, INC.	ED-5D021-12	SHEET E3

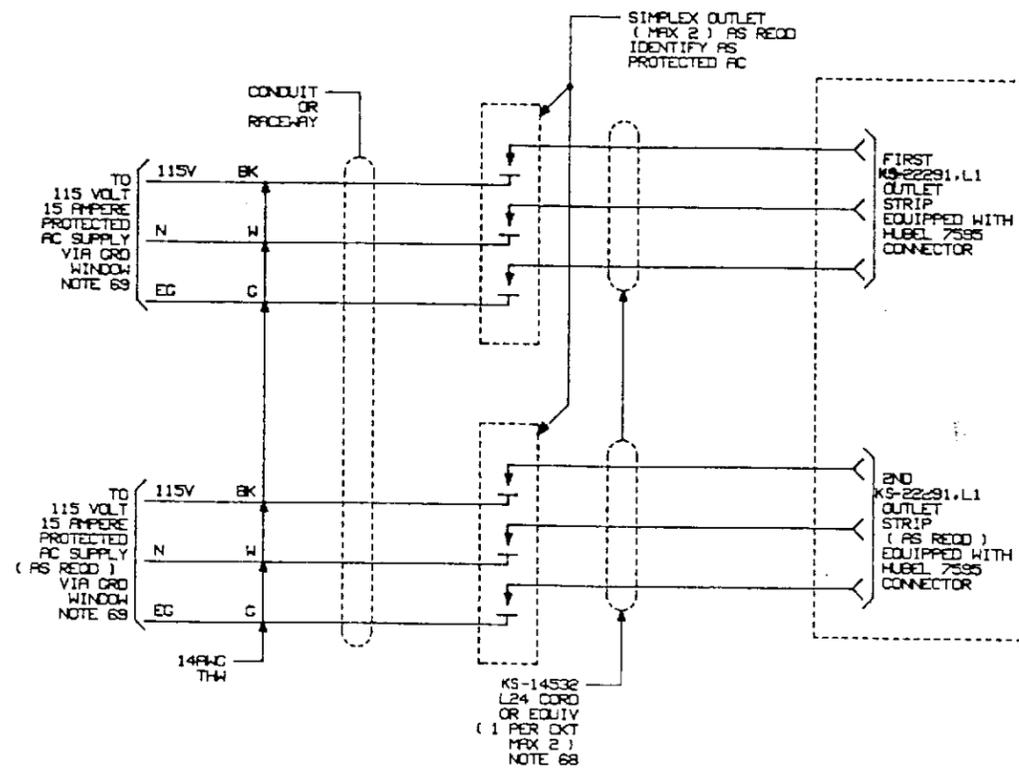


FIG. 8  
OSPS DATA SET CABINET  
J50000K-  
( NOTES 68, 69 )

SEE PROPRIETARY NOTICE ON SHEET ONE		
5ESS SWITCHING EQUIPMENT AC POWER DISTRIBUTION	DWG SIZE	ISSUE
	C2	6
LUCENT TECHNOLOGIES, INC.	ED-5D021-12	SHEET E4