

TABLE A-FEATURES											
EQUIPMENT		RAT- ING	LIST OR GROUP	EQUIPMENT OR CIRCUIT DATA					SD EQUIVALENT		
DESCRIPTION	REF NOTE			QTY	EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON J5D003AU-1 UNIT).			1 THRU 5								
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON J5D003AU-1 UNIT).			1A								
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON J5D003AU-1 UNIT).			6								
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON J5D003AU-1 UNIT).			7								
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON J5D003AU-1 UNIT).			8								
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON J5D003AU-1 OR 2 UNIT).			9								
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON MFFU J5D003FJ-1 UNIT).			10								
ASSEMBLY & WIRING REQUIRED FOR ONE 10 AWG -48 VOLT UNIT POWER DISTRIBUTION CABLE (USE ON MFFU J5D003FJ-1 UNIT).(METRIC LUG USED)			11								
END OF TABLE-A											



ISSUE NOTES				
ORIG ISS: 03/01/83	NDD NBR: 5D003IH-13	CHANGE CLASS:		
DRAFT: JRP	ENGR: WJV	SUPV: JFM	VAULT: 03/01/83	ISSUE: 1
GROUP 2 & 3 ADDED. NOTES 9,10 & 11 ADDED. SL ITEMS 1040 & 1050 ADDED, 1030 CHANGED. TABLE A ADDED.				
AT&T CL: AD		ORIG ISS: 03/01/83		WECCO CL: AD
DRAFT: JRP	ENGR: WJV	SUPV:	VAULT: 05/12/83	ISSUE: 2
GROUP 4 ADDED. NOTE 6 CHANGED. SL ITEMS 1060 AND 1090 ADDED.				
AT&T CL: AD		ORIG ISS: 03/01/83		WECCO CL: AD
DRAFT: JRP	ENGR: RW	SUPV:	VAULT: 07/26/83	ISSUE: 3
<p>-----</p> <p>* DRAWING CONVERTED FROM SEDBS TO MDS COMPUTER SYSTEMS. *</p> <p>* THIS IS A MACHINE COPY OF THE LATEST SEDBS CERTIFIED ISSUE *</p> <p>* AND MAY CONTAIN MINOR DIFFERENCES. THE TABLE OF ASSOCIATED *</p> <p>* DRAWINGS WAS ELIMINATED DURING MIGRATION TO ASSIST THE *</p> <p>* SCRUBBING OF PROPRIETARY INFORMATION. *</p> <p>-----</p> <p>SHT C1 REF TO NOTE 12 ADDED. SHT D1 NOTE 12 ADDED. GROUP 5 ADDED. DRAWING RATING REMOVED.</p>				
ORIG ISS: 03/01/83		CHANGE CLASS: B		
DRAFT: DJP	ENGR: REW	SUPV:	CERTIFIED: 01/28/86	ISSUE: 4
GROUP 1A ADDED TO TABLE A, SL ITEM 2000 ADDED.				
ORIG ISS: 03/01/83		CHANGE CLASS: B		
DRAFT: DSL	ENGR: WJV	SUPV:	CERTIFIED: 02/12/86	ISSUE: 5
GROUPS 6,7,8 & 9 ADDED TO TABLE A & SHT. D1,SL ITEM 2010 ADDED.				
ORIG ISS: 03/01/83		CHANGE CLASS: B		
DRAFT: DSL	ENGR: JDC	SUPV:	CERTIFIED: 07/01/86	ISSUE: 6
GROUP 10 ADDED FOR MFFU (J5D003FJ-1).				
ORIG ISS: 03/01/83		CHANGE CLASS: B		
DRAFT: TFL	ENGR: TPL	SUPV:	CERTIFIED: 01/12/93	ISSUE: 7
<p>CREATED SHT C2,MOVED GRAPHICS FOR GRPS 2,3,6,7,8,9 AND 10 TO SHT C2,CHGD KS CONN ON GROUPS 6,7,8, AND 9 TO WF CONN (PI 7.1). CONN POSITION FOR T &amp; B CONN C52 CHGD (PI 7.2).METRIC DIMS ADDED TO SHTS C1 AND C2,A DIM ADDED TO SL.</p>				
ORIG ISS: 03/01/83		CHANGE CLASS: MF		
DRAFT: ESK	ENGR: ESK	SUPV:	CERTIFIED: 08/03/95	ISSUE: 8
<p>IN TABLE A GROUP 11 ADDED. IN STOCKLIST IN ITEMS 3000,3010, 3030 &amp; 3040 GROUP 11 ADDED. ITEM 3050 ADDED. SHEET C3 GROUP 11 ADDED.</p>				
ORIG ISS: 03/01/83		NDD NBR: NDD5D005NW-75	CHANGE CLASS: B	
DRAFT: DLP	ENGR: DLP	SUPV:	CERTIFIED: 09/27/96	ISSUE: 9

SHEET INDEX									
SHT NBR	A1 THRU A1			ISSUE 9					
ISSUE									
SHT NBR	D1	THRU	D1	ISSUE 9					
ISSUE									
SHT NBR	C1	C2	C3						
ISSUE	8	8	9						
SHT NBR									
ISSUE									
SHT NBR									
ISSUE									
SHT NBR									
ISSUE									
SHT NBR									
ISSUE									
SHT NBR									
ISSUE									
SHT NBR									
ISSUE									
SHT NBR									
ISSUE									
SHT NBR									
ISSUE									


ED5D507-16

LUCENT TECHNOLOGIES - PROPRIETARY USE PURSUANT TO COMPANY INSTRUCTIONS	
XT13  SESS SWITCHING EQUIPMENT FUSE/FILTER UNIT POWER DISTRIBUTION CABLE	DWG SIZE C2  ISSUE 9
LUCENT TECHNOLOGIES INC ED5D507-16	SHEET A1 OF 5


TABLE A		
GROUP NO.	METRIC (CM)	DIMENSION
1	27.94 ± 1.25	11 ± 1/2
1A	12.07 ± 0.64	4 3/4 ± 1/4
2	30.5 ± 0.64	12 ± 1/4
3	43.2 ± 0.64	17 ± 1/4
5	15.25 ± 1.25	6 ± 1/2
6	172.7 ± 1.25	68 ± 1/2
7	182.9 ± 1.25	72 ± 1/2
8	160.0 ± 1.25	63 ± 1/2
9	185.4 ± 1.25	73 ± 1/2
10	182.9 ± 1.25	72 ± 1/2

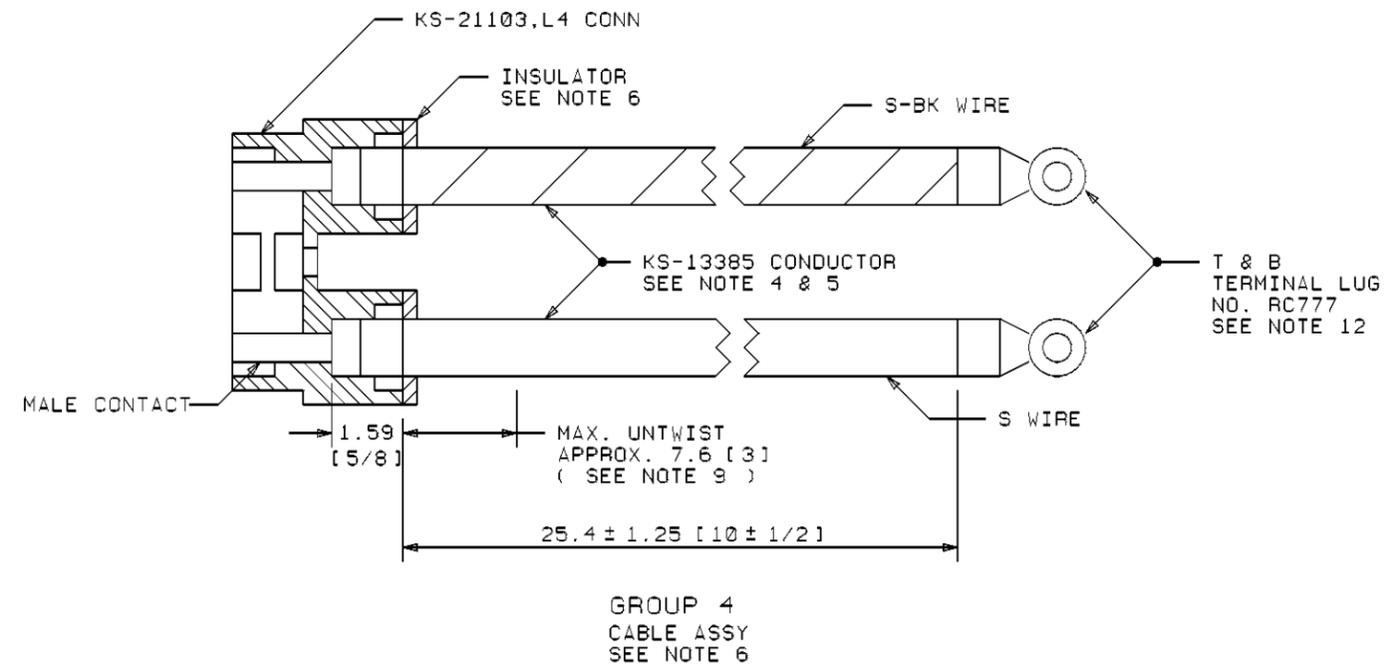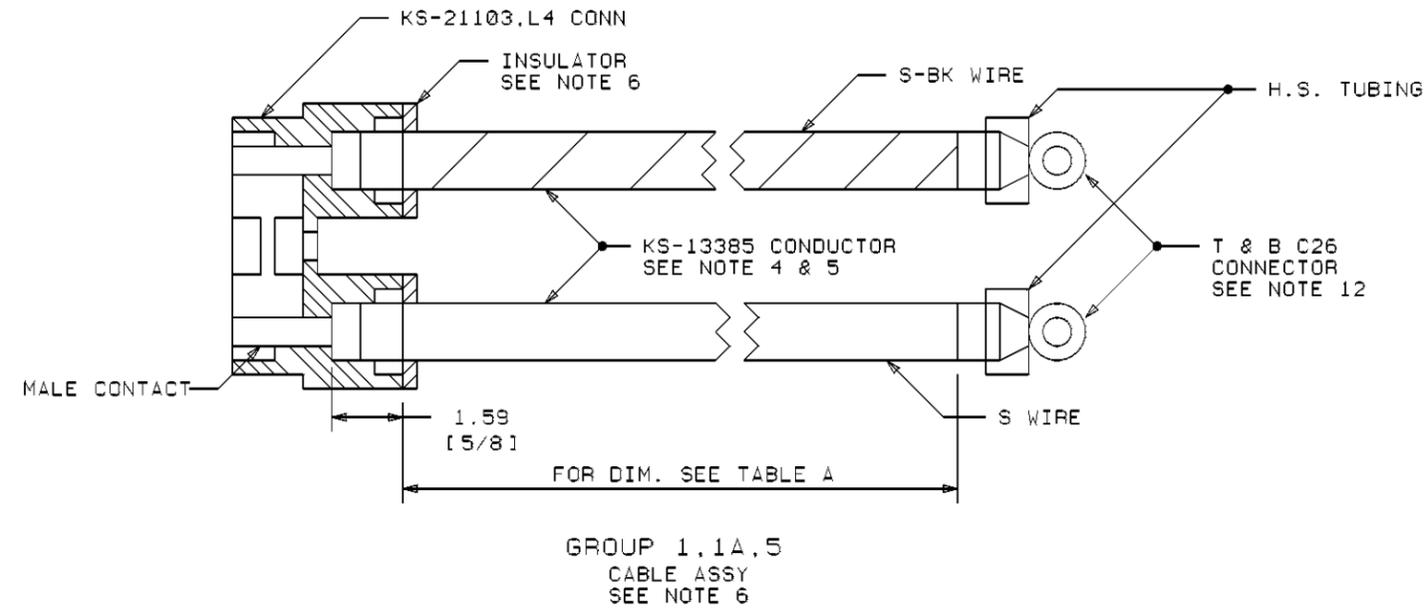


SEE PROPRIETARY NOTICE ON SHEET ONE		
FUSE/FILTER UNIT POWER DISTRIBUTION CABLE	DWG SIZE	ISSUE
	C2	8
AT&T	ED5D507-16	SHEET c1

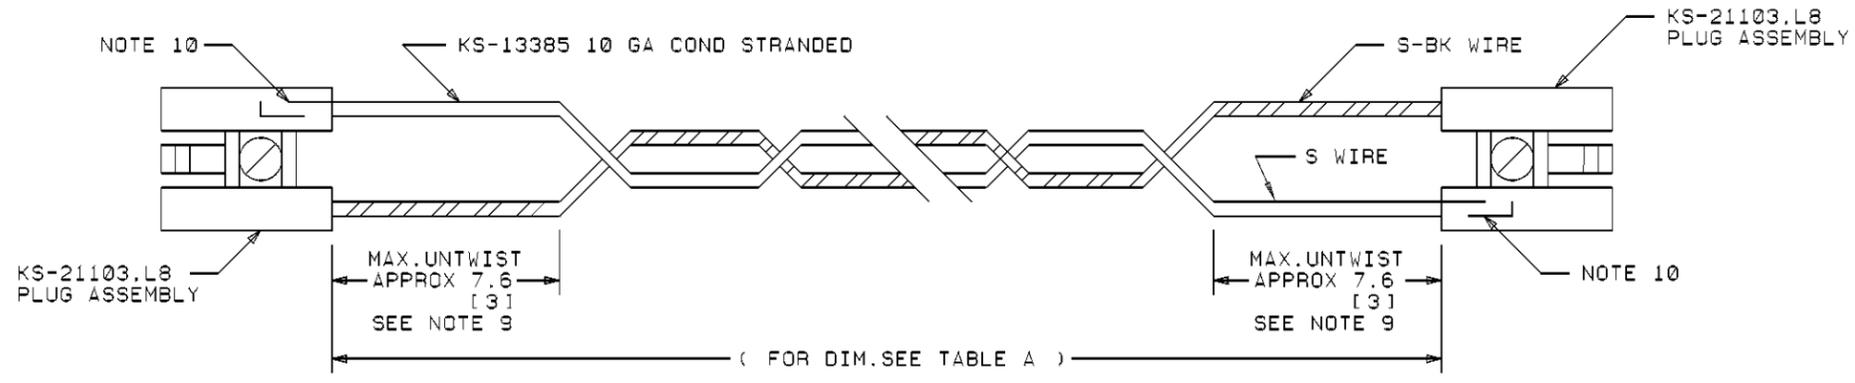

GROUP 2 OR 3  
CABLE ASSY  
SEE NOTE 11.12

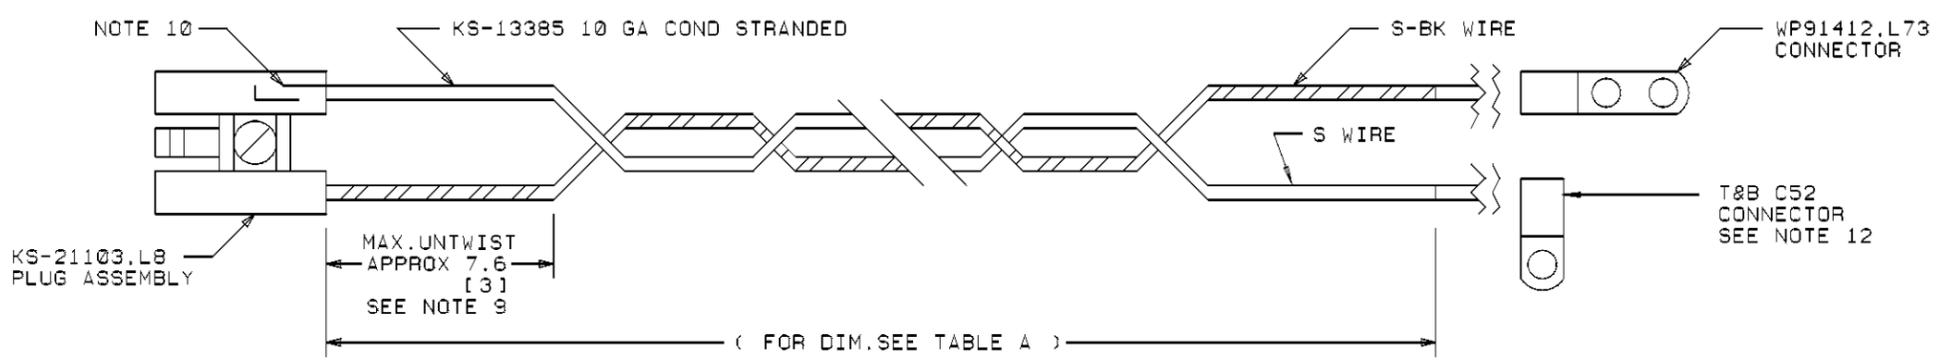


GROUP 6, 7, 8 & 9  
CABLE ASSY  
SEE NOTE 11.12

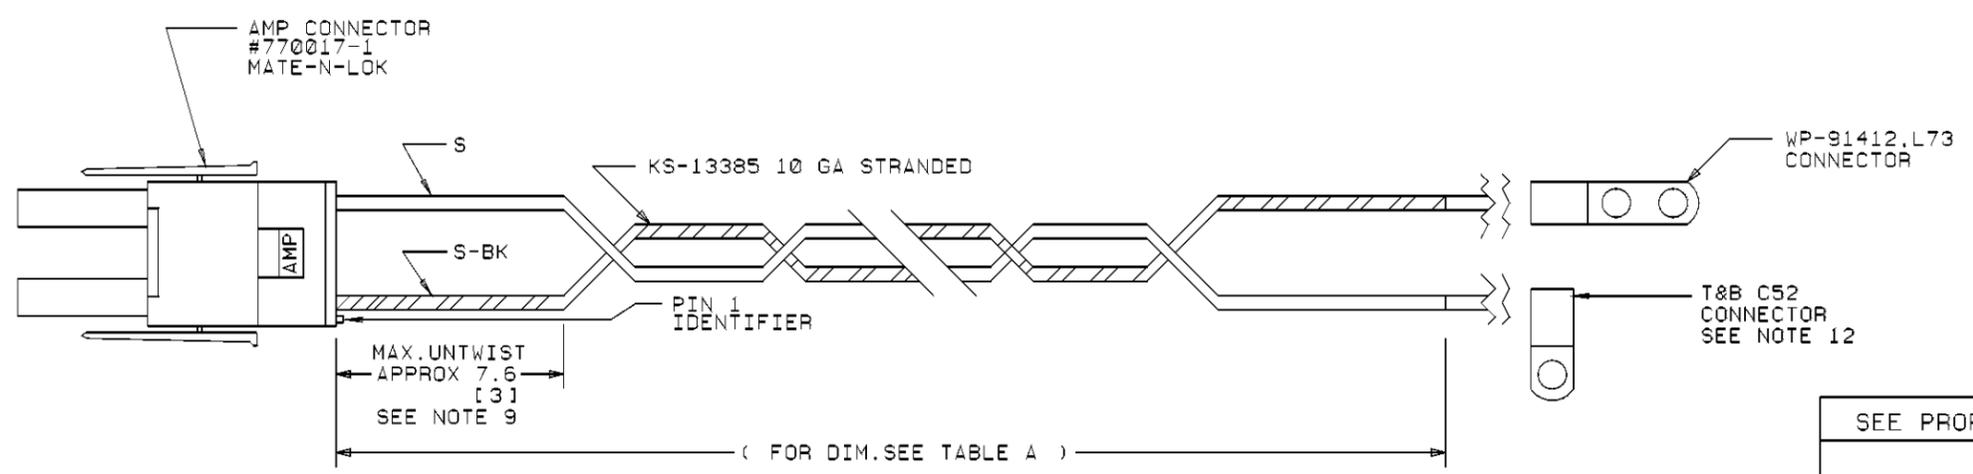

GROUP 10

SEE PROPRIETARY NOTICE ON SHEET ONE		
FUSE/FILTER UNIT POWER DISTRIBUTION CABLE	DWG SIZE	ISSUE
	c2	8
AT&T	ED5D507-16	SHEET c2

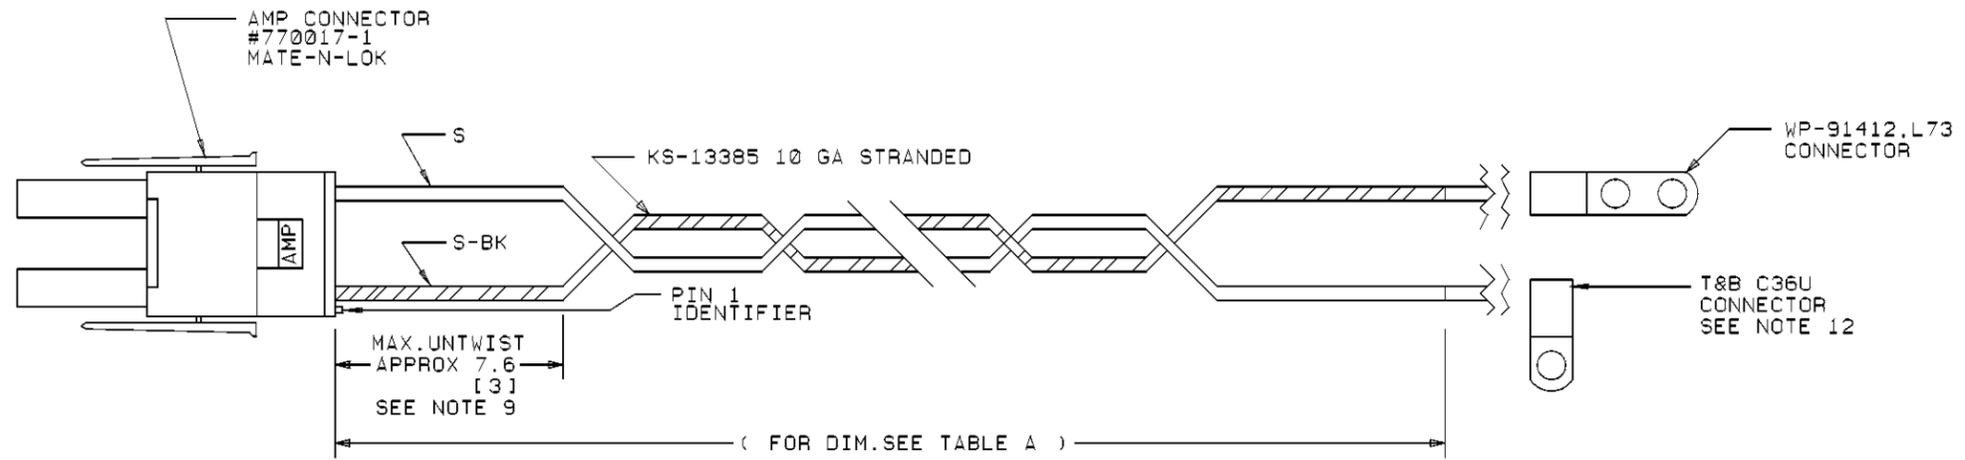

GROUP 11

ED5D507-16

SEE PROPRIETARY NOTICE ON SHEET ONE		
FUSE/FILTER UNIT POWER DISTRIBUTION CABLE	DWG SIZE	ISSUE
	C2	9
AT&T	ED5D507-16	SHEET C3

