

TABLE A										
A	B	C	D	E				J		
EQUIPMENT	RAT- ING	LIST OR GRP	QTY	EQUIPMENT OR CIRCUIT DATA				SD EQUIVALENT		
				EQUIPMENT OR CIRCUIT	LIST GROUP OR FIG	WRG	APP	SCHEMATIC	FIG	OPT
ONE CABLE RACK SUPPORT STANCHION FOR USE WITH 6'-0" HIGH EQUIPMENT CABINETS (SEE NOTE 52).		1								
ONE CABLE RACK SUPPORT STANCHION FOR USE WITH 6'-0" HIGH EQUIPMENT CABINETS (SEE NOTE 53).		2								

ENGINEERING NOTES

- 51. UNASSIGNED.
- 52. G-1 STANCHIONS SHALL BE USED TO SUPPORT CABLE RACKS WHEN THE CABLE RACKS SPAN FOUR OR MORE UNOCCUPIED CABINET POSITIONS AT INTERVALS OF 90 INCHES.
- 53. G-2 STANCHION SHALL BE UTILIZED WITH AN END GUARD WHEN END POSITION IN LINEUP IS UNEQUIPPED.

VAULTED	NO050513-701H	03/14/83
DES	NJT	RSZ
SHEET B1 ADDED.		
VAULTED	AT&T CL:D	06/23/83
DES	NJT	HE CL:D
NOTE 53 ADDED.		
VAULTED	AT&T CL:B	07/26/83
DES	NJT	HE CL:B
ADDED G-2 REVISED NOTES 52 & 53 C084M0031-81		
VAULTED	AT&T CL:B	04/17/84
DES	NJT	HE CL:B
LIST OF ASSOCIATED DRAWING TABLE CORRECTED.		
VAULTED	AT&T CL:D	12/27/84
DES	RJC	

SHEET INDEX	SH NO.	A1 THRU A 1 AND D1 THRU D 1
	ISSUE	5
SH NO.	8 1	
ISSUE	4	
SH NO.		
ISSUE		
SH NO.		
ISSUE		
SH NO.		
ISSUE		
SH NO.		
ISSUE		
SH NO.		
ISSUE		

12		
11		
10		
9		
8		
7		
6		
5		
4		
3		
2		
1		
LINE	NAME	NUMBER
DRAWINGS DESIGN NOT REQUIRED BY THE INSTALLER		
TABLE D-LIST OF ASSOCIATED DRAWINGS		

NOTICE-AT&T TECHNOLOGIES, INC. - PROPRIETARY

7199 5ESS SWITCHING EQUIPMENT SPECIFICATION FOR LINE-UP CABLE RACK SUPPORT STANCHION ASSEMBLY	AT&T CO RATING AT&T CO PROVISIONAL
	WECO RATING
DWG SIZE C2	ISSUE 5
WESTERN ELECTRIC ED-5D513-70	SHEET 1 OF 3

ED-50513-70

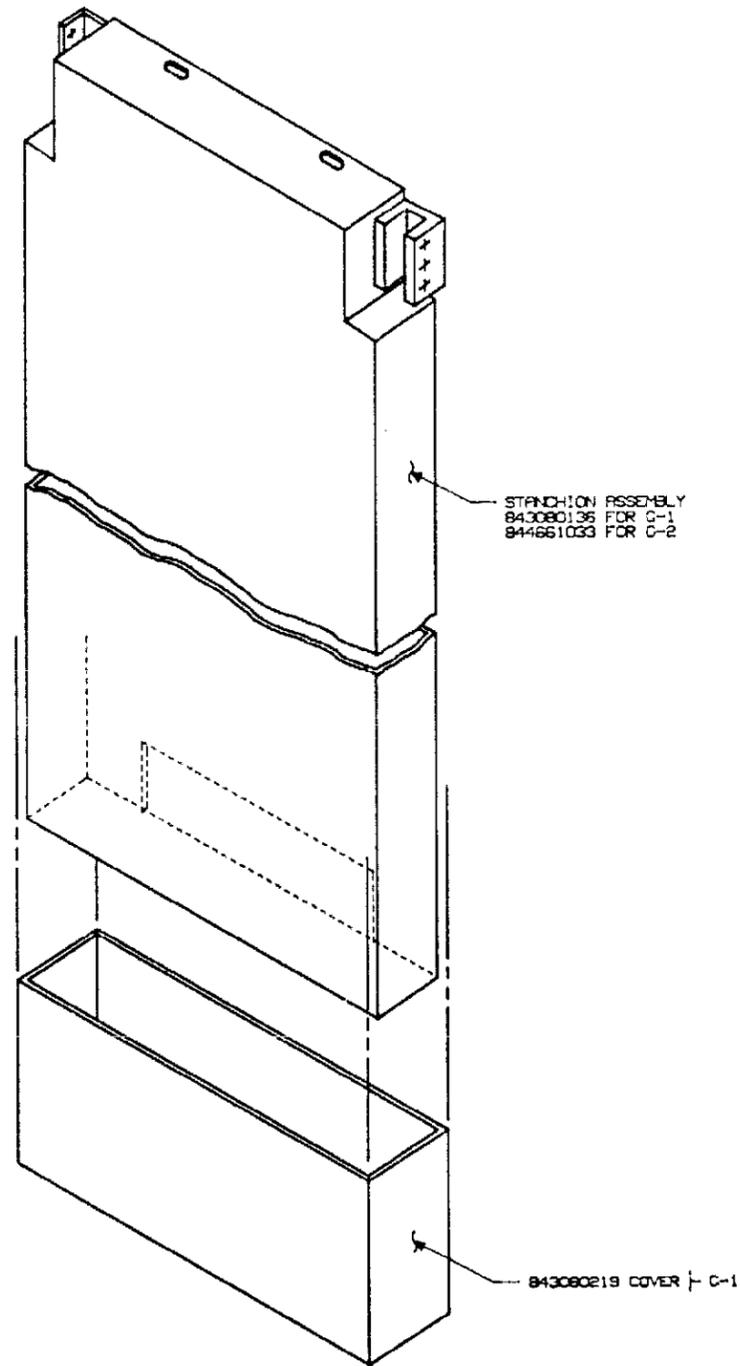


FIG. 1
GROUP 1 & 2

SHEET INDEX	ISSUE													
	SH. NO.													
	ISSUE													
	SH. NO.													
	ISSUE	4												
	SH. NO.	B1												

ED-50513-70

STANCHION ASSEMBLY		DWG. SIZE	ISSUE
		C2	4
WESTERN ELECTRIC	ED-50513-70	REV. NAME	SHEET
			B1

