

TABLE A										
A	B	C	D	E				J		
EQUIPMENT	RAT- ING	LIST OR GRP	QTY	EQUIPMENT OR CIRCUIT DATA				SD EQUIVALENT		
				EQUIPMENT OR CIRCUIT	LIST GROUP OR FIG	WRG	APP	SCHEMATIC	FIG	OPT
APPARATUS, WIRING AND ASSEMBLY FOR ONE REMOTE SWITCHING MODULE ALARM STATUS PANEL.		1	1	SD-50017-01	5					

ENGINEERING NOTES

51. INFORMATION FURNISHED PER THIS DRAWING IS IN ACCORDANCE WITH AT&T PRACTICES NONE.

52. THIS DOCUMENT CONTAINS COMPLETE ENGINEERING INFORMATION FOR THE SUBJECT EQUIPMENT. JOB INFORMATION SHALL BE RECORDED BY LIST OR GROUP.

53. THE RSM ALARM STATUS PANEL IS MOUNTED ON THE LEFT SIDE OF THE SWITCHING MODULE CONTROL CABINET.

ND050570-30IM 10/18/83
VAULTED
JRP EDH JEM
SL ITEM 1010 READ 843087115 HOUSING; ITEM 1070 QTY READ 2; ITEM 1040 REF TO NOTES 12 & 14 ADDED. ITEM 1055; NOTES 12 - 14; DETAIL AB & SK. A ADDED. FIG. 1 CHG ACCORD.
ND050570-30IM
VAULTED CHGE CL:NONE
03/29/84
DJP PEW
LIST OF ASSOCIATED DRAWING TABLE CORRECTED. TBL A, COL E READ ED-50570-30.
VAULTED CHGE CL:D
12/24/84
DJP PEW
TABLE A, SD-50017-01 FIG. 5 WAS SD-50049-01. STOCKLIST CHANGES: ITEM 1030 (P-44G500 (INSULATOR) REMOVED; ITEM 1050, QTY WAS 3; ITEMS 1053, 1140 AND 1150 ADDED. GRAPHICS CHANGED ACCORDINGLY.
VAULTED CHGE CL:AD
01/29/85
DJP EDH
SL ITEMS 1180 THRU 1200 NOTES 15 AND 53 ADDED. FIG 1 AND SECTION A-A CHGD ACCORDINGLY. ITEM 1040 RMVD.
VAULTED CHGE CL:AD
12/23/85
DSL JRK

ED-50570-30

SHEET INDEX	SH NO. A1 THRU A 1 AND D1 THRU D 1											
	SH NO.	B 1	C 1	C 2	D 1	D 2	D 3	D 4	D 5	D 6	D 7	D 8
ISSUE	5											
SH NO.	B 1											
ISSUE	5											
SH NO.	C 1	C 2										
ISSUE	5	5										
SH NO.												
ISSUE												
SH NO.												
ISSUE												
SH NO.												
ISSUE												
SH NO.												
ISSUE												

12		
11		
10		
9		
8		
7		
6		
5		
4		
3		
2		
1		
LINE	NAME	NUMBER
DRAWINGS DESIG=NOT REQUIRED BY THE INSTALLER		
TABLE D-LIST OF ASSOCIATED DRAWINGS		

AT&T-PROPRIETARY

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF AT&T AND IS NOT TO BE DISCLOSED OR USED EXCEPT IN ACCORDANCE WITH APPLICABLE CONTRACTS OR AGREEMENTS.

SESS SWITCHING EQUIPMENT SPECIFICATION FOR RSM ALARM STATUS PANEL	7113	AT&T RATING PROVISIONAL
	DWG SIZE C2	ISSUE 5
AT&T TECHNOLOGIES, INC.	ED-50570-30	SHEET 11 OF 5



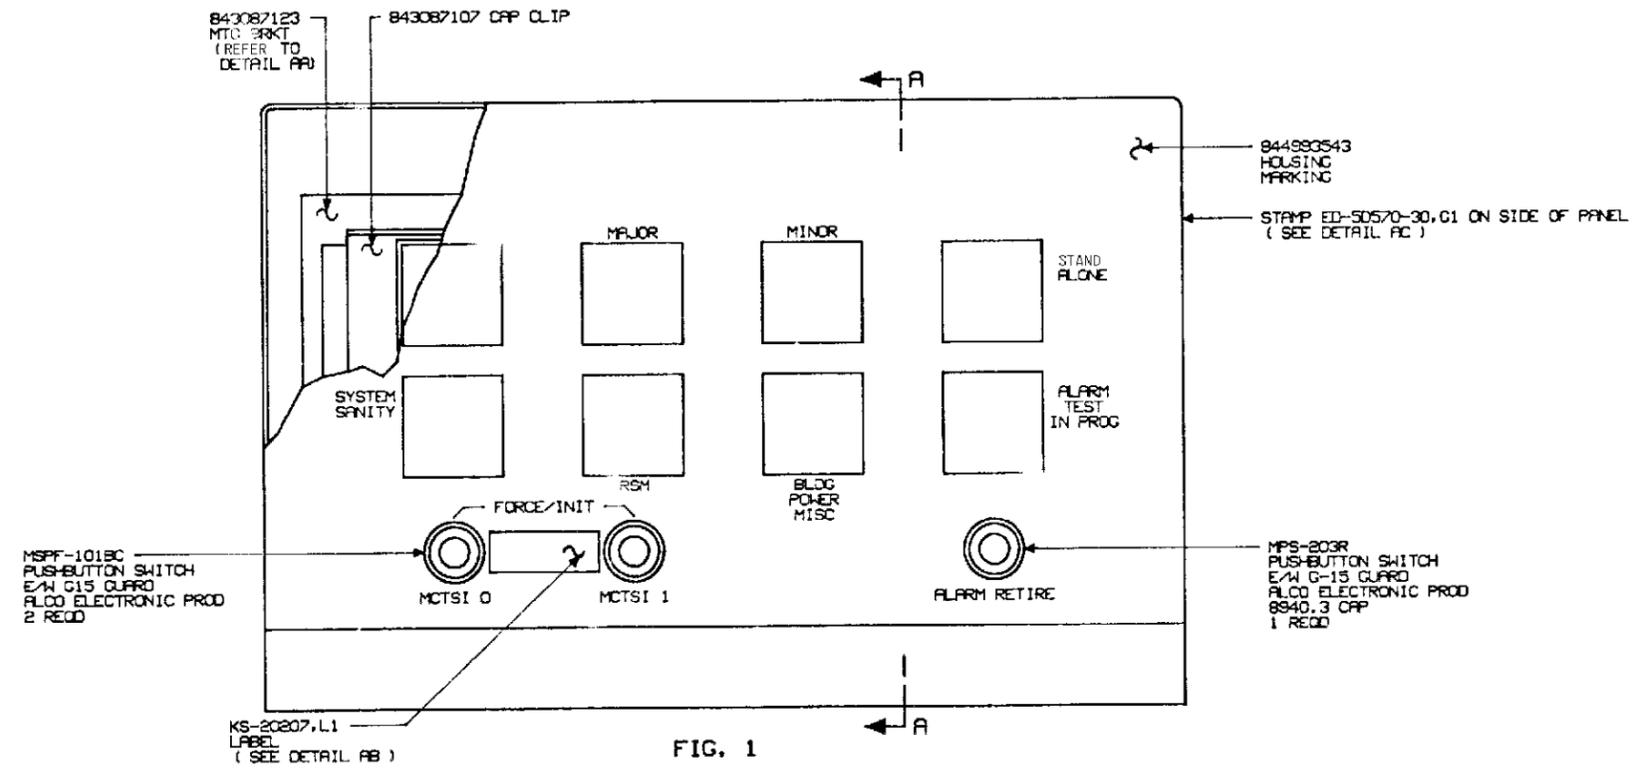


FIG. 1

SEE PROPRIETARY NOTICE ON SHEET ONE		
RSM ALARM STATUS PANEL	DWG SIZE	ISSUE
	C2	5
AT&T TECHNOLOGIES, INC.	ED-50570-30	SHEET B1

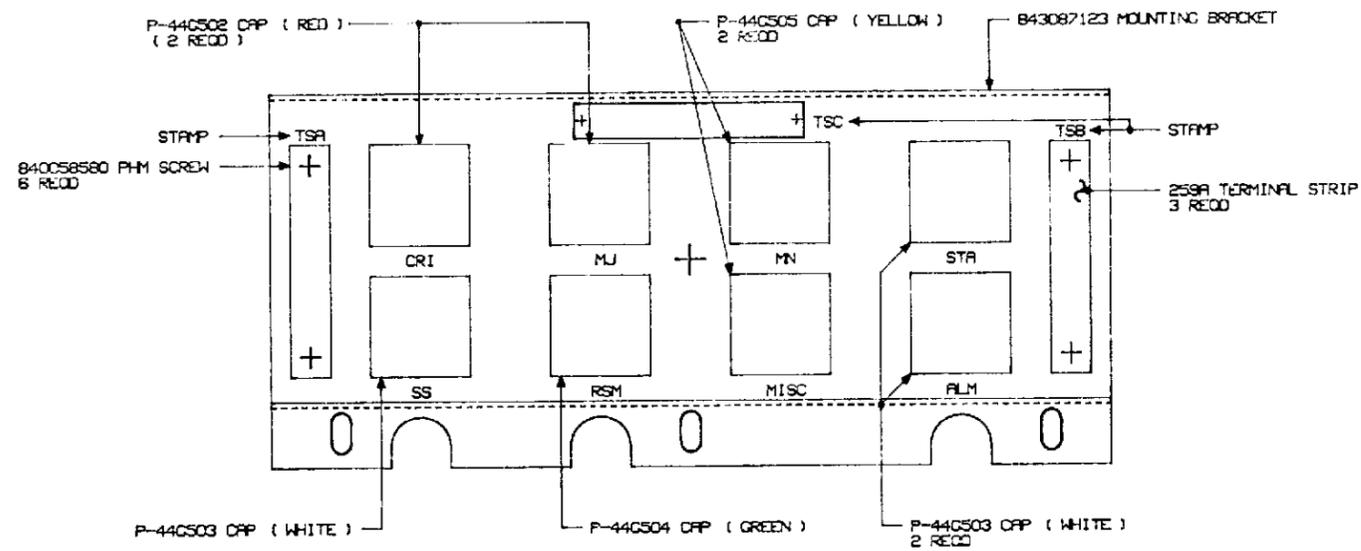


DETAIL AA




DETAIL AB
STAMP IN RED INK
APPROX AS SHOWN


SEE PROPRIETARY NOTICE ON SHEET ONE		
RSM ALARM STATUS PANEL	DWG SIZE	ISSUE
	C2	5
AT&T TECHNOLOGIES, INC.	ED-50570-30	SHEET C1

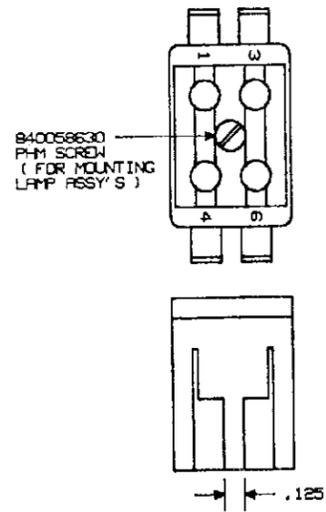

SK. A
SHOWING MODIFICATION
OF P-440501 LAMP ASSY
(SEE NOTE 12 & 14)

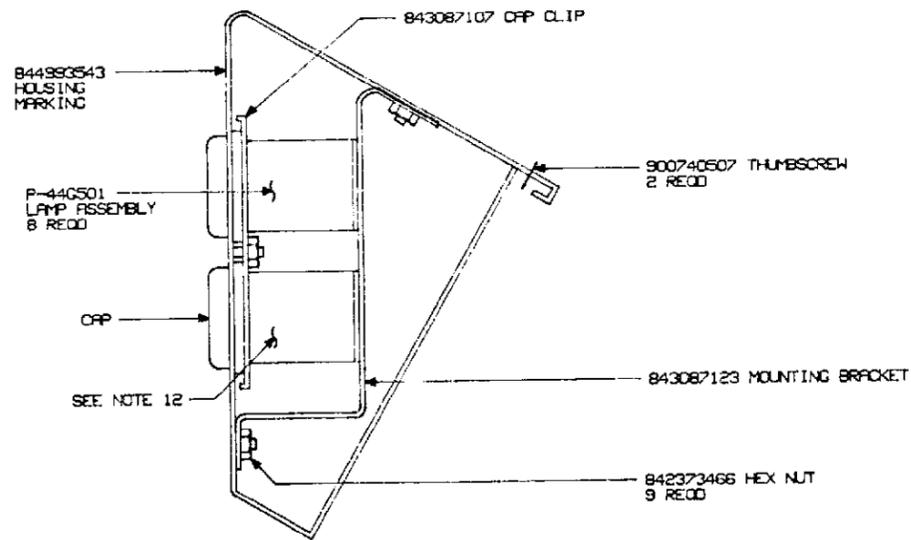

SECTION A-A

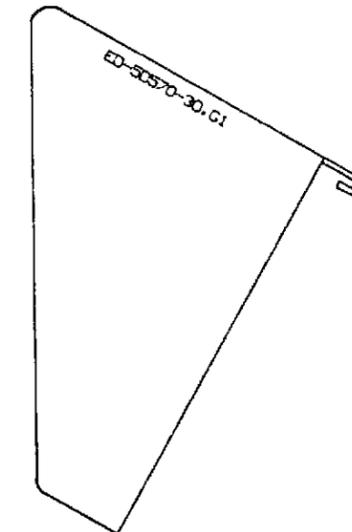

DETAIL AC
LOCATION OF UNIT IDENTIFICATION STAMPING

SEE PROPRIETARY NOTICE ON SHEET ONE		
RSM ALARM STATUS PANEL	DWG SIZE	ISSUE
	C2	5
AT&T TECHNOLOGIES, INC.	ED-50570-30	SHEET C2

STOCKLIST						
QA	QB	QC	QD	QE	QF	QGL
GROUP	QTY PER GROUP	IDENTIFICATION	CODE	DESCRIPTION	NOTE	ITEM
1	1	843087107		CLIP, CAP		1000
1	1	844993543		HOUSING MARKING		1010
1	1	843087123		BRACKET, MOUNTING		1020
1	2	4034273/0		SWITCH, PUSHBUTTON MSPF-101BC ALCO ELECTRONICS/OR EQUIV		1050
1	1	403754476		SWITCH, PUSHBUTTON #MPS-203R ALCO ELECTRONICS/OR EQUIV.		1053
1	1	403617327	KS-20207, L1	PLATE, NAME (.250 HT X 1.500 W) DET AB	13	1055
1	3	403424690		GUARD, #G-15 ALCO ELECTRONICS/OR EQUIV.		1060
1	3	100733716	259A	STRIP, TERMINAL		1070
1	1	814475042	P-44G504	CAP, (GREEN)		1080
1	3	814475034	P-44G503	CAP, (WHITE)		1090
1	2	814475059	P-44G505	CAP, (YELLOW)		1100
1	2	814475026	P-44G502	CAP, (RED)		1110
1	9	842373466		NUT, HEX .138-32		1120
1	2	900740507		THUMBSCREW .164-32 X 3/8		1130
1	6	840058580		SCREW, PHM .138-32 X 5/16		1140
1	8	840058630		SCREW, PHM .138-32 X 5/8		1150
1	1	403362544		CAP, #8940-3 SNAP-ON-RED C&K COMPONENT/OR EQUIV.		1160
1	8	814474979	P-44G497	HOUSING	14	1170
					15	
1	16	814474987	P-44G498	CONTACT, CENTER	14	1180
					15	
1	16	814474995	P-44G499	CONTACT, END	14	1190
					15	
1	32	102479227	K2	LAMP	14	1200
					15	

SHOP INST
X X

MANUFACTURING NOTES

1. PARTS REQUIRED FOR INSTALLATION.

PARTS REQUIRED FOR MANUFACTURE WHEN EQUIPMENT IS SHOP MOUNTED OR BY THE INSTALLER WHEN THE EQUIPMENT IS TO BE MOUNTED BY THE INSTALLER.

PARTS THAT ARE TO BE SHIPPED ATTACHED TO OR ENCLOSED IN THE SAME CONTAINER WITH THE ASSOCIATED ASSEMBLED ITEM.

PARTS (A) REQUIRED FOR MANUFACTURE WHEN EQUIPMENT INVOLVED IS SHOP MOUNTED OR (B) TO BE SHIPPED ATTACHED TO, OR ENCLOSED IN THE SAME CONTAINER WITH THE ASSOCIATED ASSEMBLED ITEM WHEN FIELD MOUNTED.

() INDICATES DESIGNATIONS TO BE STAMPED IN ACCORDANCE WITH JOB INFORMATION.

[] INDICATES DESIGNATIONS SHOWN FOR INFORMATION ONLY AND ARE NOT TO BE STAMPED.

< > INDICATES DESIGNATIONS PROVIDED IN ACCORDANCE WITH OTHER INFORMATION.

"W" PARTS ASSEMBLED AT THE SAME TIME THE EQUIPMENT IS MOUNTED.

"W*" PARTS TO BE (A) SHOP ASSEMBLED, BUT WHICH CANNOT BE ASSEMBLED UNTIL THE ASSOCIATED EQUIPMENT IS BEING MOUNTED, OR (B) SHIPPED ATTACHED TO, OR ENCLOSED IN THE SAME CONTAINER WITH THE ASSOCIATED EQUIPMENT WHEN FIELD MOUNTED.

"S" PARTS NOT ASSEMBLED, SHIPPED SEPARATELY.

A/R = AS REQUIRED.

NOTES 2 THRU 11 RESERVED.

X 12. FOUR OF THE LAMP ASSEMBLIES MUST BE MODIFIED TO PROVIDE A DUAL BUS (0,1) ARRANGEMENT. SEE SK A.

X 13. STAMP IN ACCORDANCE WITH DETAIL AB. THIS IS ONLY A TEMPORARY LABEL.

X 14. TO MODIFY LAMP ASSEMBLIES, REMOVE PINS 2 & 3 AND ISOLATE PINS 1 & 4 FROM PINS 3 & 6, AS SHOWN IN SK A.

X 15. COMPONENTS REQUIRED TO ASSEMBLE P-44G501 LAMP ASSEMBLIES.

SEE PROPRIETARY NOTICE ON SHEET ONE

RSM ALARM STATUS PANEL	
DWG SIZE C2	ISSUE 5
AT&T TECHNOLOGIES, INC. ED-5D570-30	
SHEET 1 OF 1	