ISSUE	
1	2
5-49	

DATE	
4-49	

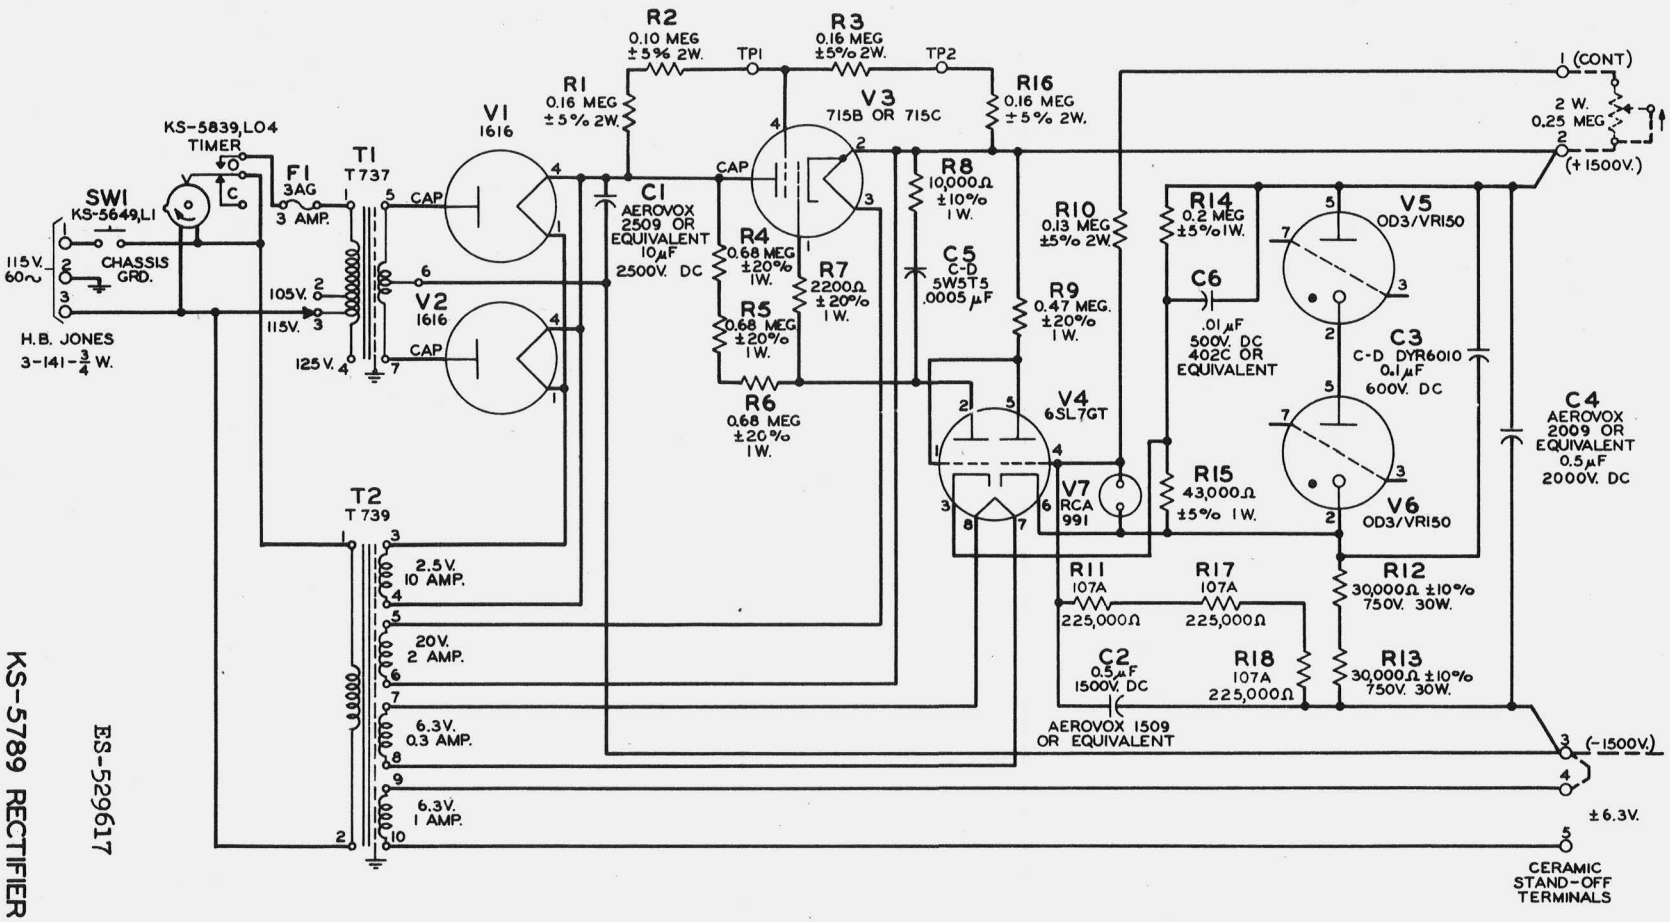

NOTES:
1. ALL WIRING SHALL BE 16 GAUGE SOLID TINNED COPPER WIRE SLEEVED WITH IRVINGTON VARNISH CO. NO. 16 "TRANSFLEX" TUBING, EXCEPT INPUT 115V. AC LEADS WHICH SHALL BE 20 GAUGE KS-13385.

ES-529617

KS-5789 RECTIFIER UNIT

ELECTRON TUBE TYPE-AUTOMATIC REGULATION

BELL TELEPHONE LABORATORIES, INC.

PRINTED IN U.S.A.