

TABLE A-FEATURES												
EQUIPMENT		RAT- ING	LIST OR GROUP	EQUIPMENT OR CIRCUIT DATA					SD EQUIVALENT			
DESCRIPTION	REF NOTE			QTY	EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT	
FRAMEWORK, ASSEMBLY AND EQUIPMENT FOR ONE MODEM POOLING CABINET FOR DOMESTIC 5ESS SWITCH APPLICATIONS ARRANGED FOR UP TO FOUR DATA MOUNTINGS AND EQUIPPED FOR COMMERCIAL AC INPUT ONLY. DA EFF:07/29/93 FE:J5D007B-1,L1A		DA	1	1				SD5D098-01	FS1 FS2	V V		
FRAMEWORK, ASSEMBLY AND EQUIPMENT FOR ONE MODEM POOLING CABINET FOR DOMESTIC 5ESS SWITCH APPLICATIONS ARRANGED FOR UP TO FOUR DATA MOUNTINGS AND EQUIPPED FOR COMMERCIAL AC INPUT ONLY. EQUIPPED IN THE 5ESS CLASSIC CABINET. REPL:J5D007B-1,L1 DA EFF:06/30/95 FE/RA:NONE		DA	1A	1	J5D007B-1	7,8		SD5D098-01	FS1 FS2	U U		
EQUIPMENT REQUIRED IN ADDITION TO LIST 1,1A,30,37 OR 39 PROVIDES DC TO AC INVERTER CONFIGURED FOR CONTINUOUS DUTY. (MAX. ONE PER LIST 1,1A,30,37 OR 39). DA EFF:04/12/94 FE:J5D007B-1,L2A	56	DA	2	1				SD5D098-01	FS3			
EQUIPMENT REQUIRED IN ADDITION TO LIST 1,1A,30,37,39,40 OR 41 TO PROVIDE ONE 1KVA DC TO AC INVERTER CONFIGURED FOR CONTINUOUS DUTY. PROVIDES OVER VOLTAGE PROTECTION. (MAX. ONE PER LIST 1,1A,30,37,39,40 OR 41). REPL:J5D007B-1,L2 DA EFF:06/30/95 FE/RA:NONE	56	DA	2A	1				SD5D098-01	FS3			
EQUIPMENT REQUIRED IN ADDITION TO LIST 1,1A,30,37 OR 39. PROVIDES DC TO AC INVERTER CONFIGURED WITH A TRANSFER SWITCH FOR BACK-UP OF COMMERCIAL AC POWER. (MAX. ONE PER LIST 1,1A,30,37 OR 39). DA EFF:04/12/94 FE:J5D007B-1,L3A	57	DA	3	1				SD5D098-01	FS3			
EQUIPMENT REQUIRED IN ADDITION TO LIST 1,1A,30,37,39,40 OR 41 TO PROVIDE ONE 1KVA DC TO AC INVERTER CONFIGURED WITH A TRANSFER SWITCH FOR BACK-UP OF COMMERCIAL AC POWER. PROVIDES OVER VOLTAGE PROTECTION. (MAX. ONE PER LIST 1,1A,30,37,39,40 OR 41). REPL:J5D007B-1,L3 DA EFF:06/30/95 FE/RA:NONE	57	DA	3A	1				SD5D098-01	FS3			
EQUIPMENT REQUIRED IN ADDITION TO LIST 1,1A,30,37 OR 39. PROVIDES ONE 77A DATA MOUNTING ARRANGED FOR UP TO 8 7500A,L1 UNIVERSAL DATA MOUNTINGS (UDM). (MAX 4 PER LIST 1,1A,30,37 OR 39). DA EFF:06/30/95 FE/RA:NONE	54 58	DA	4	1				SD5D098-01	FS4			
EQUIPMENT REQUIRED IN ADDITION TO LIST 4 OR 46 TO PROVIDE 1 7500A,L1 UDM (MAX 8 PER LIST 4 OR 46). DA EFF:06/30/95 FE/RA:NONE		DA	5	1				SD5D098-01	FS4			
EQUIPMENT REQUIRED IN ADDITION TO LIST 1 TO PROVIDE ONE 106A3 DATA MOUNTING ARRANGED FOR UP TO 8 2224G MODEMS (MAX 2 PER LIST 1) (SEE NOTE 54). DA EFF:07/29/93 FE/RA:NONE		DA	6	1				SD5D098-01	FS4			

TABLE-A CONTINUED

TABLE A-FEATURES (CONTINUED)												
EQUIPMENT		RAT- ING	LIST OR GROUP	EQUIPMENT OR CIRCUIT DATA					SD EQUIVALENT			
DESCRIPTION	REF NOTE			QTY	EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT	
EQUIPMENT REQUIRED IN ADDITION TO LIST 6 TO PROVIDE 1 2224G MODEM WITH AUTODIAL CAPABILITY. (MAX 8 PER LIST 6). DA EFF:07/29/93 FE/RA:NONE		DA	7	1				SD5D098-01	FS4			
EQUIPMENT REQUIRED IN ADDITION TO LIST 6 TO PROVIDE A SHELF DIAGNOSTIC UNIT FOR A 106A3 MOUNTING (1 PER LIST 6). DA EFF:07/29/93 FE/RA:NONE		DA	8	1								
EQUIPMENT REQUIRED IN ADDITION TO LIST 1 TO PROVIDE A SET OF TTY JACKS. (MAX 1 PER LIST 1). DA EFF:07/29/93 FE:J5D007B-1,L1A		DA	9	1								
EQUIPMENT REQUIRED IN ADDITION TO LIST 1 TO PROVIDE 1 105A DATA MOUNTING ARRANGED FOR UP TO 8 2296A,L1,2,3 MODEMS. (MAX 1 PER LIST 1) DA EFF:07/29/93 FE:J5D007B-1,L12		DA	10	1								
EQUIPMENT REQUIRED IN ADDITION TO LIST 10 TO PROVIDE 1 2296A,L1,2,3 MODEM. (MAX 8 PER LIST 10). DA EFF:07/29/93 FE/RA:NONE		DA	11	1								
EQUIPMENT REQUIRED IN ADDITION TO LIST 1A,30,37 OR 39. PROVIDES ONE HD MICROCOM SYSTEM (HDMS) DATA MOUNTING ARRANGED FOR UP TO 16 HD2400C MODEMS. (MAX. 1 LIST 12). REPL:NONE DA EFF:06/30/95 FE/RA:NONE	59	DA	12	1				SD5D098-01	FS4			
EQUIPMENT REQUIRED IN ADDITION TO LIST 12 OR 47. PROVIDES ONE HD2400C MODEM. (MAX. 16 LIST 13'S PER LIST 12 OR 47). REPL:NONE DA EFF:06/30/95 FE/RA:NONE		DA	13									
FRAMEWORK, ASSEMBLY AND EQUIPMENT FOR ONE MODEM POOLING CABINET FOR DOMESTIC 5ESS SWITCH APPLICATIONS ARRANGED FOR UP TO FOUR DATA MOUNTINGS AND EQUIPPED FOR COMMERCIAL AC INPUT ONLY. EQUIPPED IN THE 5ESS-2000 CABINET. DA EFF:03/22/94 FE:J5D007B-1,L39		DA	30	1	J5D007B-1		8	SD5D098-01	FS1 FS2	U U		
EQUIPMENT REQUIRED IN ADDITION TO LIST 30,37 OR 39. PROVIDES ONE MODULAR FUSE/FILTER UNIT. DA EFF:06/30/95 FE:J5D007B-1,L48		DA	31	1	J5D003FJ-1		107					

TABLE-A CONTINUED

COPYRIGHT © 1995 AT&T
ALL RIGHTS RESERVED

BT13

5ESS* SWITCHING EQUIPMENT
SPECIFICATION FOR
MODEM POOLING CABINET
* AT&T TRADEMARKDWG SIZE
C2ISSUE
10

AT&T

J5D007B-1

SHEET A2
OF 28

PRINTED IN U.S.A.

J5D007B-1

TABLE A-FEATURES (CONTINUED)												
EQUIPMENT		RAT- ING	LIST OR GROUP	QTY	EQUIPMENT OR CIRCUIT DATA				SD EQUIVALENT			
DESCRIPTION	REF NOTE				EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT	
EQUIPMENT REQUIRED IN ADDITION TO LIST 30,37 OR 39. PROVIDES ONE FAN UNIT. DA EFF:06/30/95 FE:J5D007B-1,L49		DA	32	1	J5D003BE-2	4A						
EQUIPMENT REQUIRED IN ADDITION TO LIST 30,37 OR 39. PROVIDES CABINET INDICATOR STRIPS WITH INDICATORS ON THE FRONT STRIP ONLY. DA EFF:06/30/95 FE:J5D007B-1,L45		DA	33	1	ED5D745-70	1,2, 3A						
EQUIPMENT REQUIRED IN ADDITION TO LIST 30,37 OR 39. PROVIDES CABINET INDICATOR STRIPS WITH INDICATORS ON THE FRONT AND REAR STRIPS. DA EFF:06/30/95 FE:J5D007B-1,L43		DA	34	2	ED5D745-70	1,3A						
EQUIPMENT REQUIRED IN ADDITION TO LIST 30 OR 39. PROVIDES DOOR ASSEMBLIES REQUIRED FOR USE IN EMC TREATMENT COMPATIBLE APPLICATIONS. DA EFF:06/30/95 FE/RA:NONE		DA	35	2	ED5D741-70	2						
REQUIRED IN ADDITION TO LIST 30,37,39,40 OR 41 PROVIDES CABINET ADDRESS LABELS. REPL:NONE DA EFF:06/30/95 FE/RA:NONE	62	DA	36									
FRAMEWORK, ASSEMBLY AND EQUIPMENT FOR ONE MODEM POOLING CABINET FOR DOMESTIC 5ESS SWITCH APPLICATIONS ARRANGED FOR UP TO FOUR DATA MOUNTINGS AND EQUIPPED FOR COMMERCIAL AC INPUT ONLY. EQUIPPED IN THE 5ESS-2000 CABINET REQUIRED FOR USE IN NON-EMC TREATMENT COMPATIBLE APPLICATIONS. DA EFF:06/30/95 FE:J5D007B-1,L40		DA	37	1	J5D007B-1 ED5D741-70	FIG8 1A			SD5D098-01	FS1 FS1A FS2	U U	
EQUIPMENT REQUIRED IN ADDITION TO LIST 37. PROVIDES DOOR ASSEMBLIES REQUIRED FOR USE IN NON-EMC TREATMENT COMPATIBLE APPLICATIONS. DA EFF:06/30/95 FE/RA:NONE		DA	38	2	ED5D741-70	2A						
FRAMEWORK, ASSEMBLY AND EQUIPMENT FOR ONE MODEM POOLING CABINET FOR DOMESTIC 5ESS SWITCH APPLICATIONS ARRANGED FOR UP TO FOUR DATA MOUNTINGS AND EQUIPPED FOR COMMERCIAL AC INPUT ONLY. EQUIPPED IN THE 5ESS-2000 CABINET REQUIRED FOR USE IN EMC TREATMENT COMPATIBLE APPLICATIONS. DA EFF:06/30/95 FE:J5D007B-1,L41		DA	39	1	J5D007B-1 ED5D741-70	FIG8 1B			SD5D098-01	FS1 FS1A FS2	U U	
EQUIPMENT REQUIRED FOR ONE MODEM POOLING CABINET, EQUIPPED IN THE 5ESS-2000 CABINET FOR DOMESTIC 5ESS SWITCH APPLICATIONS ARRANGED FOR UP TO FOUR DATA MOUNTINGS AND EQUIPPED FOR COMMERCIAL AC INPUT ONLY. FOR USE IN NON-EMC TREATMENT COMPATIBLE APPLICATIONS. REPL:J5D007B-1 L37 DA EFF:06/30/95 FE/RA:NONE		DA	40	1	ED5D785-70	1A, 2A						

TABLE-A CONTINUED

TABLE A-FEATURES (CONTINUED)												
EQUIPMENT		RAT- ING	LIST OR GROUP	QTY	EQUIPMENT OR CIRCUIT DATA				SD EQUIVALENT			
DESCRIPTION	REF NOTE				EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT	
EQUIPMENT REQUIRED FOR ONE MODEM POOLING CABINET, EQUIPPED IN THE 5ESS-2000 CABINET FOR DOMESTIC 5ESS SWITCH APPLICATIONS ARRANGED FOR UP TO FOUR DATA MOUNTINGS AND EQUIPPED FOR COMMERCIAL AC INPUT ONLY. FOR USE IN EMC TREATMENT COMPATIBLE APPLICATIONS. REPL:J5D007B-1 L39 DA EFF:06/30/95 FE/RA:NONE		DA	41	1	ED5D785-70	1A, 2B, 4						
EQUIPMENT REQUIRED IN ADDITION TO LIST 40. PROVIDES INDICATOR STRIP KIT WHERE FAN AND FUSE INDICATORS ARE REQUIRED ON FRONT AND REAR. FOR USE IN NON-EMC TREATMENT COMPATIBLE APPLICATIONS. REPL:NONE DA EFF:06/30/95 FE/RA:NONE		DA	42	2	ED5D785-70	3A						
EQUIPMENT REQUIRED IN ADDITION TO LIST 41. PROVIDES INDICATOR STRIP KIT WHERE FAN AND FUSE INDICATORS ARE REQUIRED ON FRONT AND REAR. FOR USE IN EMC TREATMENT COMPATIBLE APPLICATIONS. REPL:J5D007B-1 L34 DA EFF:06/30/95 FE/RA:NONE		DA	43	2	ED5D785-70	3B						
EQUIPMENT REQUIRED IN ADDITION TO LIST 40. PROVIDES INDICATOR STRIP KIT WHERE FAN AND FUSE INDICATORS ARE REQUIRED ON FRONT ONLY. FOR USE IN NON-EMC TREATMENT COMPATIBLE APPLICATIONS. REPL:NONE DA EFF:06/30/95 FE/RA:NONE		DA	44	1	ED5D785-70	3A, 3C						
EQUIPMENT REQUIRED IN ADDITION TO LIST 41. PROVIDES INDICATOR STRIP KIT WHERE FAN AND FUSE INDICATORS ARE REQUIRED ON FRONT ONLY. FOR USE IN EMC TREATMENT COMPATIBLE APPLICATIONS. REPL:J5D007B-1 L33 DA EFF:06/30/95 FE/RA:NONE		DA	45	1	ED5D785-70	3B, 3D						
EQUIPMENT REQUIRED IN ADDITION TO LIST 40 OR 41. PROVIDES ONE 77A DATA MOUNTING ARRANGED FOR UP TO 8 7500A,L1 UNIVERSAL DATA MOUNTINGS (UDM). (MAX. 4 PER LIST 40 OR 41). REPL:NONE DA EFF:06/30/95 FE/RA:NONE	54 58	DA	46	1					SD5D098-01	FS4		

TABLE-A CONTINUED

COPYRIGHT © 1995 AT&T
ALL RIGHTS RESERVED

BT13

5ESS* SWITCHING EQUIPMENT
SPECIFICATION FOR
MODEM POOLING CABINET
* AT&T TRADEMARK

DWG SIZE
C2

ISSUE
10

AT&T

J5D007B-1

SHEET A3
OF 28

PRINTED IN U.S.A.

J5D007B-1

TABLE A-FEATURES (CONTINUED)											
EQUIPMENT		RAT- ING	LIST OR GROUP	EQUIPMENT OR CIRCUIT DATA					SD EQUIVALENT		
DESCRIPTION	REF NOTE			QTY	EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT
EQUIPMENT REQUIRED IN ADDITION TO LIST 40 OR 41. PROVIDES ONE HD MICROCOM SYSTEM (HDMS) DATA MOUNTING ARRANGED FOR UP TO 16 HD2400C MODEMS. (MAX. 1 LIST 47) REPL:NONE DA EFF:06/30/95 FE/RA:NONE	59	DA	47	1				SD5D098-01	FS4		
EQUIPMENT REQUIRED IN ADDITION TO LIST 40 OR 41. PROVIDES ONE MODULAR FUSE/FILTER UNIT. REPL:J5D007B-1 L31 DA EFF:06/30/95 FE/RA:NONE		DA	48	1	J5D003FJ-1	107 CH CK					
EQUIPMENT REQUIRED IN ADDITION TO LIST 40 OR 41. PROVIDES ONE FAN UNIT. REPL:J5D007B-1 L32 DA EFF:06/30/95 FE/RA:NONE		DA	49	1	J5D003BE-2	4A					
CABLING REQUIRED IN ADDITION TO THE 2ND THRU 5TH LIST 1,1A,30,37,39,40 OR 41 EACH MODEM POOLING GROUP. (ONE PER LIST 1,1A,30,37,39,40 OR 41). DA EFF:06/30/95 FE/RA:NONE		DA	A	1	ED5D621-20	18					
EQUIPMENT REQUIRED IN ADDITION TO LIST 1 OR 1A. PROVIDES DOOR ASSEMBLIES. DA EFF:06/30/95 FE/RA:NONE		DA	B	1	ED5D184-76	1					
EQUIPMENT REQUIRED IN ADDITION TO LISTS 1 OR 1A FOR OFFICES SUBJECT TO EMC REQUIREMENTS. PROVIDES DOORS AND GASKETS. REPL:NONE DA EFF:06/30/95 FE/RA:NONE		DA	C	1	ED5D184-76	2					
EQUIPMENT REQUIRED IN ADDITION TO LIST 31 OR 48 WHEN THE MODULAR FUSE/FILTER UNIT MOUNTS IN THE CLASSIC OR 5ESS-2000 CABINET. DA EFF:06/30/95 FE/RA:NONE		DA	D	1	J5D003FJ-1	CH					
EQUIPMENT REQUIRED IN ADDITION TO LIST D WHEN THE MODULAR FUSE FILTER MOUNTS IN THE 5ESS-2000 CABINET. DA EFF:06/30/95 FE/RA:NONE		DA	E	1	J5D003FJ-1	CK					
EQUIPMENT REQUIRED TO PROVIDE JUNCTIONING HARDWARE FOR ONE ADDITIONAL MODEM POOLING CABINET EQUIPPED IN THE 5ESS-2000 CABINET IN NON-EMC APPLICATIONS. (FOR UNINITIALIZED SHIPMENT) REPL:NONE DA EFF:06/30/95 FE/RA:NONE	16 17	DA	F	1	J5D007B-1	FIG. 6					
EQUIPMENT REQUIRED TO PROVIDE JUNCTIONING HARDWARE FOR ONE ADDITIONAL MODEM POOLING CABINET EQUIPPED IN THE 5ESS-2000 CABINET WHEN NON-INITIALIZED SHIPMENT IS REQUIRED IN NON-EMC APPLICATIONS. REPL:NONE DA EFF:06/30/95 FE/RA:NONE	15 16 17	DA	G	1	J5D007B-1	FIG. 6					
EQUIPMENT REQUIRED TO PROVIDE JUNCTIONING HARDWARE FOR ONE ADDITIONAL MODEM POOLING CABINET EQUIPPED IN THE 5ESS-2000 CABINET IN EMC APPLICATIONS. (FOR UNINITIALIZED SHIPMENT) REPL:NONE DA EFF:06/30/95 FE/RA:NONE	16 17	DA	H	1	J5D007B-1	FIG. 6					

TABLE-A CONTINUED

TABLE A-FEATURES (CONTINUED)											
EQUIPMENT		RAT- ING	LIST OR GROUP	EQUIPMENT OR CIRCUIT DATA					SD EQUIVALENT		
DESCRIPTION	REF NOTE			QTY	EQUIPMENT OR CIRCUIT	L/G OR FIG	WRG	APP	SCHEMATIC	FIG	OPT
EQUIPMENT REQUIRED TO PROVIDE JUNCTIONING HARDWARE FOR ONE ADDITIONAL MODEM POOLING CABINET EQUIPPED IN THE 5ESS-2000 CABINET WHEN NON-INITIALIZED SHIPMENT IS REQUIRED IN EMC APPLICATIONS. REPL:NONE DA EFF:06/30/95 FE/RA:NONE	15 16 17	DA	J	1	J5D007B-1	FIG. 6					
EQUIPMENT REQUIRED IN ADDITION TO LIST 48 OR E WHEN CABINET IS DESTINED FOR U.S., U.S. COMMONWEALTH OR CANADIAN MARKETS (EXCEPT QUEBEC). (PROVIDES U.L. LABEL) REPL:NONE DA EFF:06/30/95 FE/RA:NONE		DA	K	1	J5D003FJ-1	CP					
EQUIPMENT ALWAYS REQUIRED IN ADDITION TO LIST 48 OR E. (PROVIDES MULTIPLE DC POWER SOURCE LABEL). REPL:NONE DA EFF:06/30/95 FE/RA:NONE		DA	L	1	J5D003FJ-1	CR					

END OF TABLE-A

COPYRIGHT © 1995 AT&T
ALL RIGHTS RESERVED

BT13

5ESS* SWITCHING EQUIPMENT
SPECIFICATION FOR
MODEM POOLING CABINET
* AT&T TRADEMARK

DWG SIZE
C2

ISSUE
10

AT&T

J5D007B-1

SHEET A4
OF 28

PRINTED IN U.S.A.

J5D007B-1

CONVERSION TABLE	
INCH	MM
14.50	368.30
30.50	774.70
38.50	977.90
47.50	1206.50
57.50	1460.50


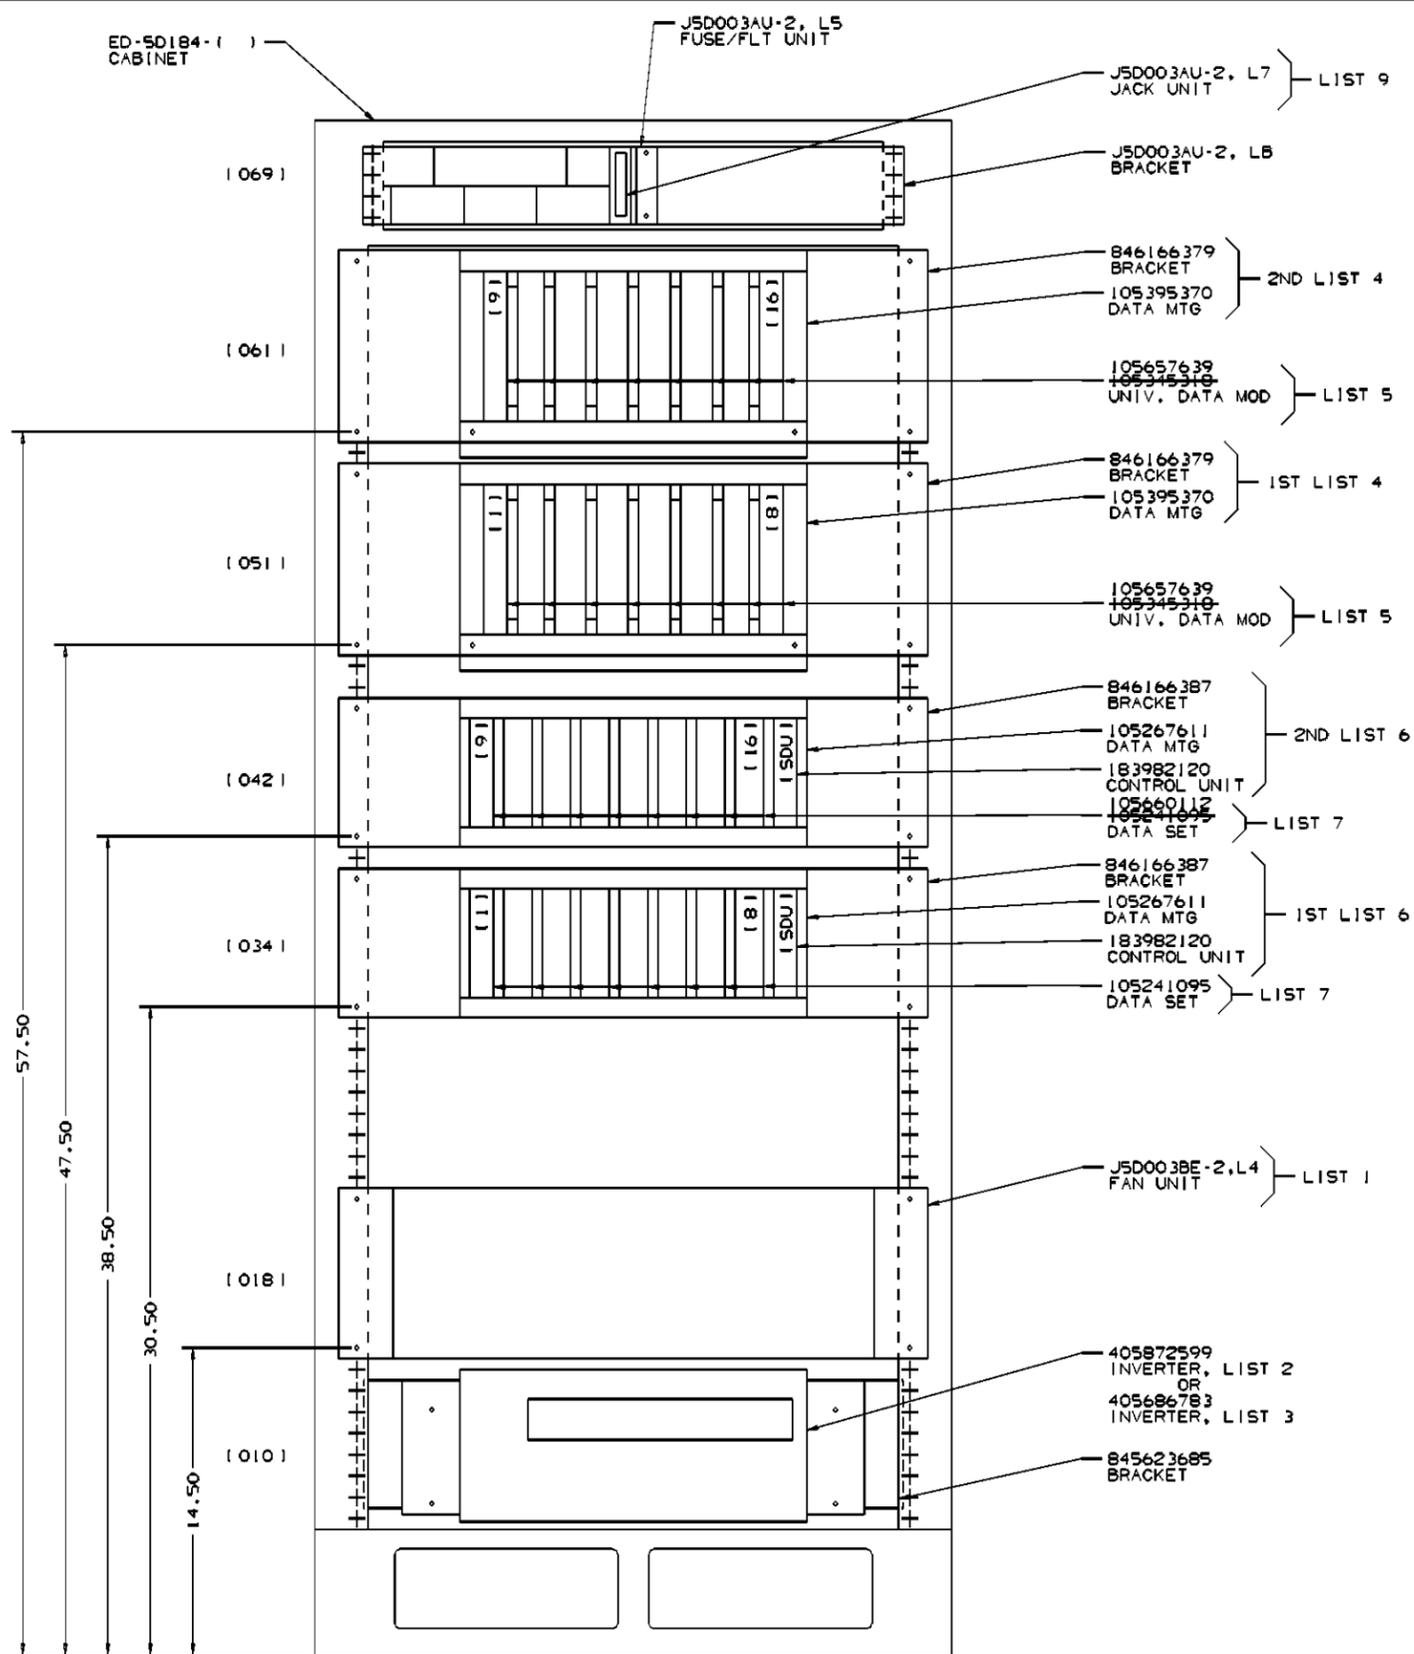


FIG. 1 (DA)
FRONT VIEW
TYPICAL ARRANGEMENT

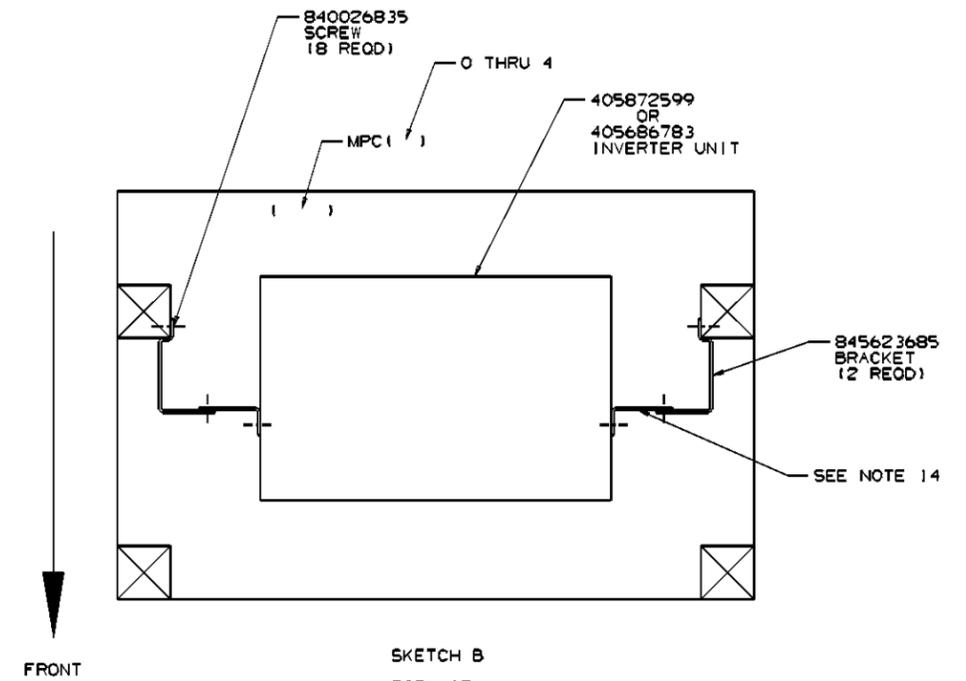

SKETCH B
TOP VIEW
METHOD OF MOUNTING
INVERTER UNIT

J5D007B-1

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	2
AT&T	J5D007B-1	SHEET B1

CONVERSION TABLE	
INCH	MM
22.50	571.50
30.00	762.00
34.50	876.30
38.00	965.20
43.50	1104.90
47.00	1193.80
54.50	1384.30
57.00	1447.80
63.50	1612.90
65.50	1663.70

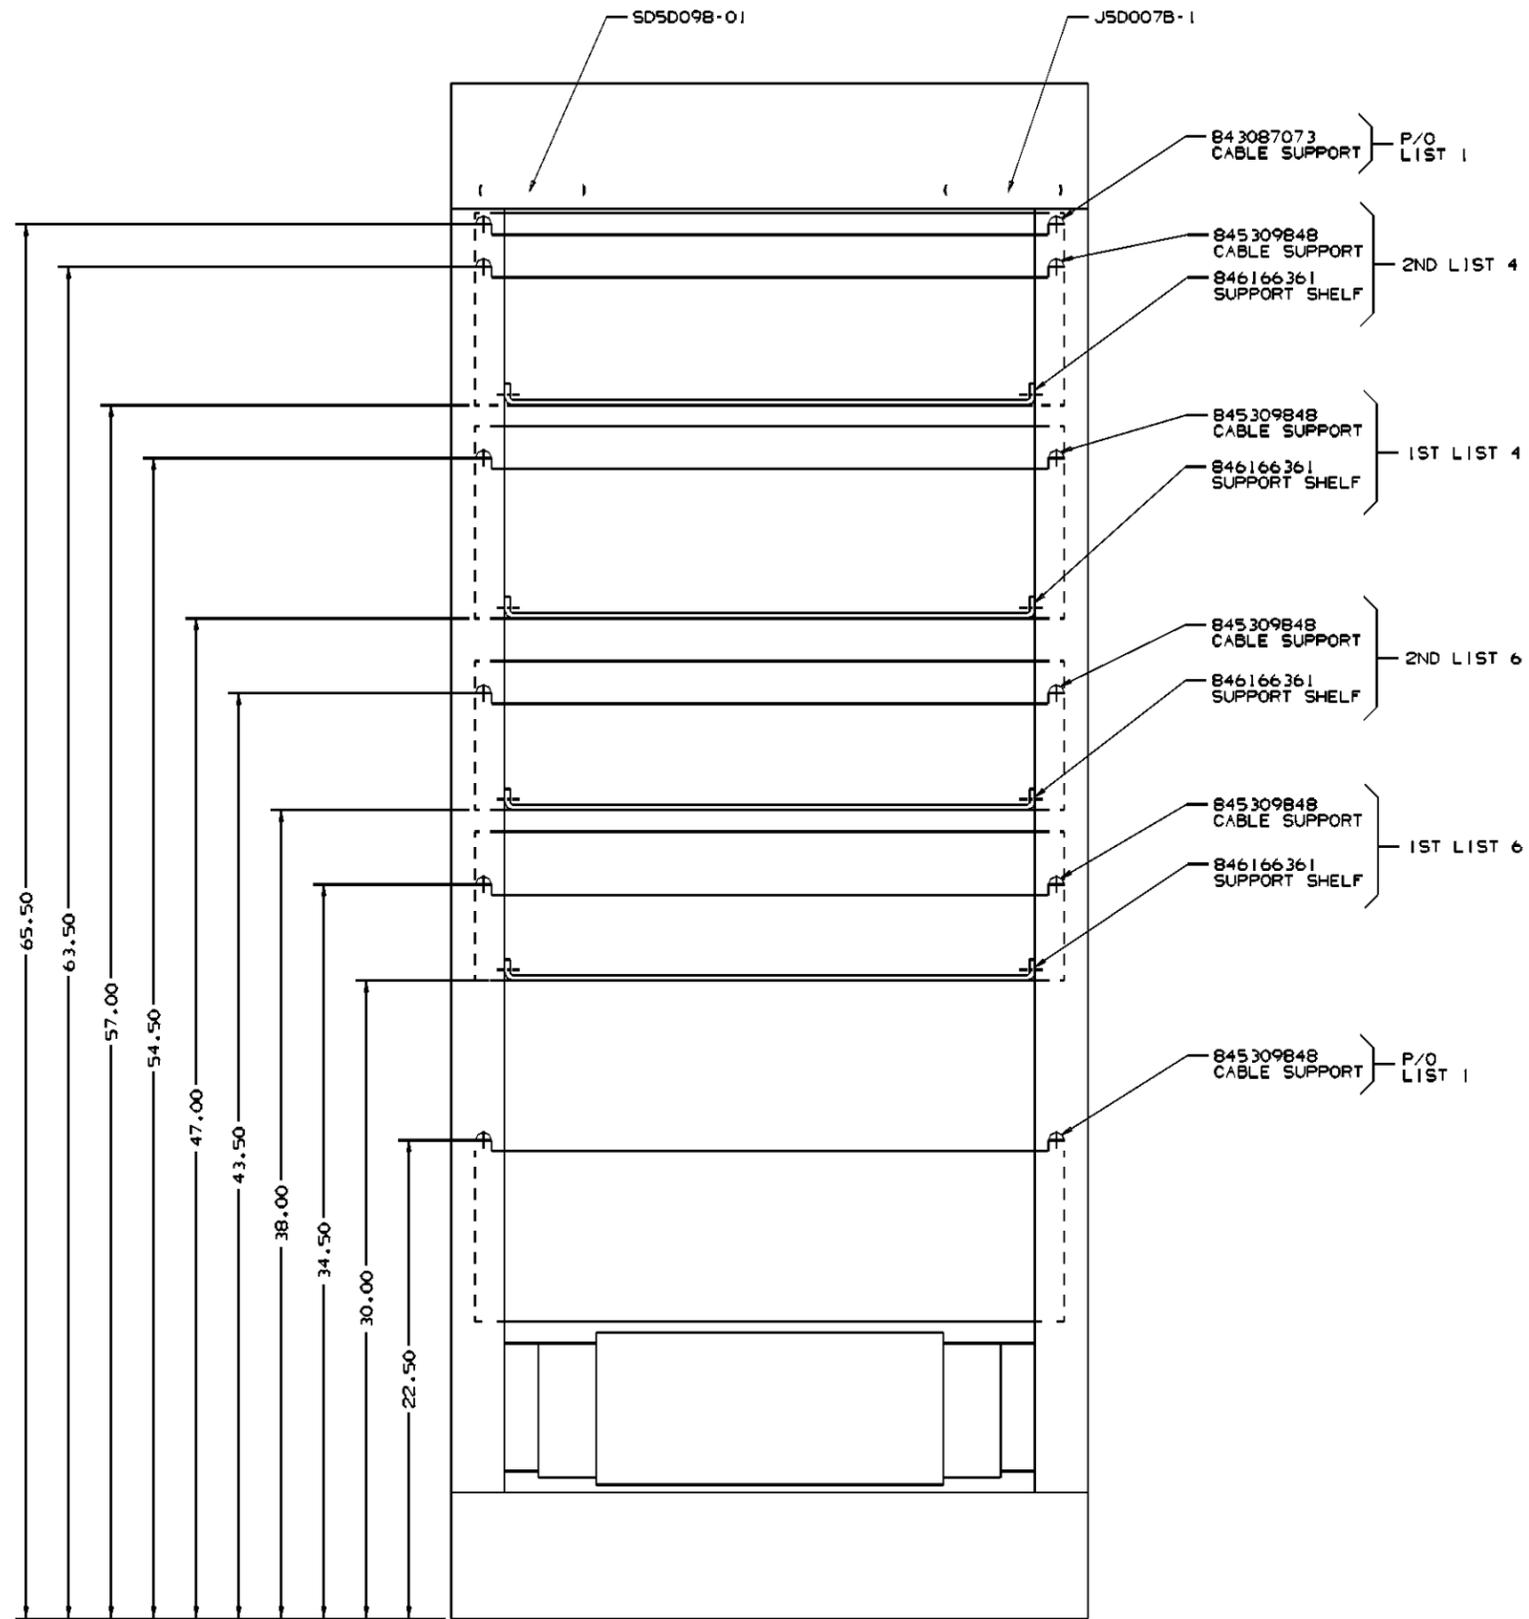


FIG. 1 (DA)
REAR VIEW

J5D007B-1

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	3
AT&T	J5D007B-1 <small>PRINTED IN U.S.A.</small>	SHEET B2

CONVERSION TABLE	
INCH	MM
14.50	368.30
30.50	774.70
38.50	977.90
47.50	1206.50
57.50	1460.50

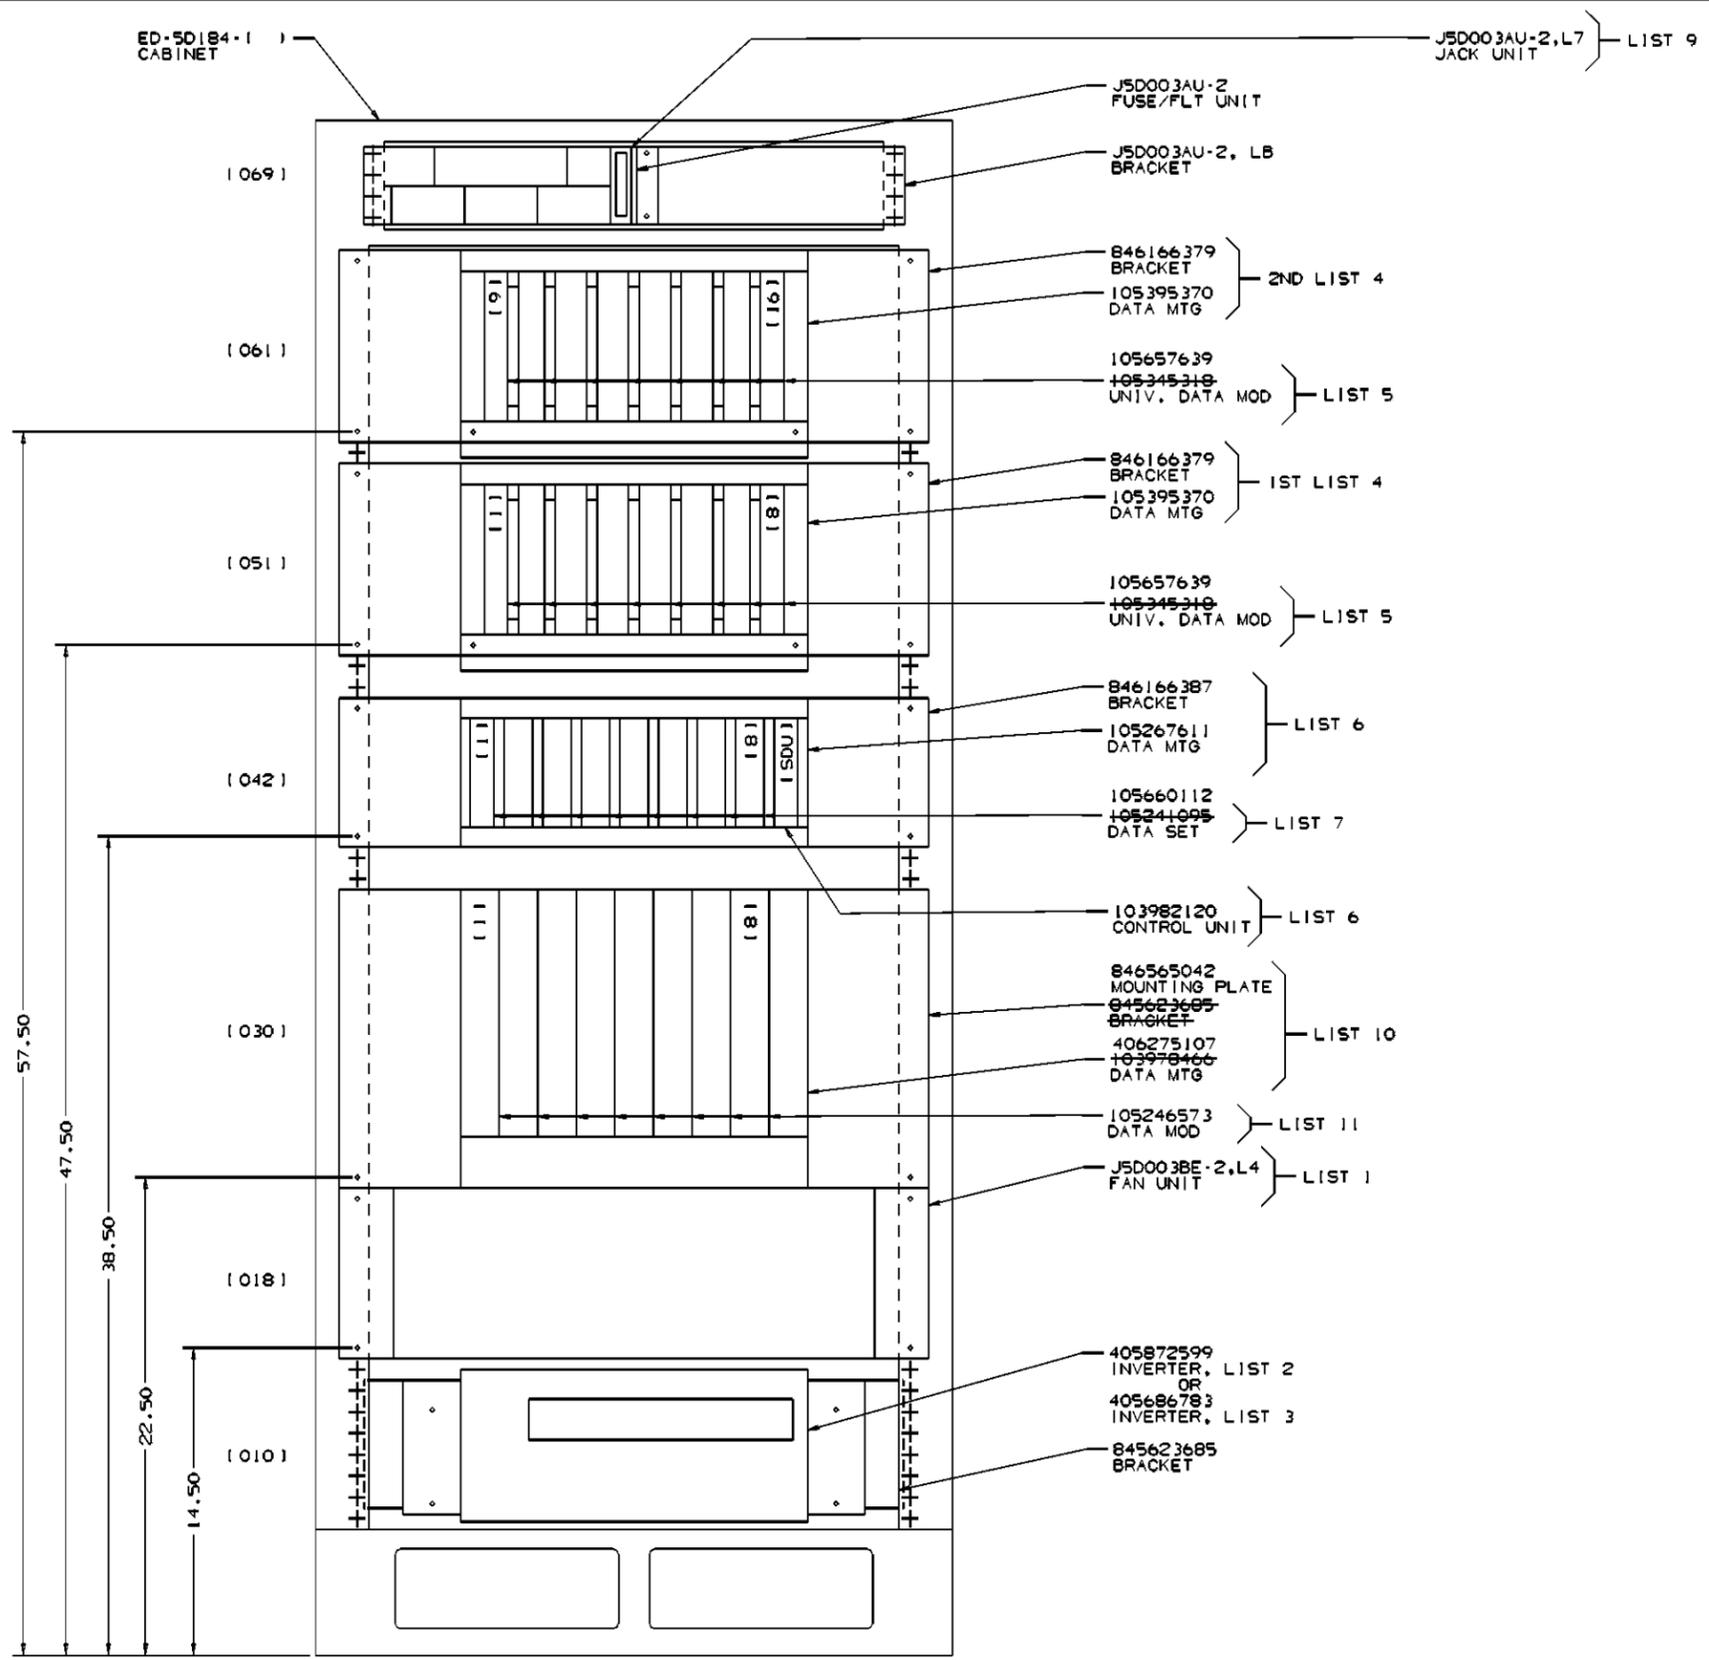


FIG. 2 (DA)
FRONT VIEW
ARRANGED FOR USE WITH
2296A MODEMS

J5D007B-1

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	2
AT&T	J5D007B-1	SHEET B3

CONVERSION TABLE	
INCH	MM
22.00	558.80
34.50	876.30
38.00	965.20
43.50	1104.90
47.00	1193.80
54.50	1384.30
57.00	1447.80
63.50	1612.90
65.50	1663.70


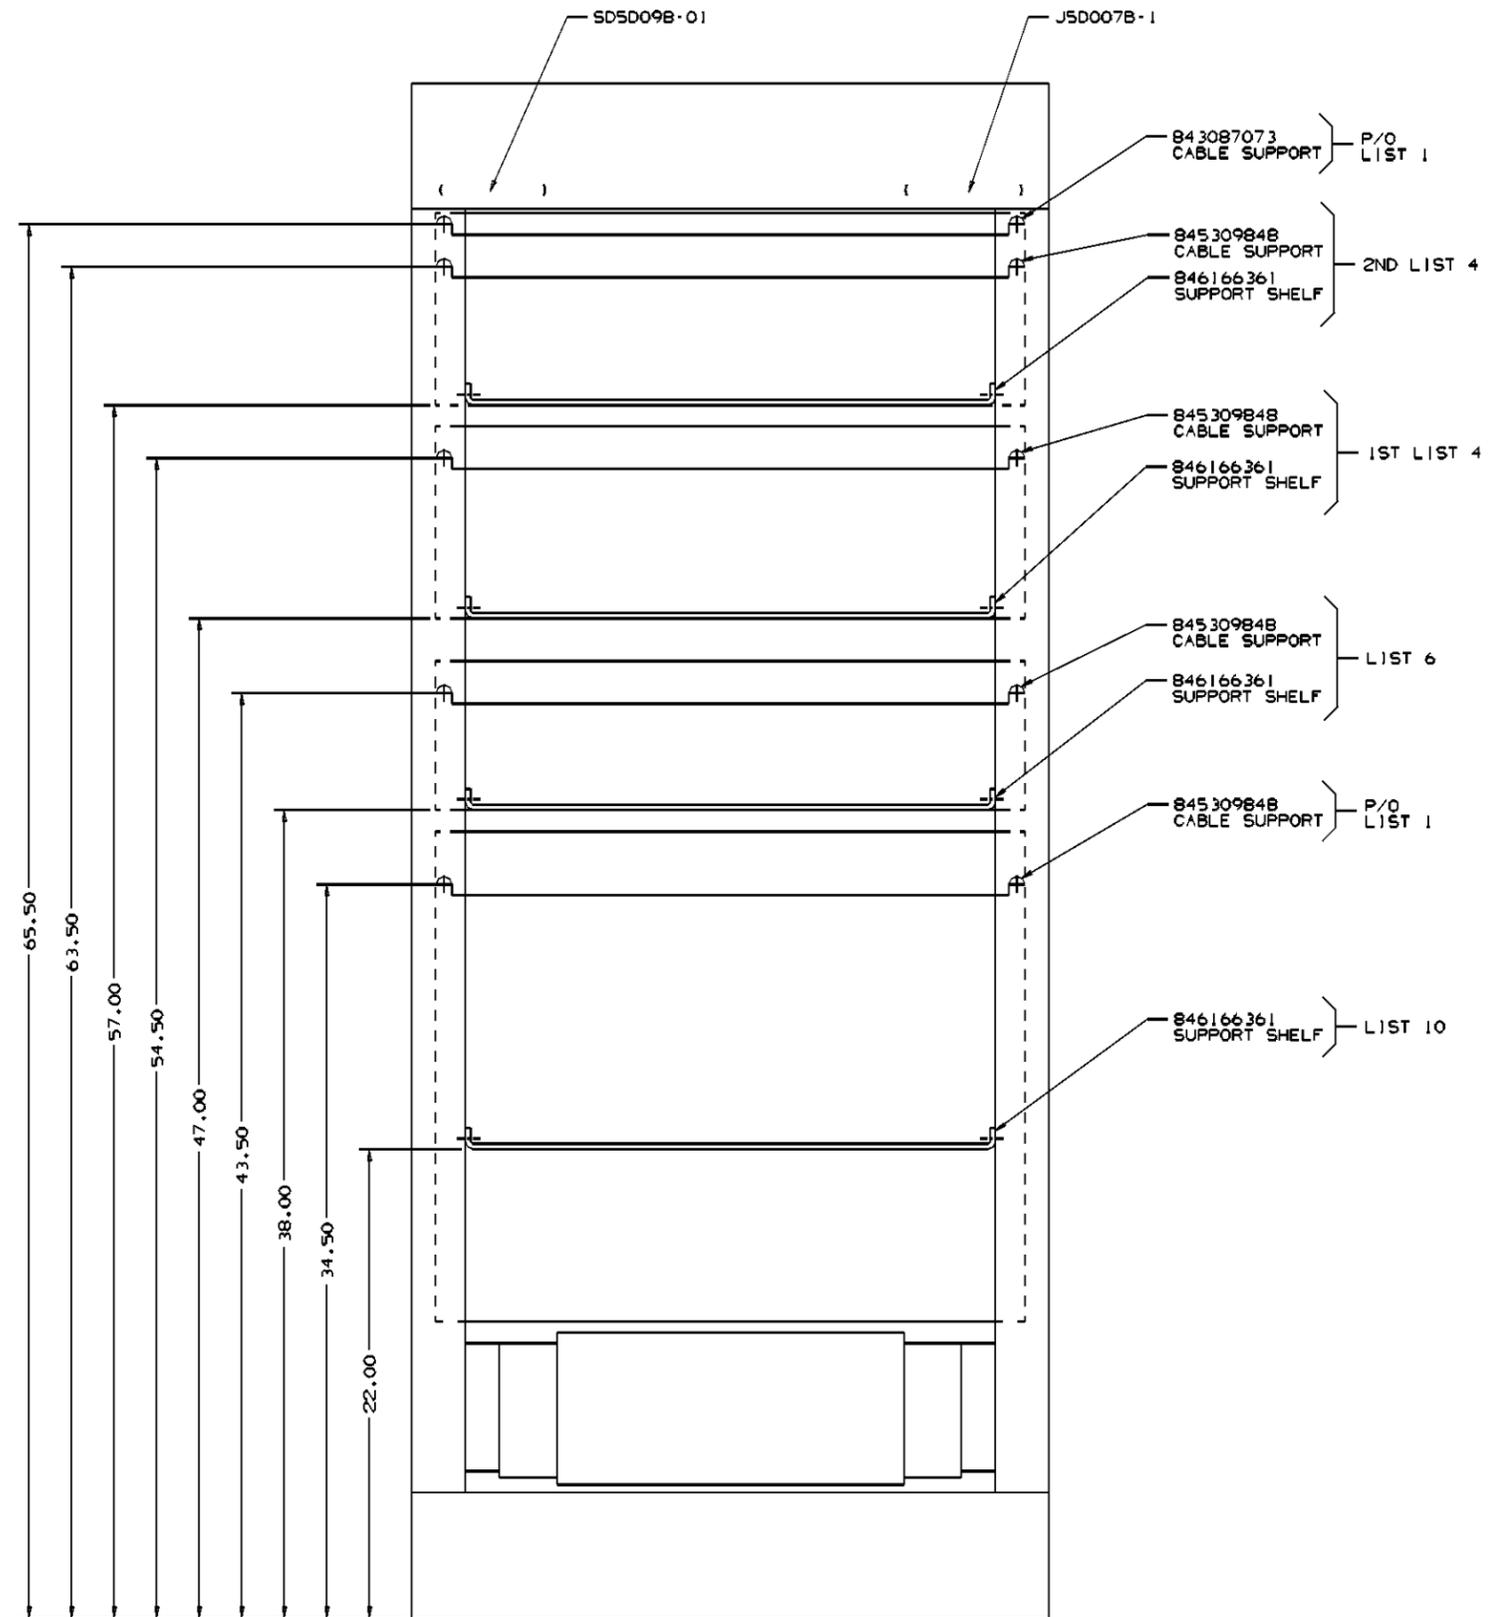



FIG. 2 (DA)
REAR VIEW

J5D007B-1

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	3
AT&T	J5D007B-1 <small>PRINTED IN U.S.A.</small>	SHEET B4

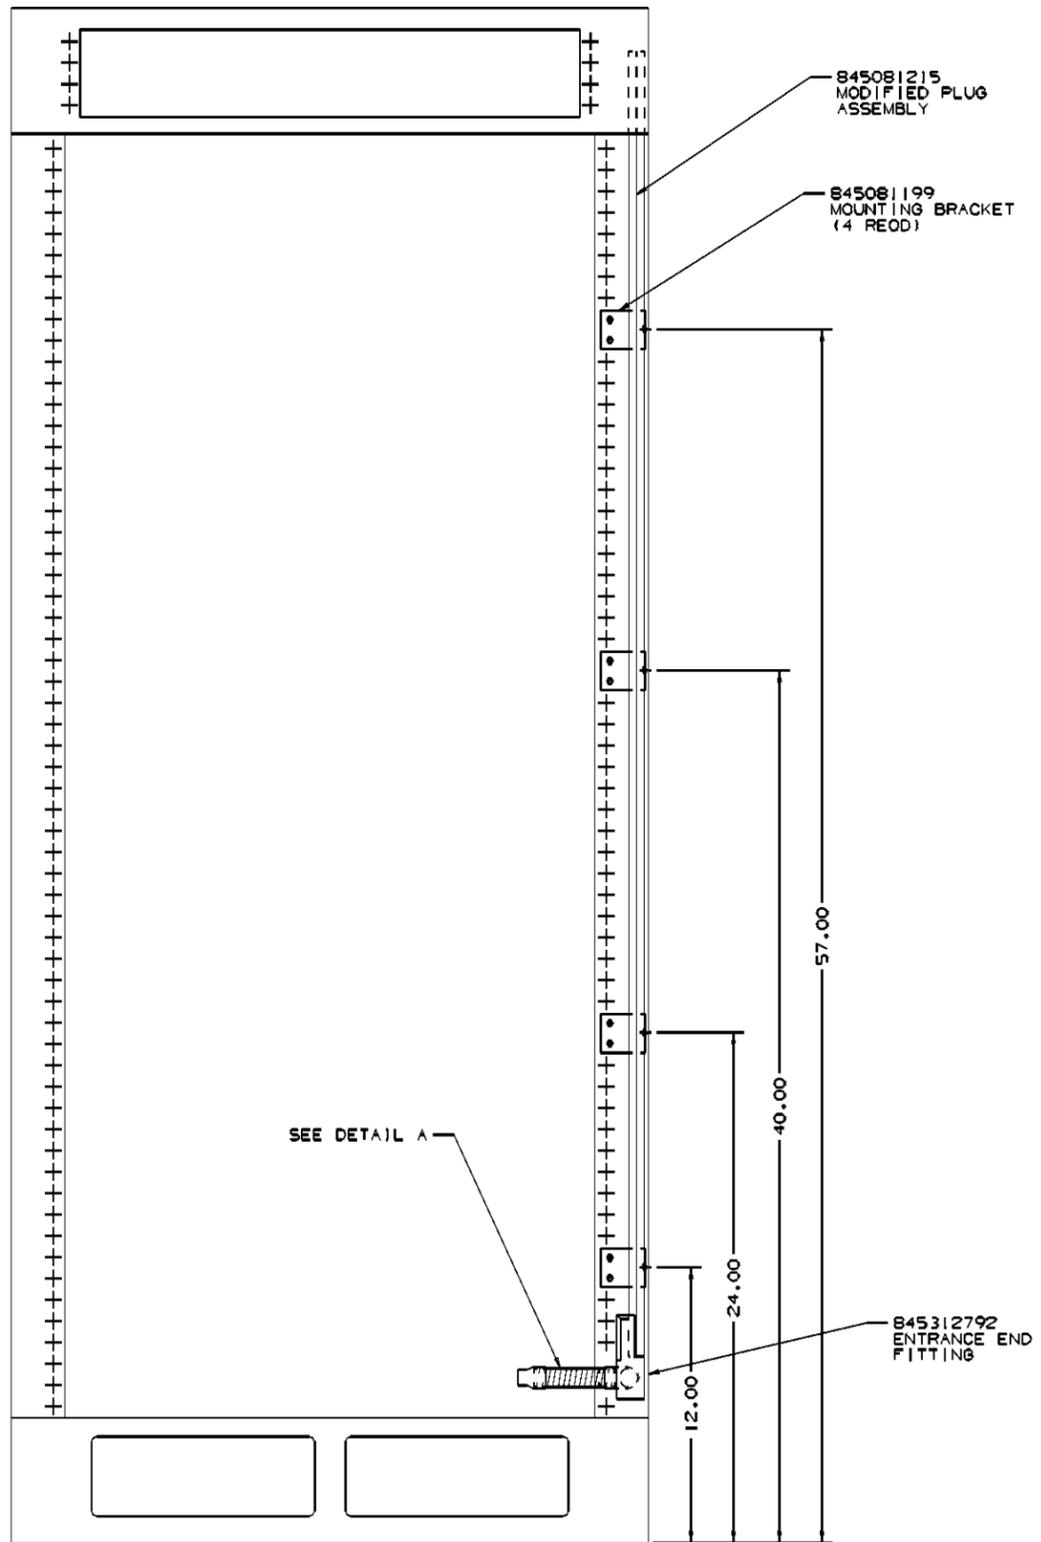

SKETCH A (DA)
METHOD OF MOUNTING
MODIFIED PLUG ASSEMBLY

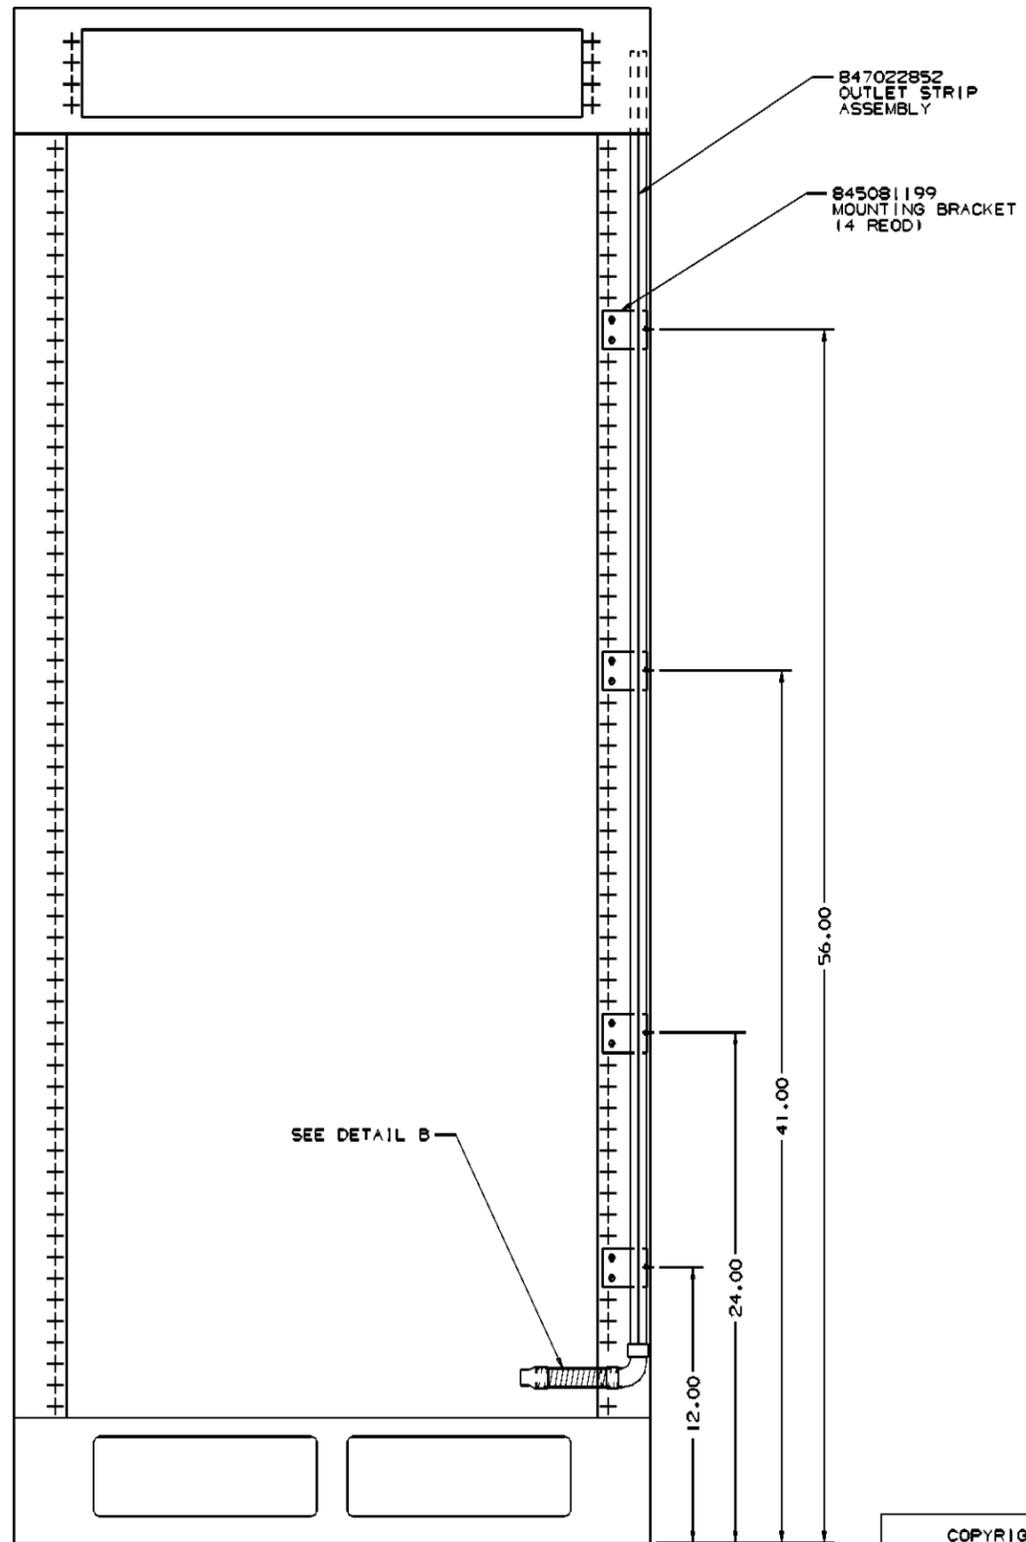


SKETCH D
METHOD OF MOUNTING
OUTLET STRIP ASSEMBLY
ED5D184-1) CABINET

57.00	1447.80
56.00	1422.40
41.00	1041.40
40.00	1016.00
24.00	609.60
12.00	403.80
INCH	MM


CONVERSION TABLE

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET		DWG SIZE C2
		ISSUE 3
AT&T	J5D007B-1	SHEET B5

CONVERSION TABLE	
INCH	MM
4.00	101.60

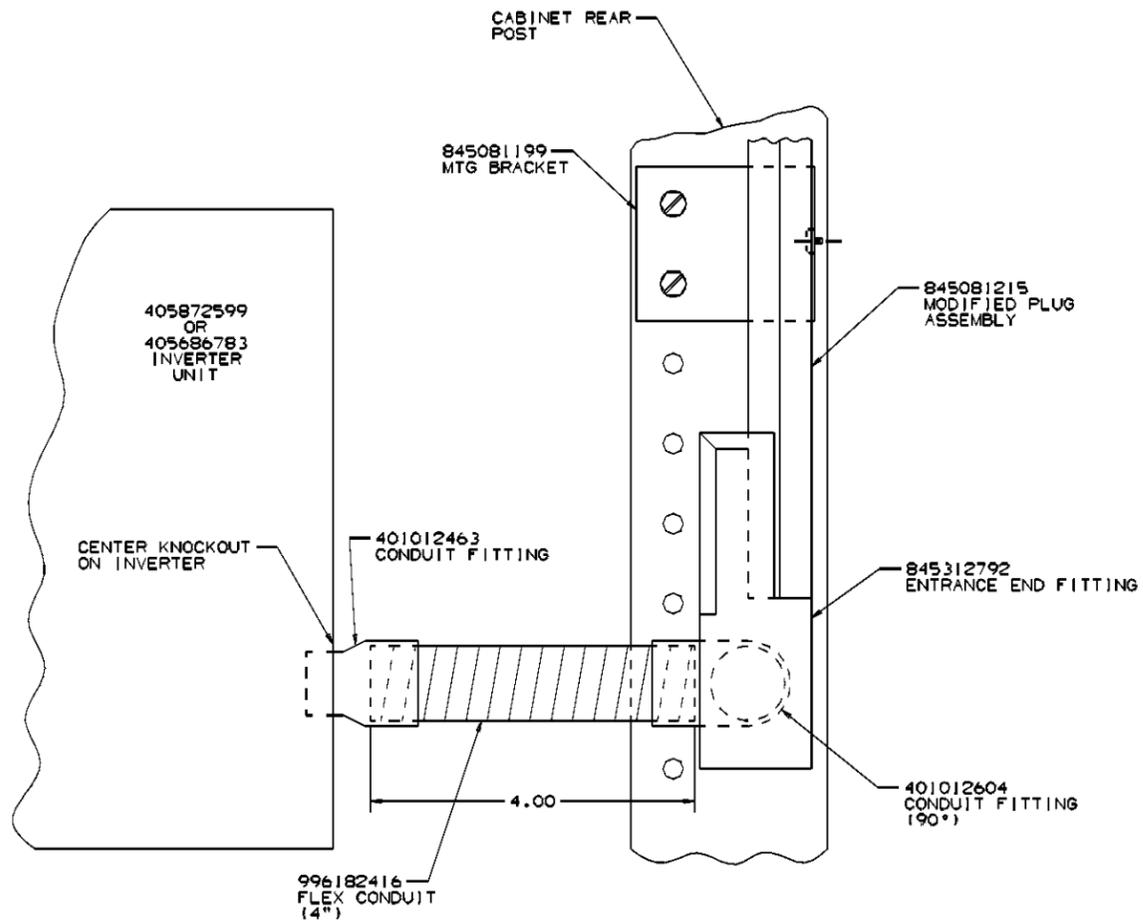


DETAIL A (DA)

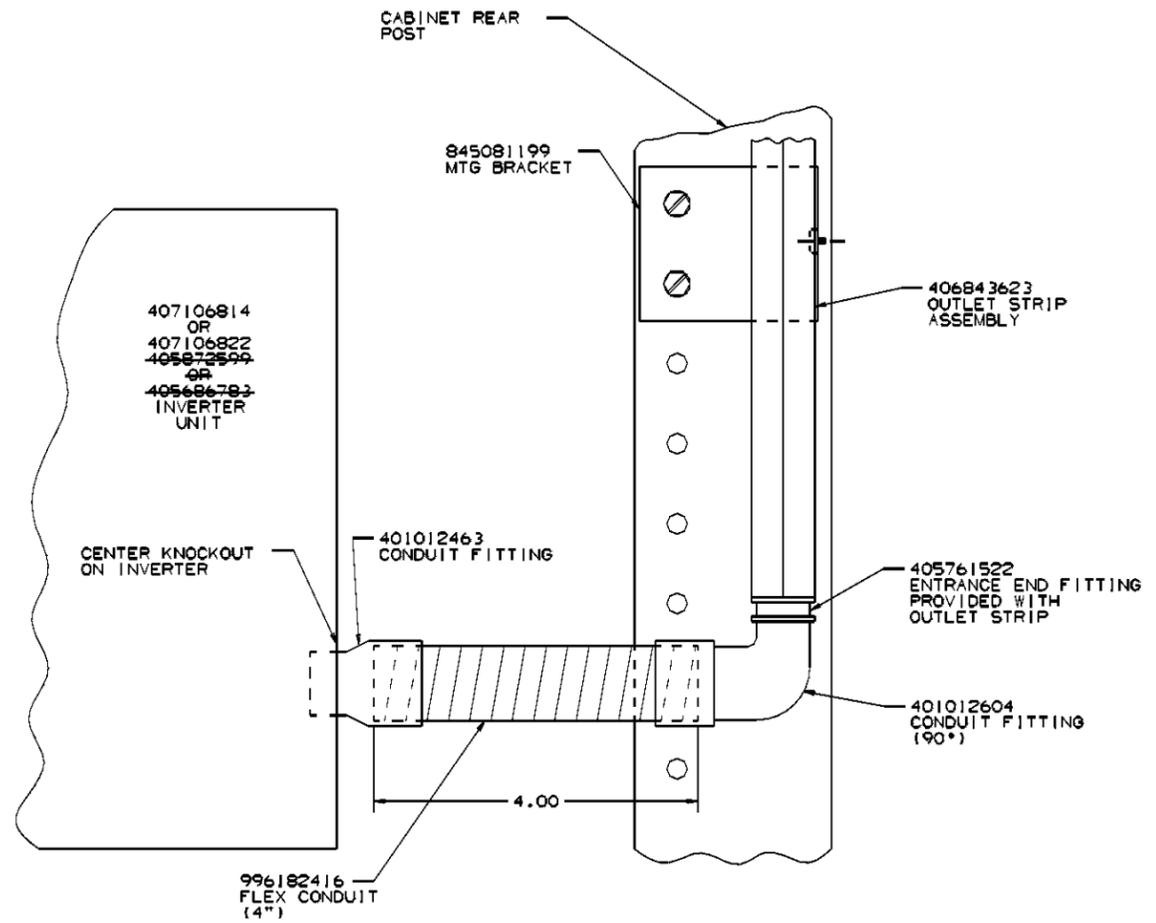

DETAIL B
ED5D184- () CABINET

J5D007B-1

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	6
AT&T	J5D007B-1	SHEET B6

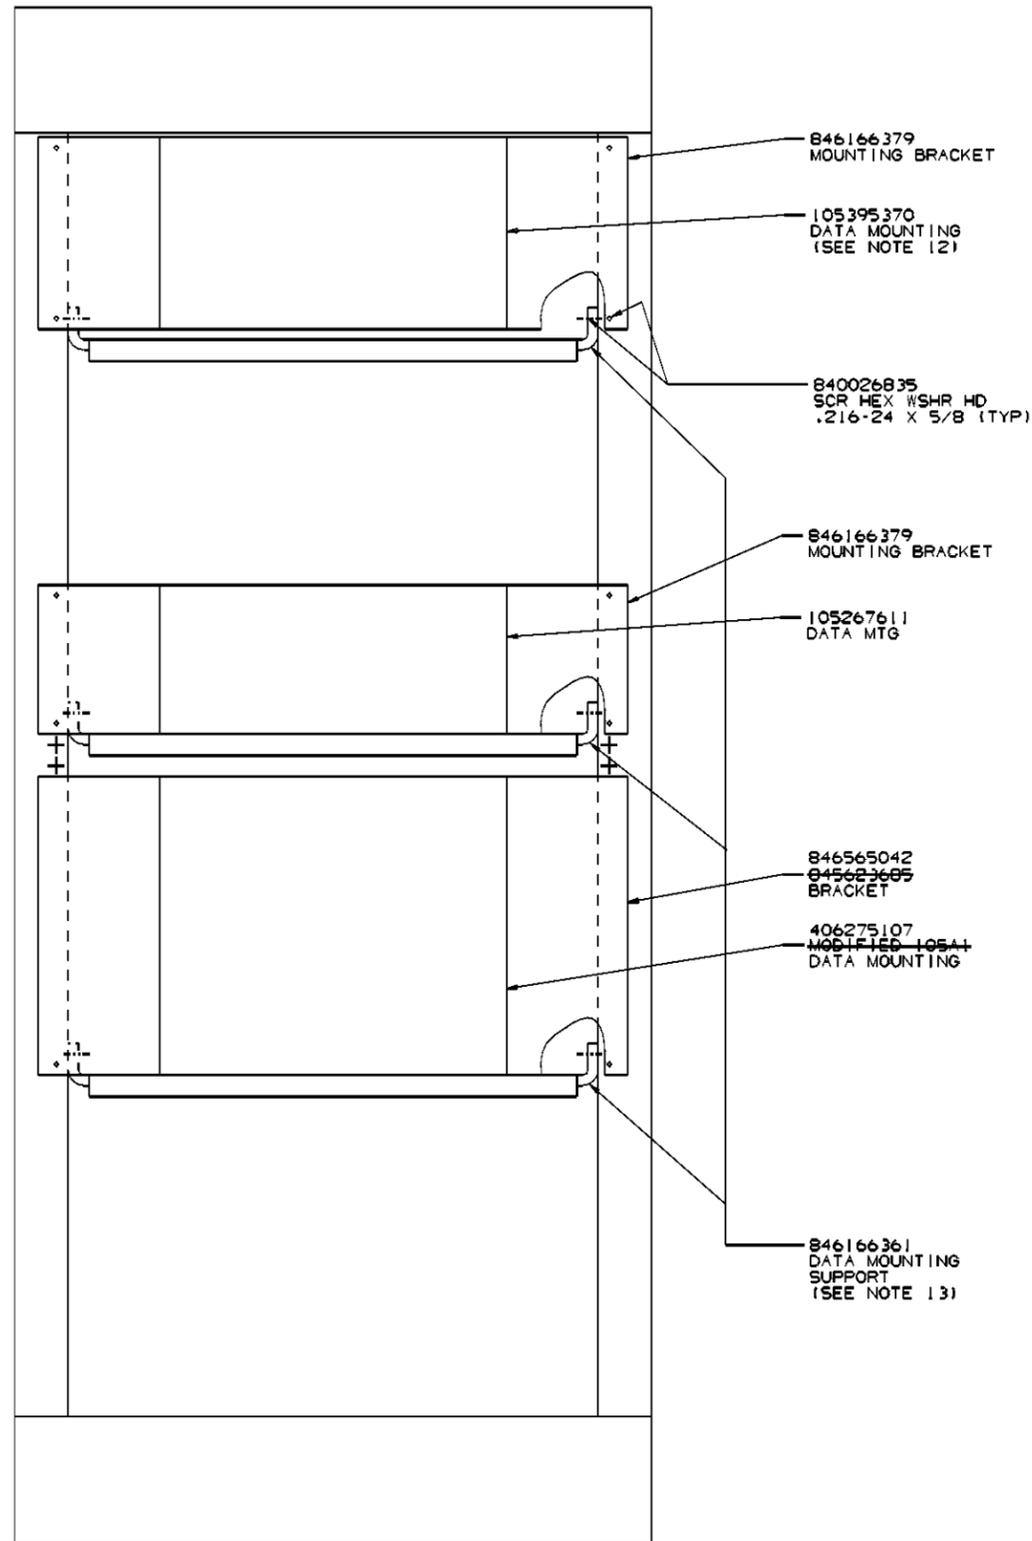

SKETCH C (DA)
METHOD OF INSTALLING
DATA MOUNTINGS

J5D007B-1

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	7
AT&T	J5D007B-1	SHEET B7

TABLE AA

GROUP NUMBER	GROUPING	CABINET
1249	MPG0	MPC0
1250	MPG0	MPC1
1251	MPG0	MPC2
1252	MPG0	MPC3
1253	MPG0	MPC4
1254	MPG1	MPC0
1255	MPG1	MPC1
1256	MPG1	MPC2
1257	MPG1	MPC3
1258	MPG1	MPC4
1259	MPG2	MPC0
1260	MPG2	MPC1
1261	MPG2	MPC2
1262	MPG2	MPC3
1263	MPG2	MPC4
1264	MPG3	MPC0
1265	MPG3	MPC1
1266	MPG3	MPC2
1267	MPG3	MPC3
1268	MPG3	MPC4
1269	MPG4	MPC0
1270	MPG4	MPC1
1271	MPG4	MPC2
1272	MPG4	MPC3
1273	MPG4	MPC4

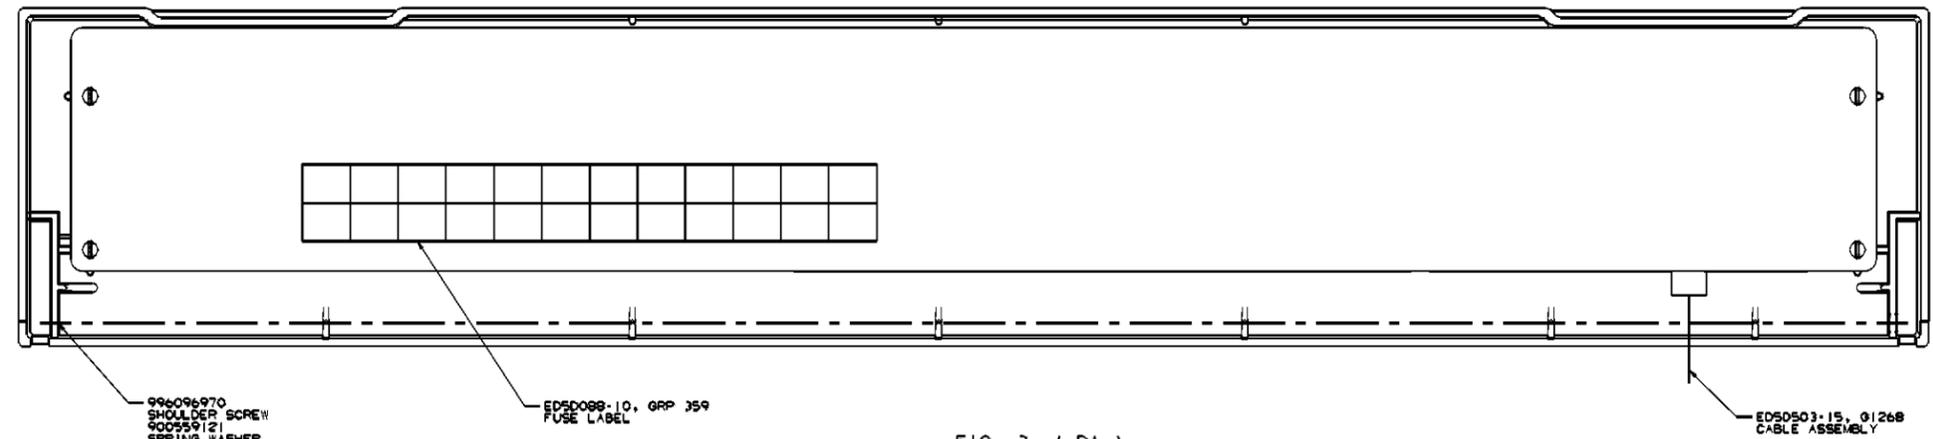


FIG. 3 (DA)
FRONT BEZEL IN MAINTENANCE
(OPEN) POSITION
OPTION V

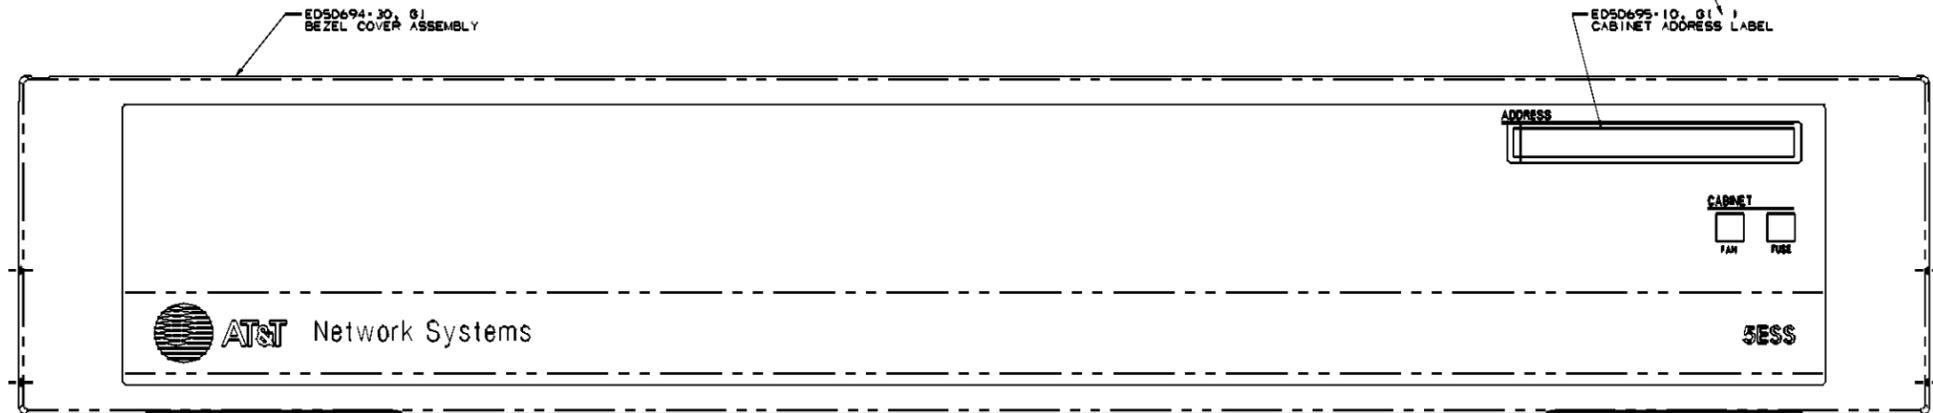


FIG. 4
FRONT BEZEL COVER ASSEMBLY
ED5D184-1 CABINET

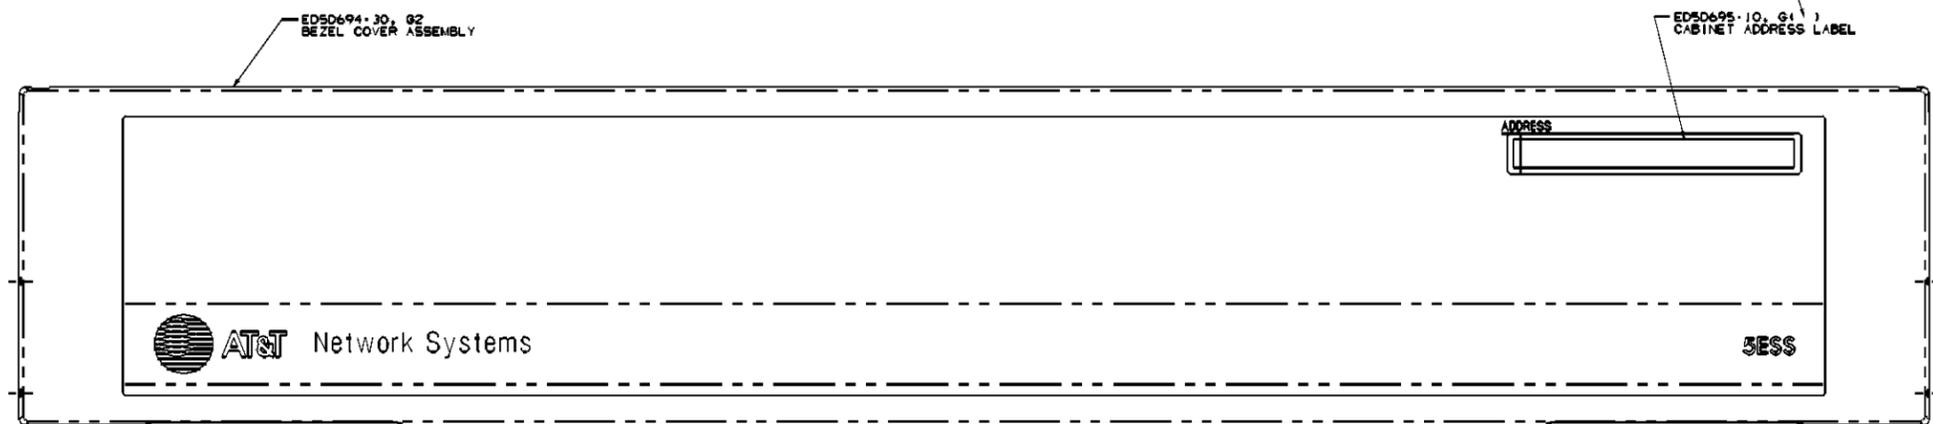


FIG. 5
REAR BEZEL COVER ASSEMBLY
ED5D184-1 CABINET

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	3
AT&T	J5D007B-1	SHEET 88




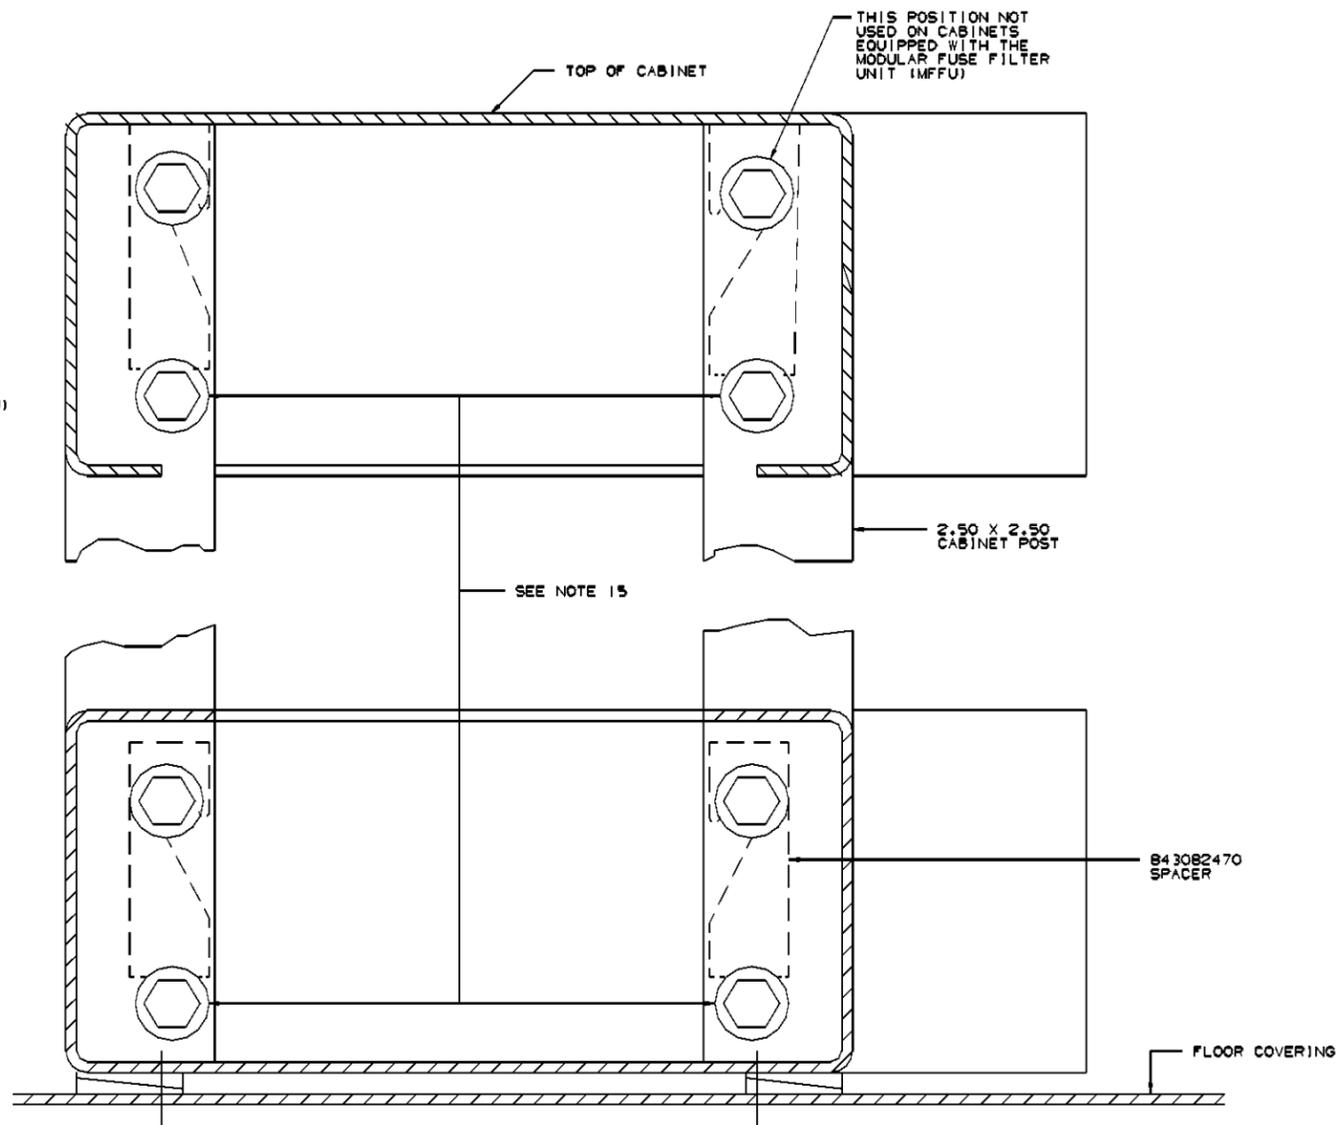


FIG. 6
METHOD OF JUNCTIONING ONE CABINET TO ANOTHER CABINET

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	7
AT&T	J5D007B-1	SHEET B9

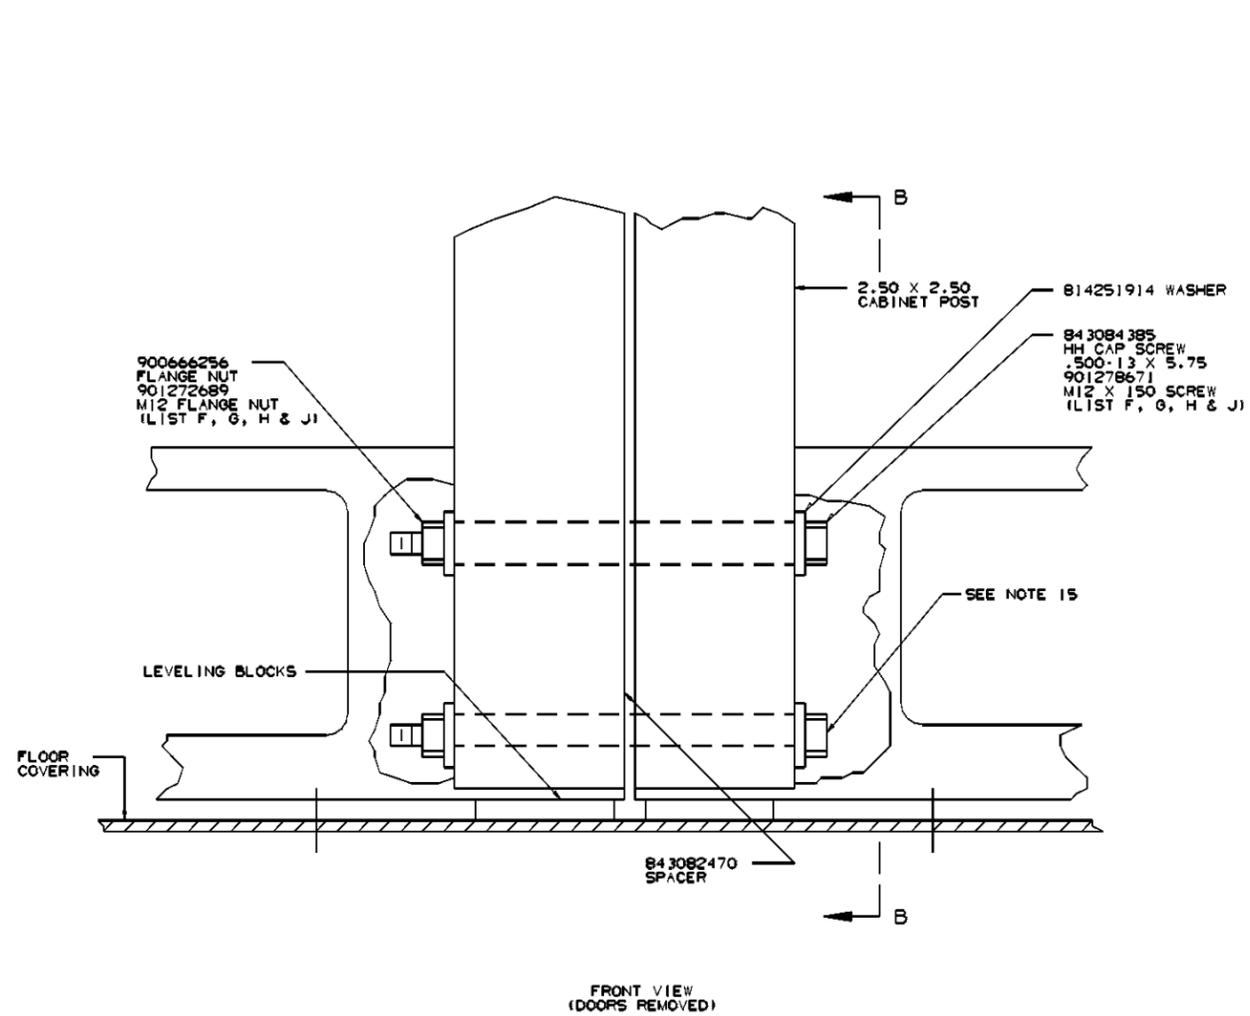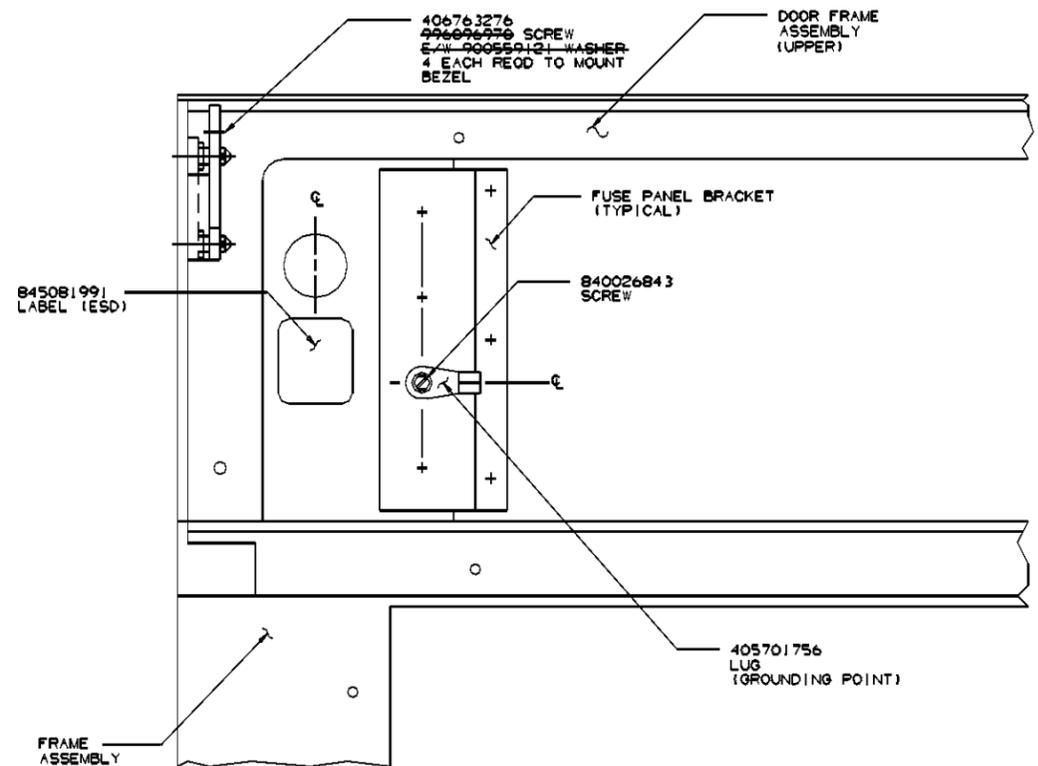

EQUIPMENT SIDE
 (BEZEL REMOVED FOR CLARITY)

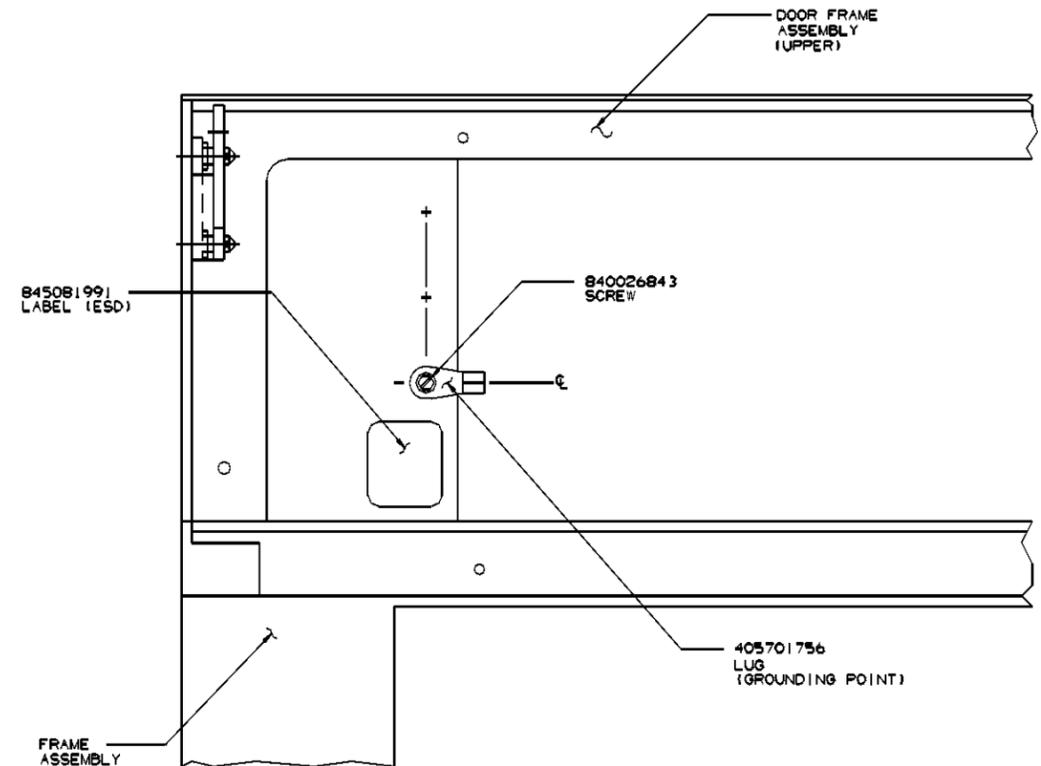

WIRING SIDE
 (BEZEL REMOVED FOR CLARITY)

FIG. A
 LOCATION OF ESD
 LABELS AND GROUNDING
 LUGS
 ED5D184-1 CABINET

CONVERSION TABLE	
INCH	MM
.12	3.175
.28	7.1438

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	6
AT&T	J5D007B-1	SHEET 810

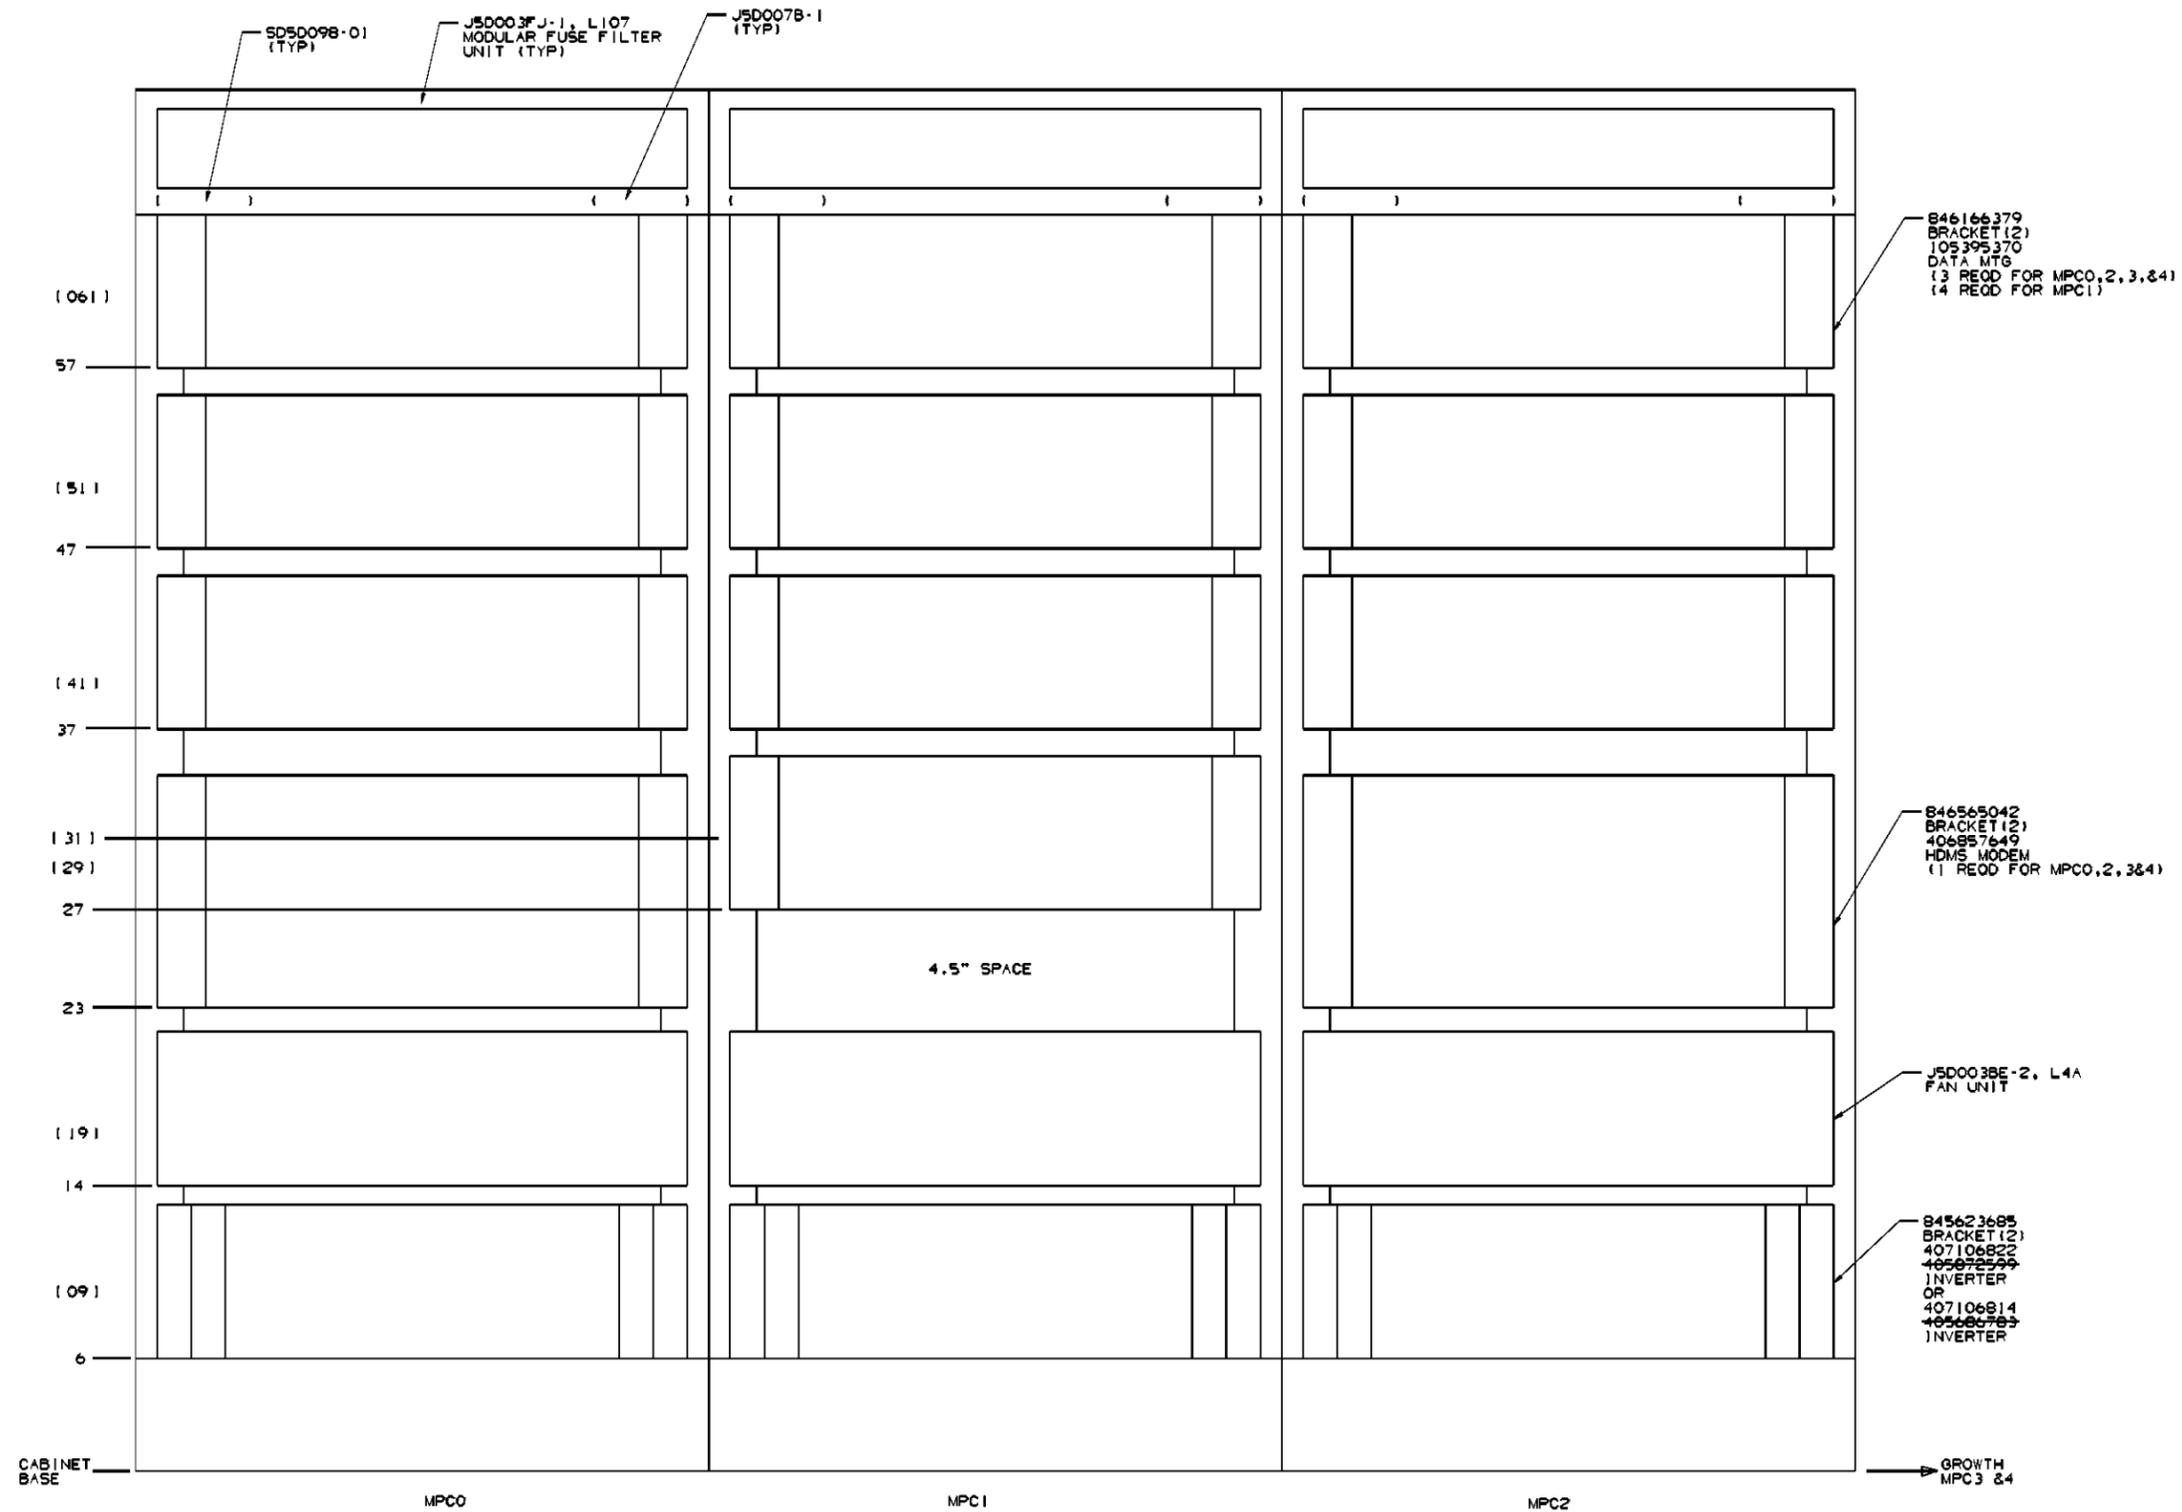


FIG. 7
FRONT VIEW
ARRANGED FOR USE WITH
HIGH DENSITY MICROCOM SYSTEM
(HDMS) MODEMS
ED5D184-1) CABINET

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	6
AT&T	J5D007B-1	SHEET B11

J5D007B-1

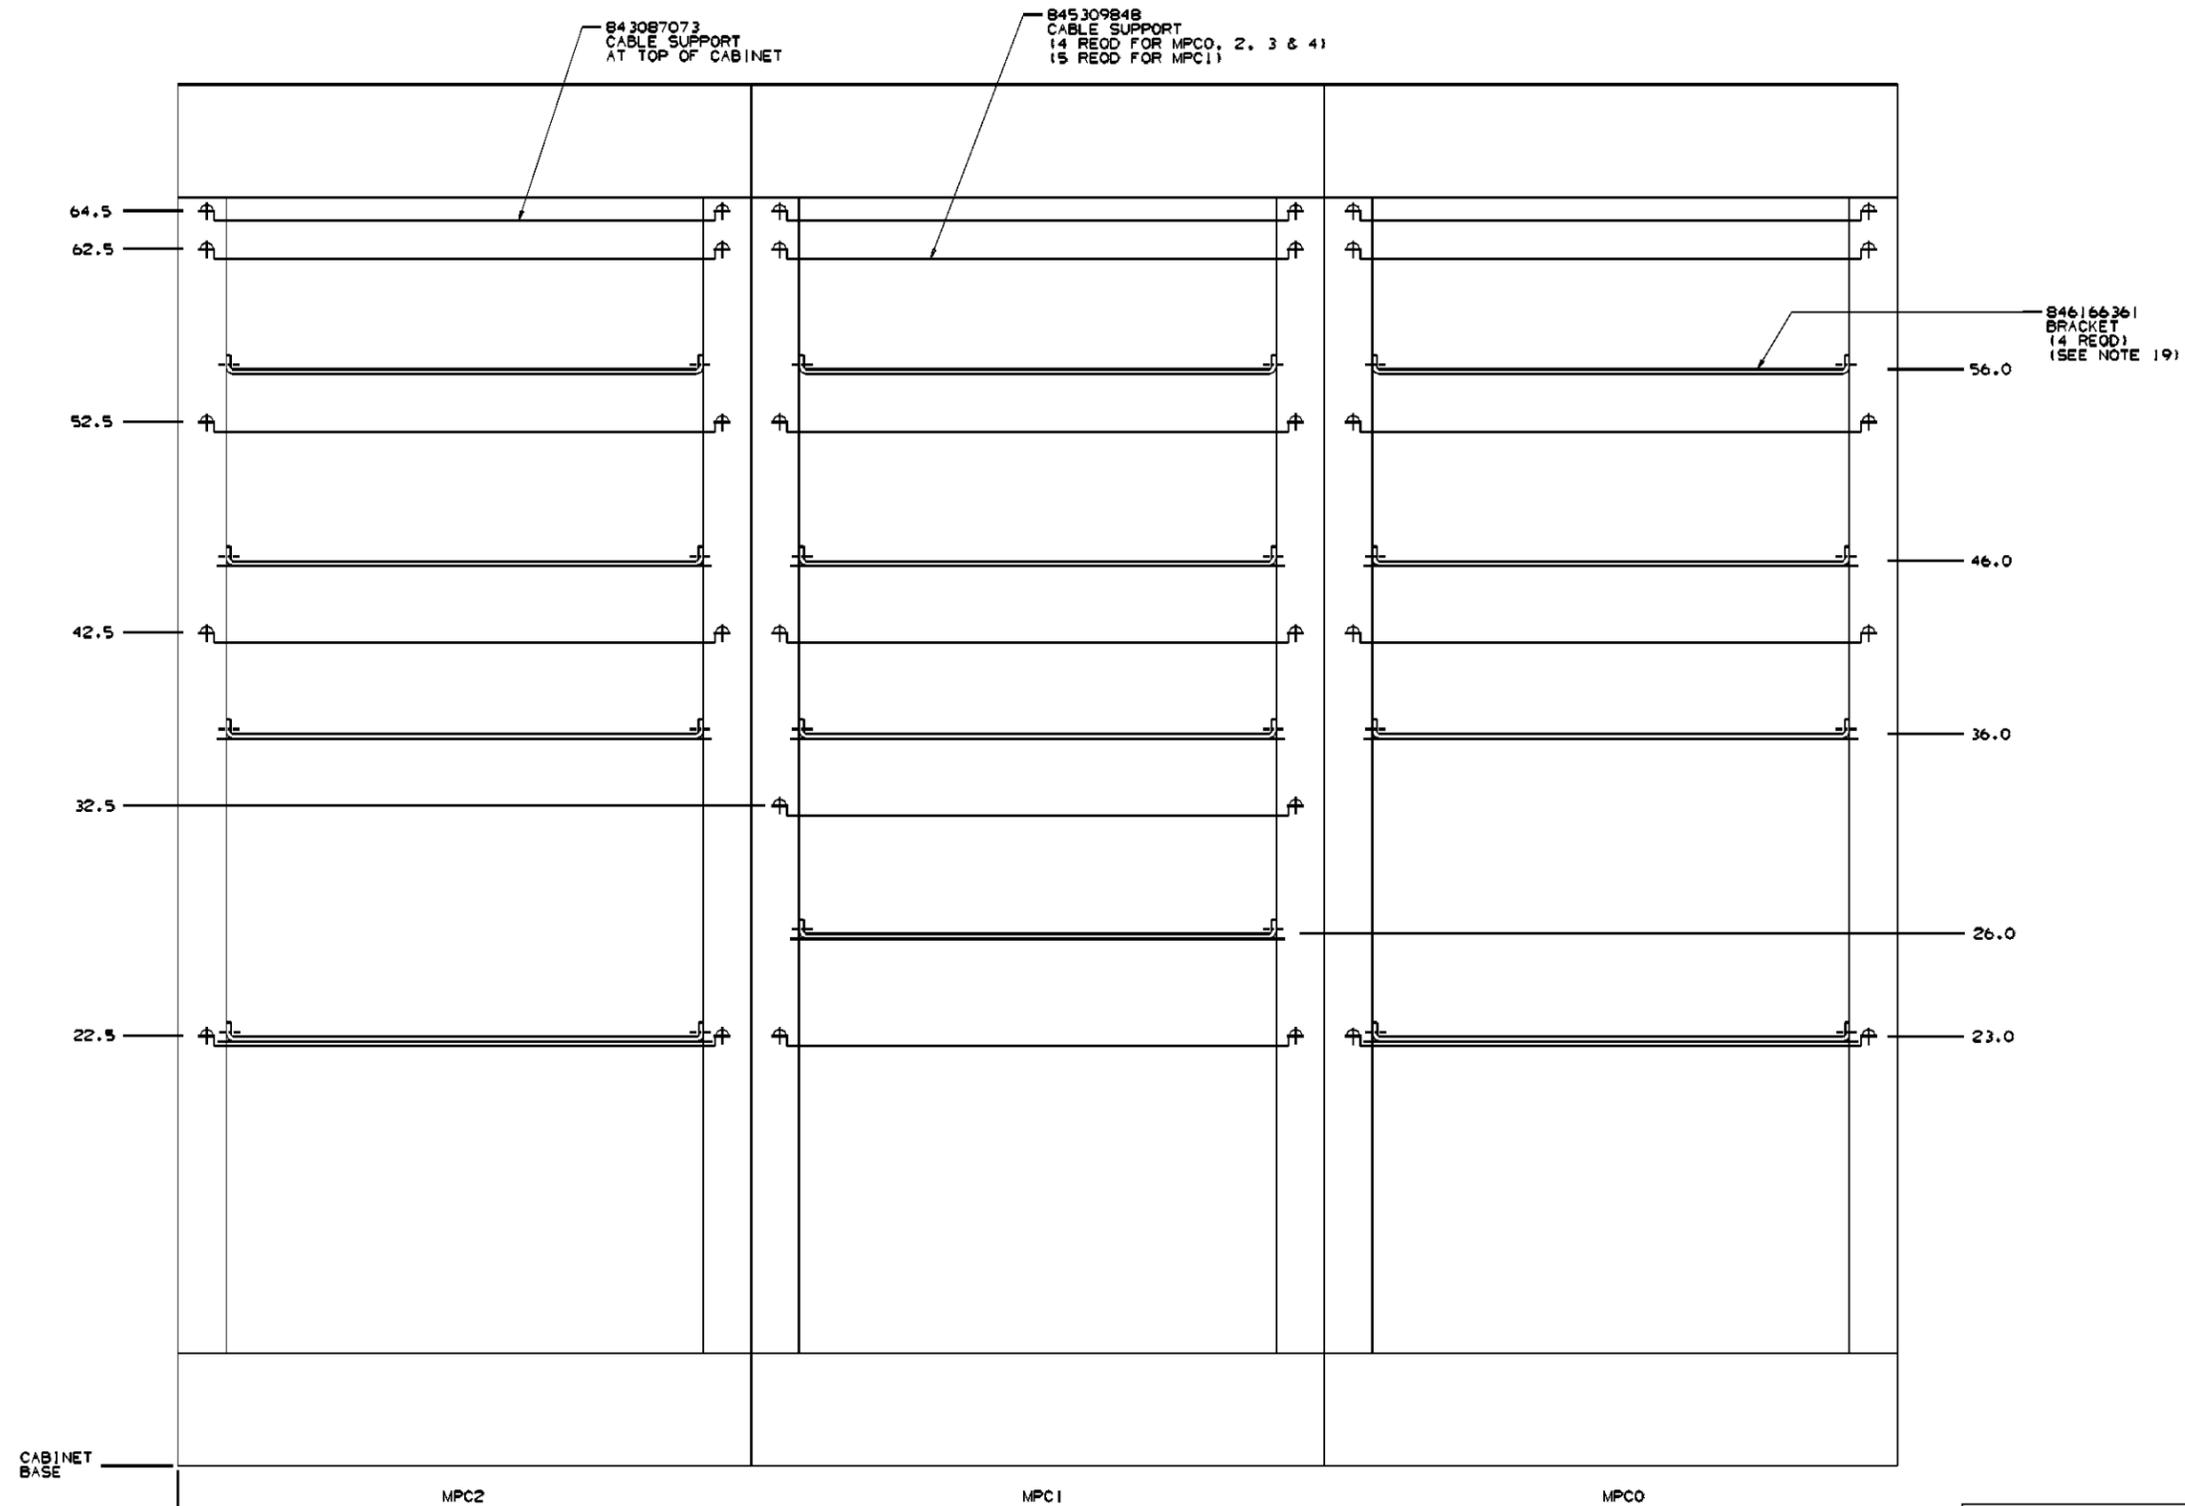


FIG. 7 (CONT)
REAR VIEW SHOWING
LOCATION OF CABLE SUPPORTS
AND BRACKETS
ED5D184-1 CABINET

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	3
AT&T	J5D007B-1	SHEET B12

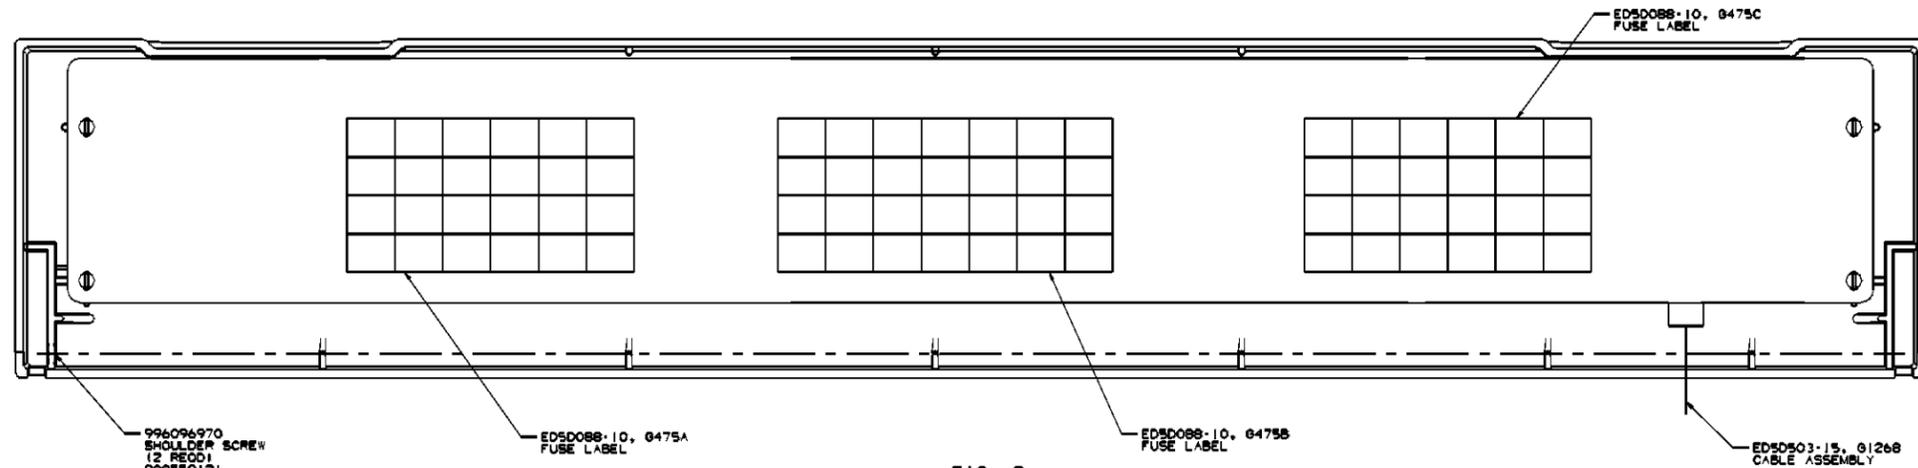


FIG. 8
 BEZEL IN MAINTENANCE
 (OPEN) POSITION OPTION U
 FRONT BEZEL COVER
 EDS0184-1 CABINET

996096970
 SHOULDER SCREW
 (2 REQD)
 900559121
 SPRING WASHER
 (6 REQD)

EDS088-10, 0475A
 FUSE LABEL

EDS088-10, 0475B
 FUSE LABEL

EDS088-10, 0475C
 FUSE LABEL

EDS03-15, 01268
 CABLE ASSEMBLY

COPYRIGHT 1993 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	3
AT&T	J5D007B-1 <small>PRINTED IN U.S.A.</small>	SHEET B13


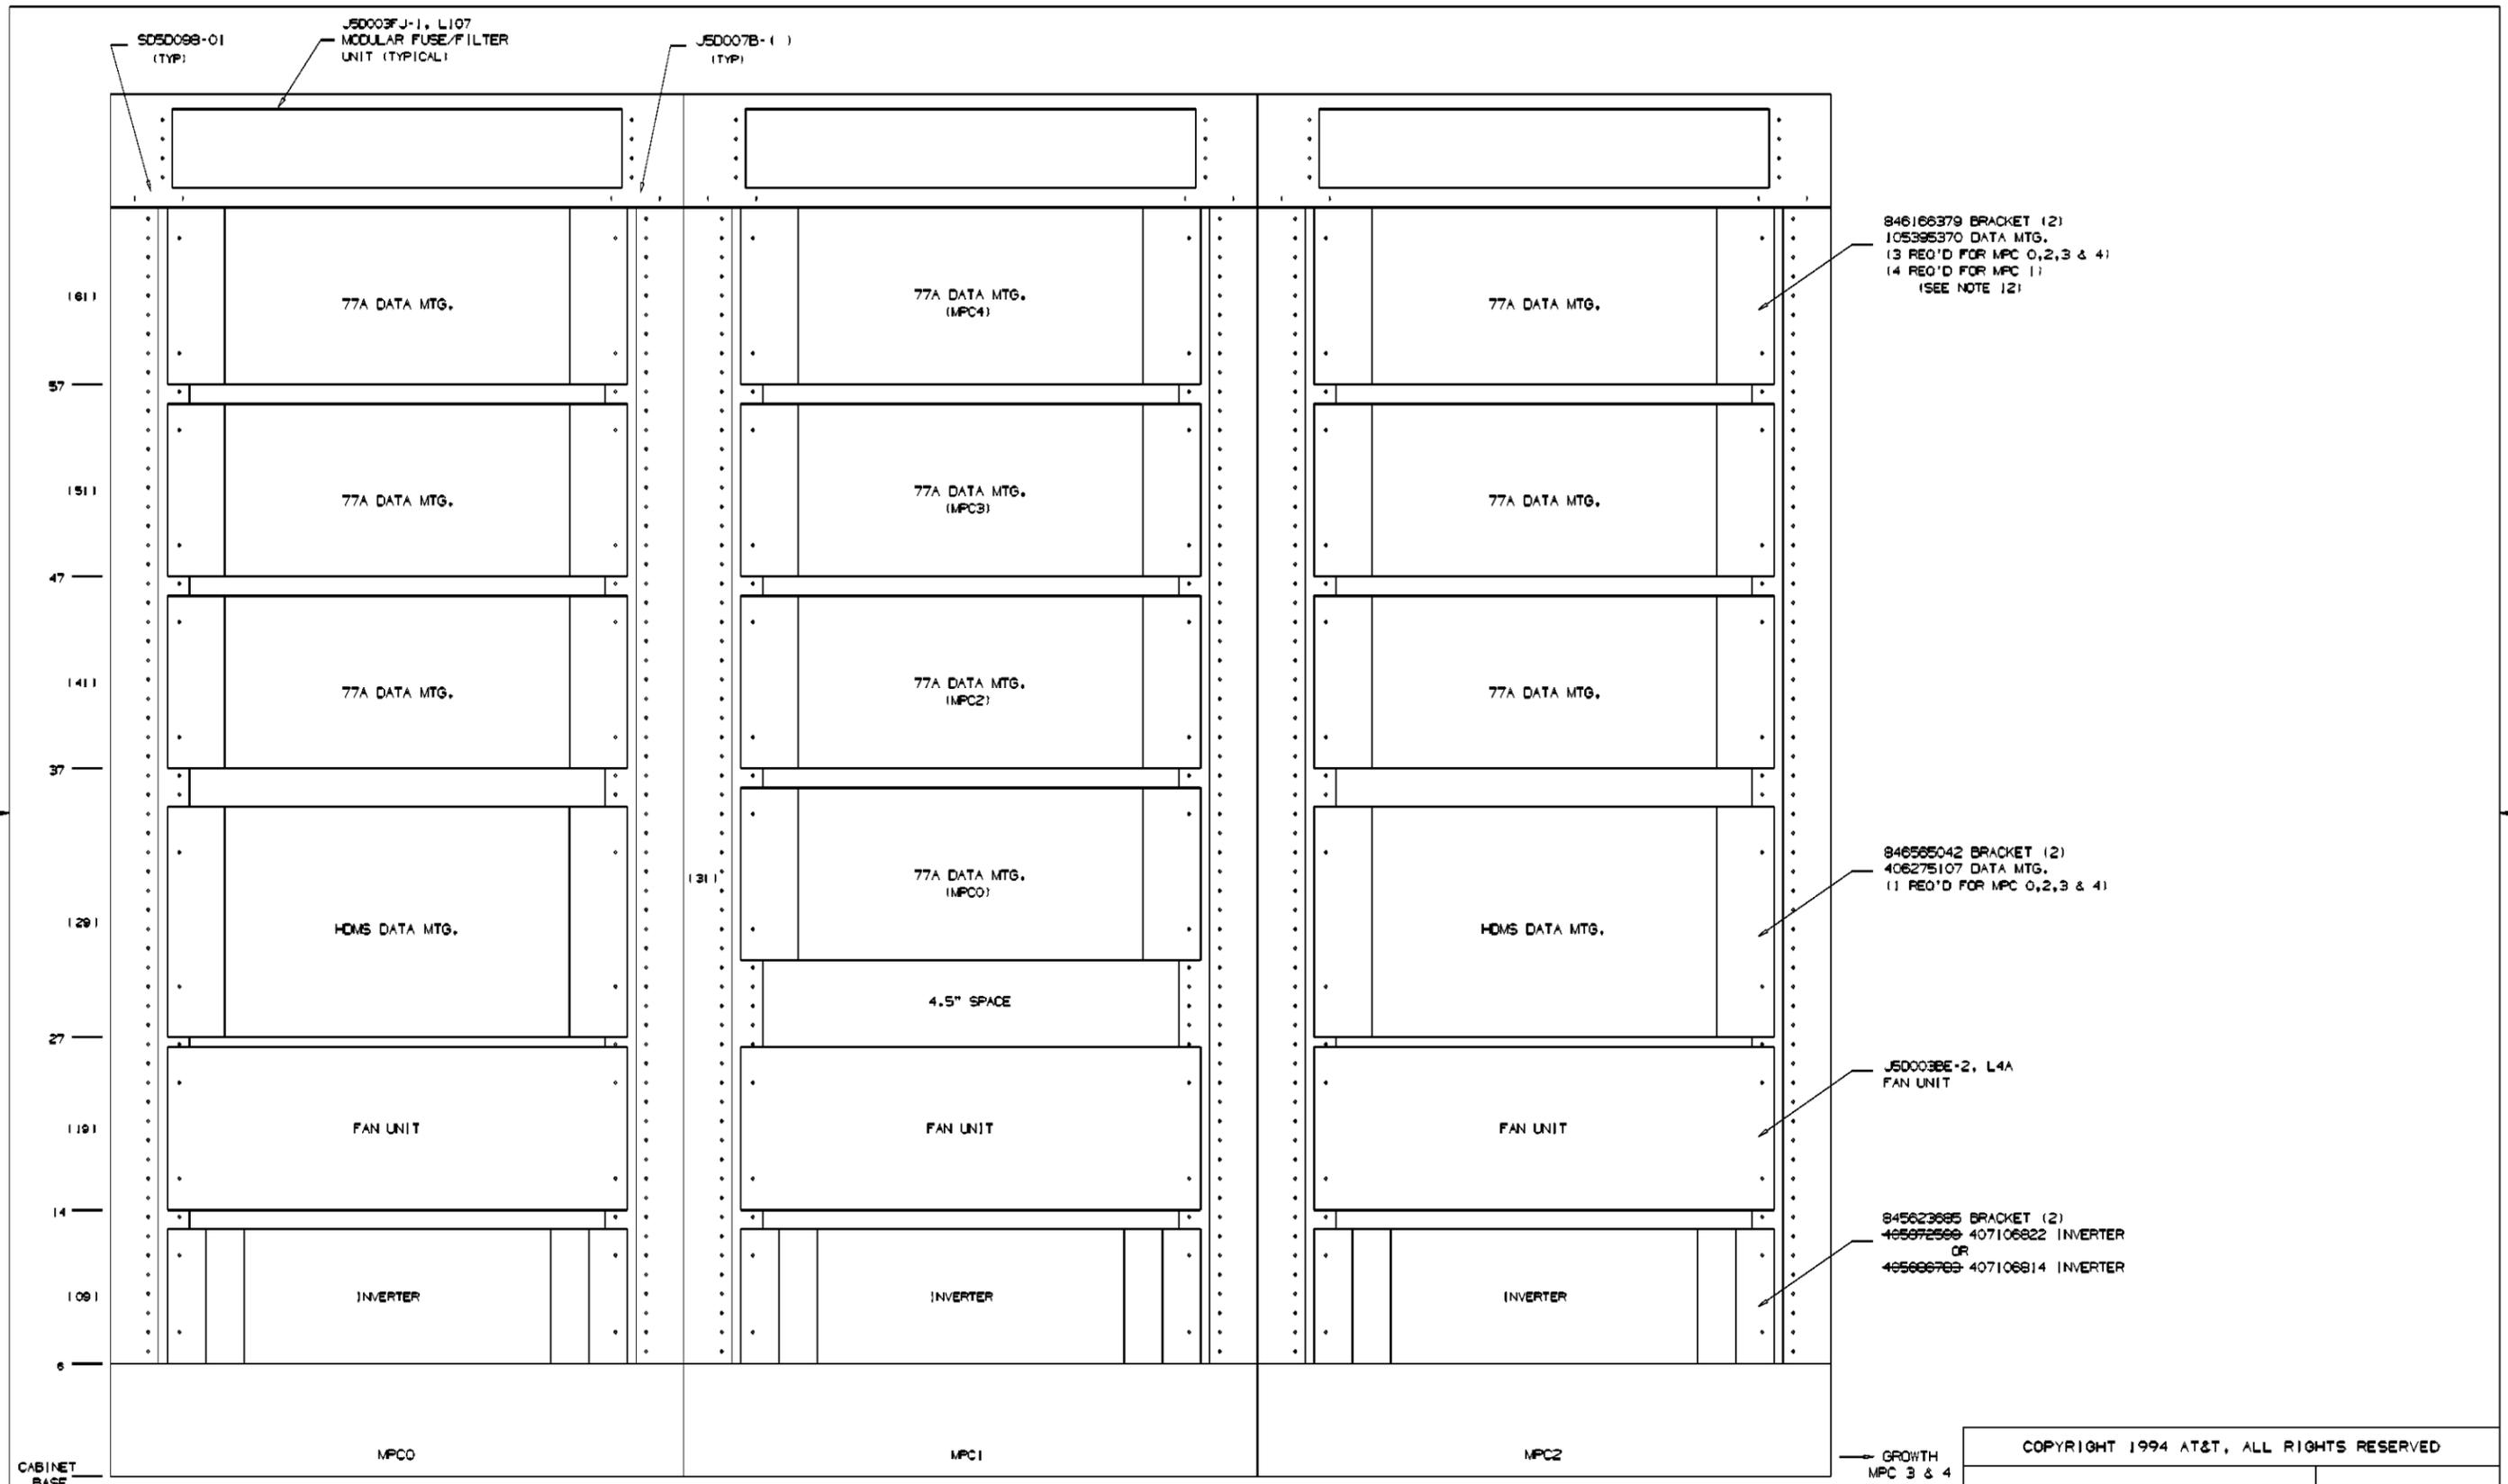


FIG. 9
FRONT VIEW ED50741-1 () CABINET
ARRANGED FOR USE WITH
HIGH DENSITY MICROCOM SYSTEM
(HDMS) MODEMS

J5D007B-1

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	8
AT&T	J5D007B-1 <small>PRINTED IN U.S.A.</small>	SHEET B14

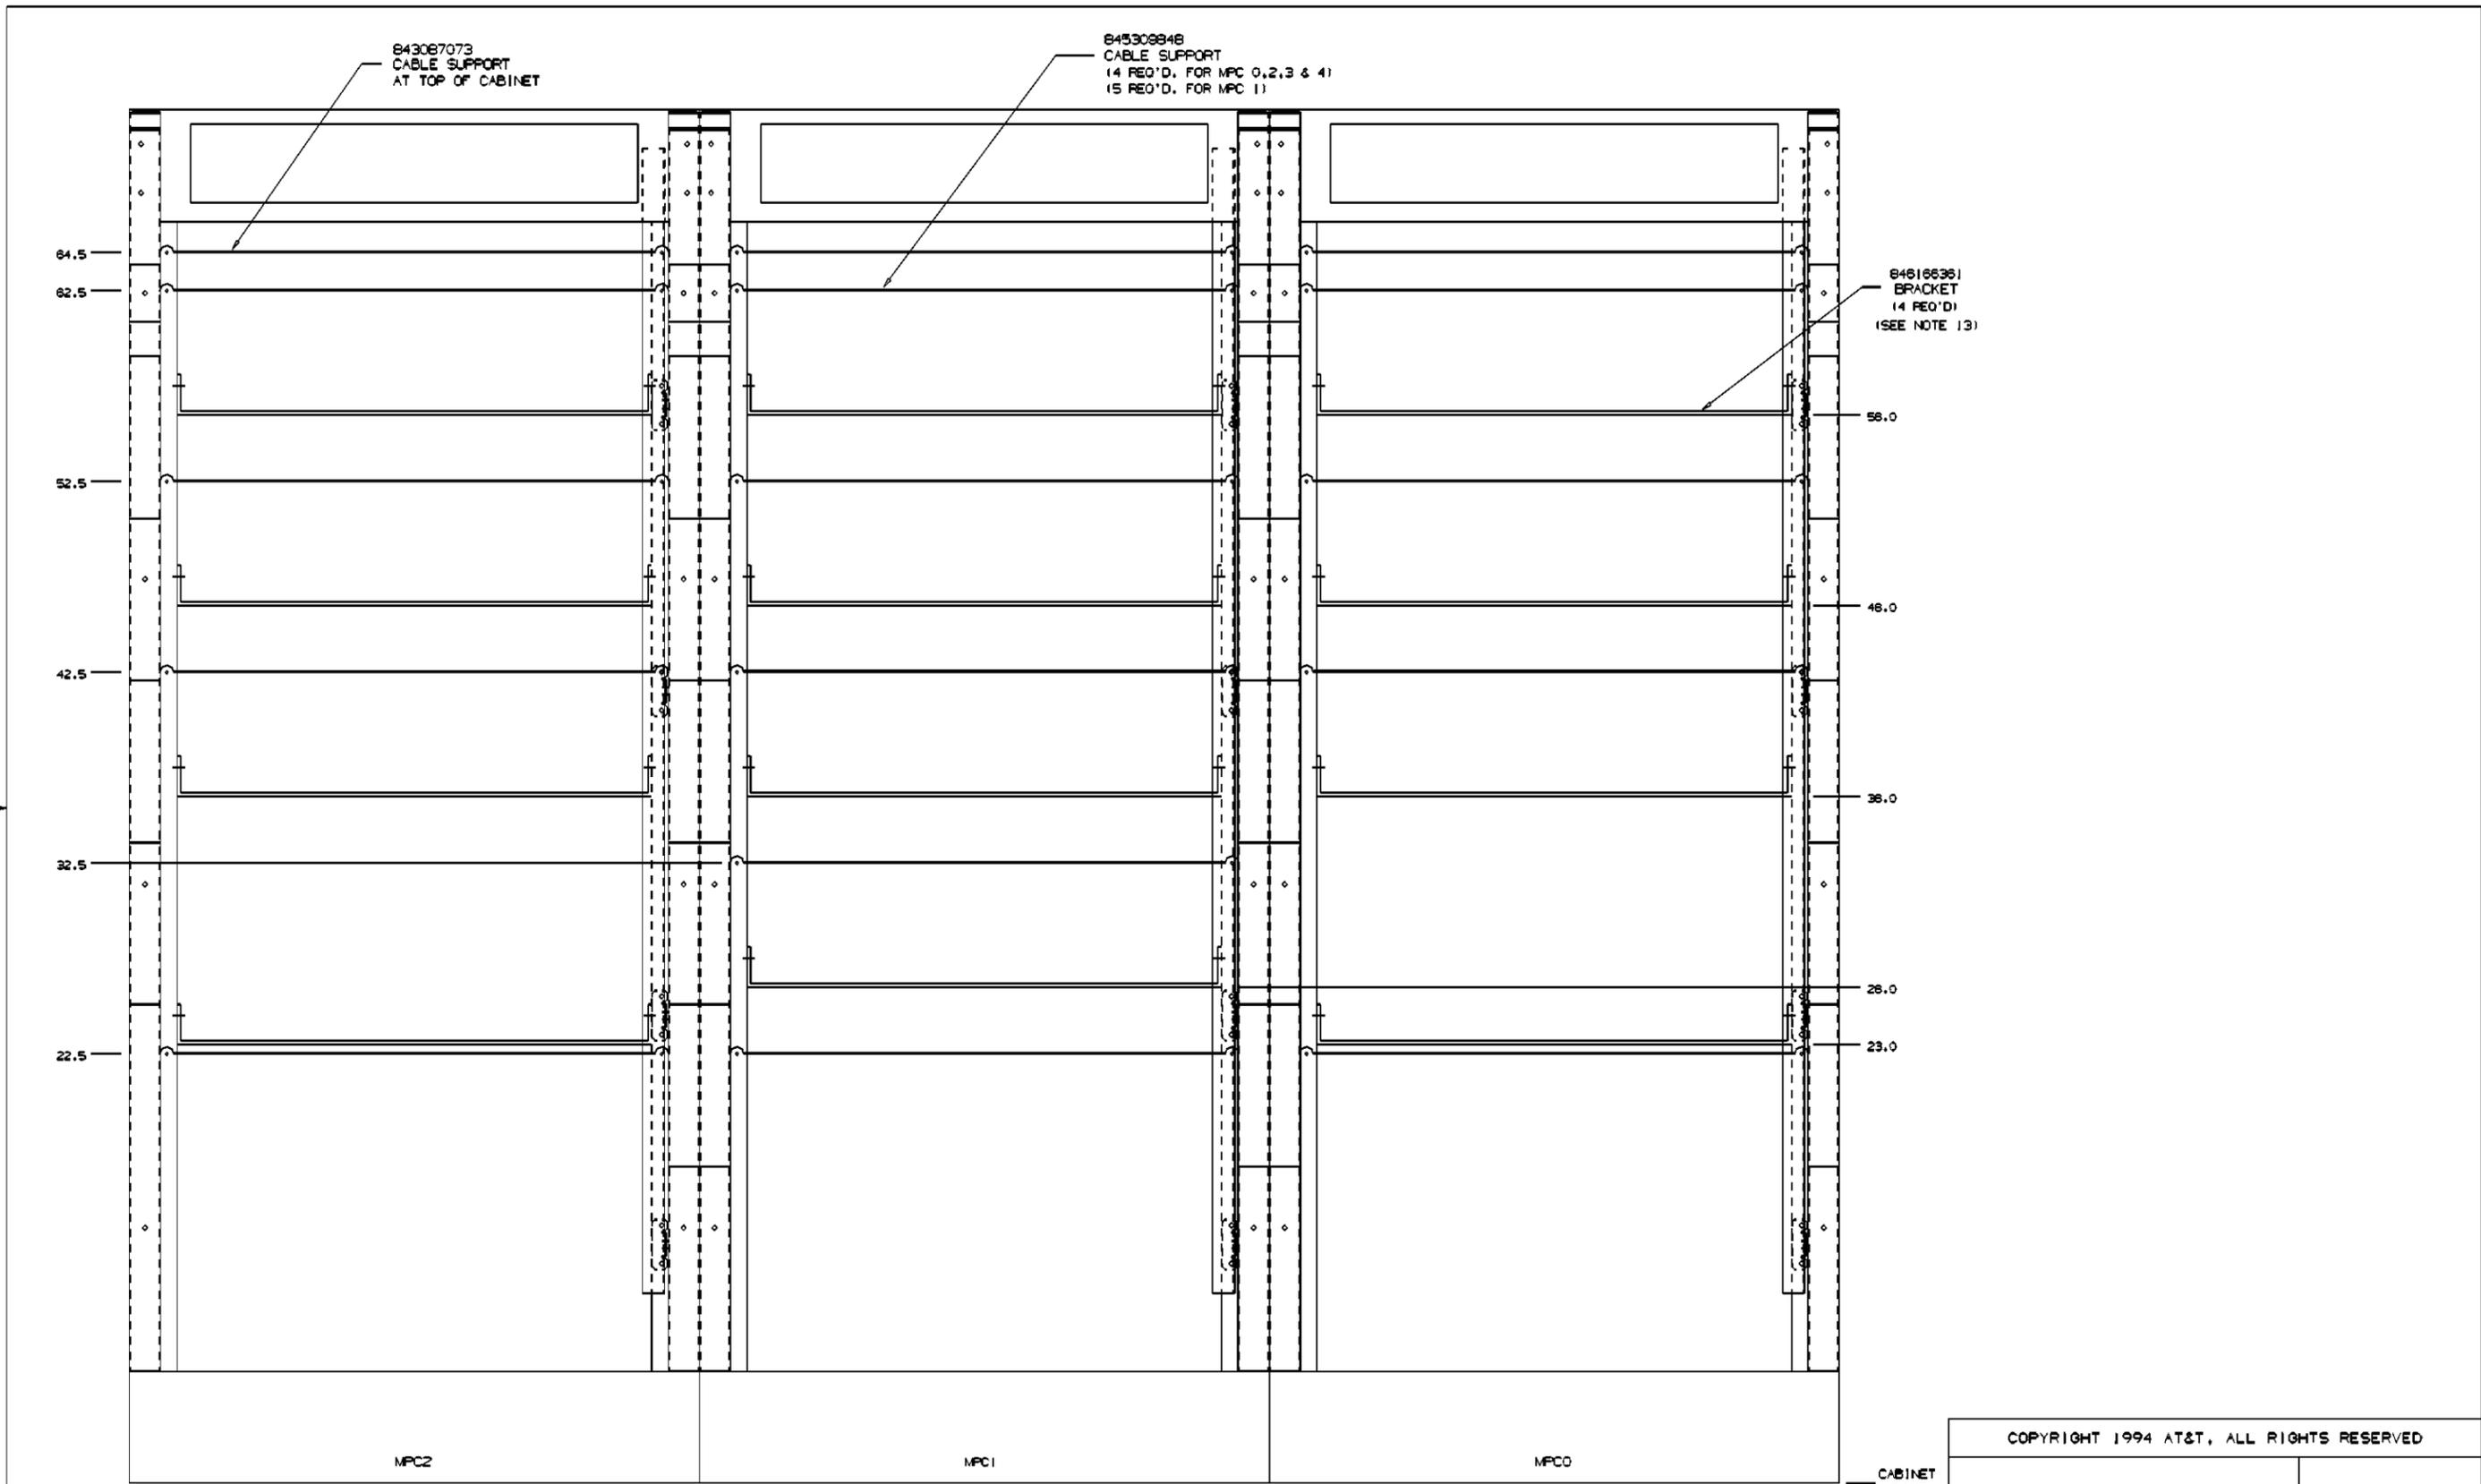


GROWTH
MPC 3 & 4

FIG. 9 (CONT)
REAR VIEW ED50741-1 CABINET
LOCATION OF CABLE SUPPORTS
AND BRACKETS


J5D007B-1

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	8
AT&T	J5D007B-1 <small>PRINTED IN U.S.A.</small>	SHEET B15

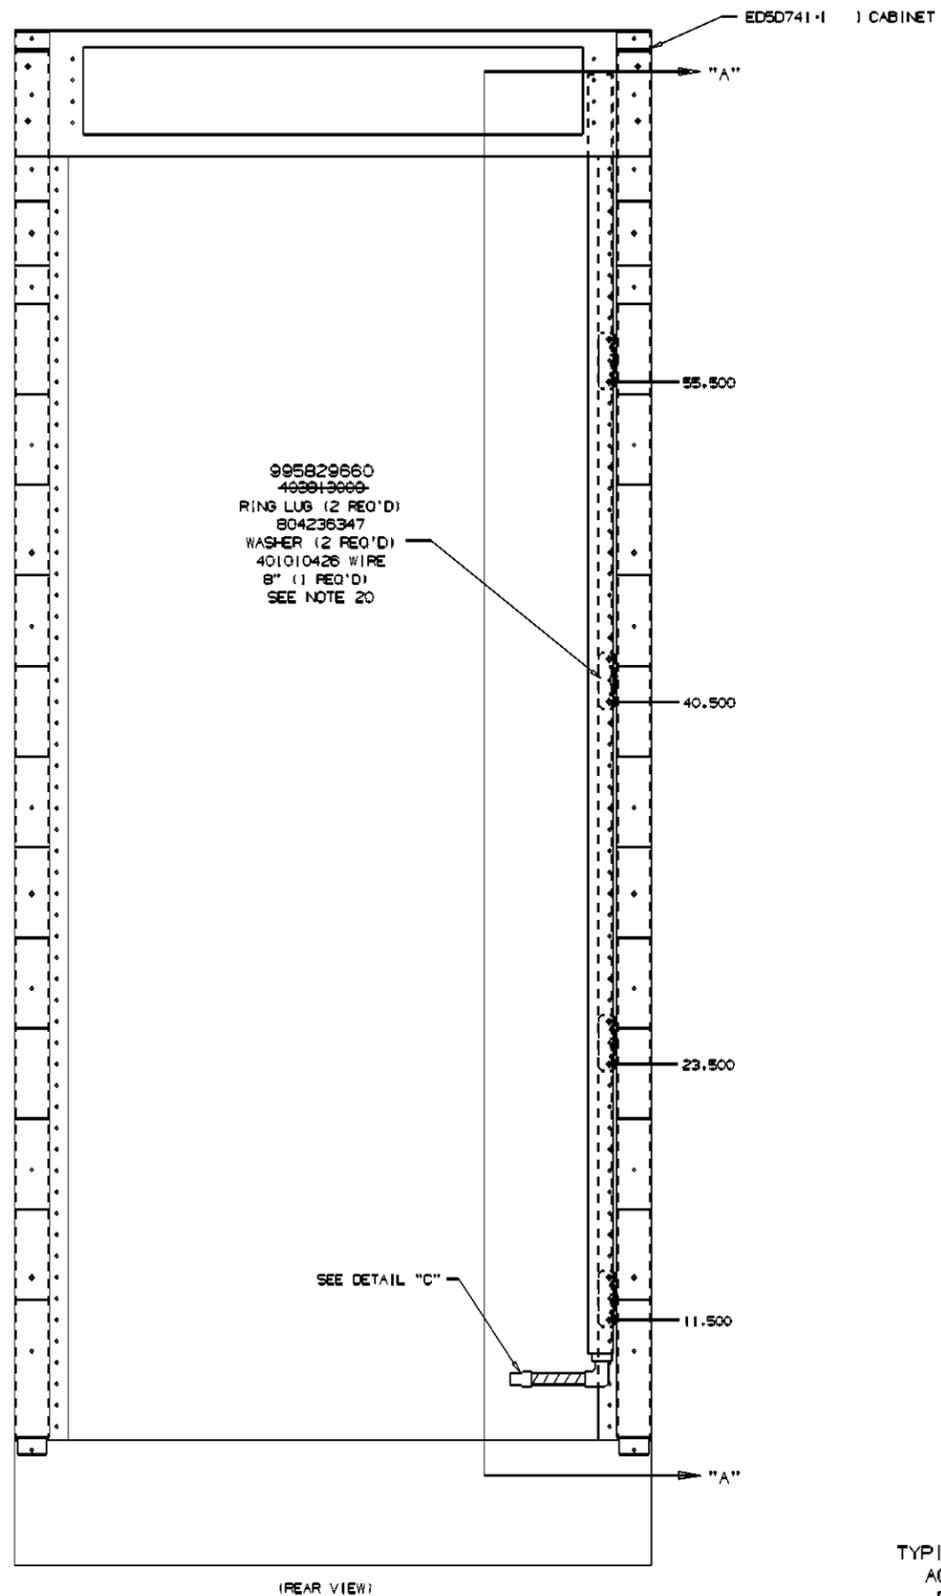


995829660
499813000
RING LUG (2 REQ'D)
804236347
WASHER (2 REQ'D)
401010426 WIRE
8\"/>

(REAR VIEW)

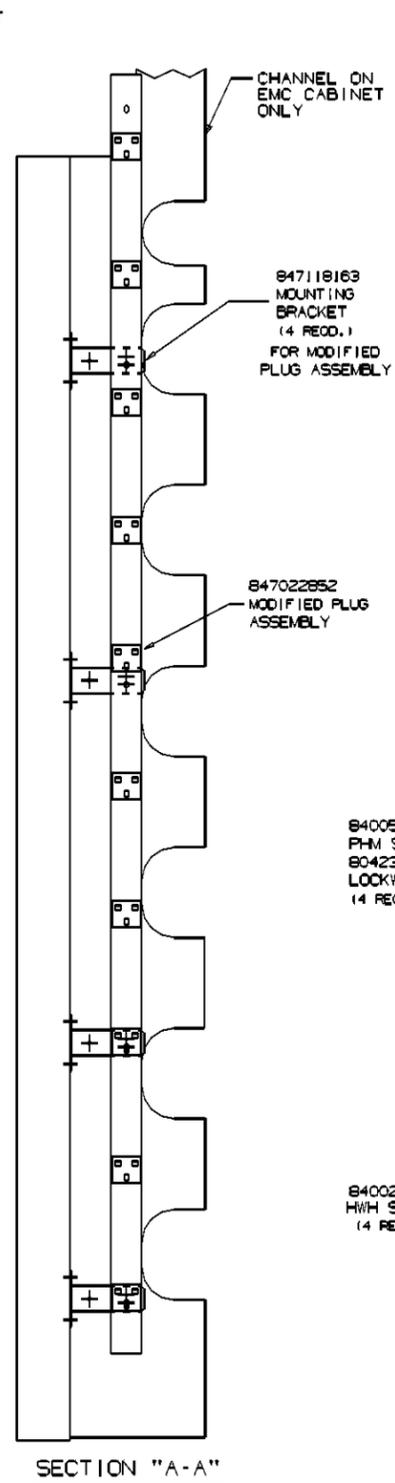


SECTION "A-A"

FIG. C
TYPICAL METHOD OF MOUNTING
AC POWER AND INVERTER
ED50741-1 CABINET


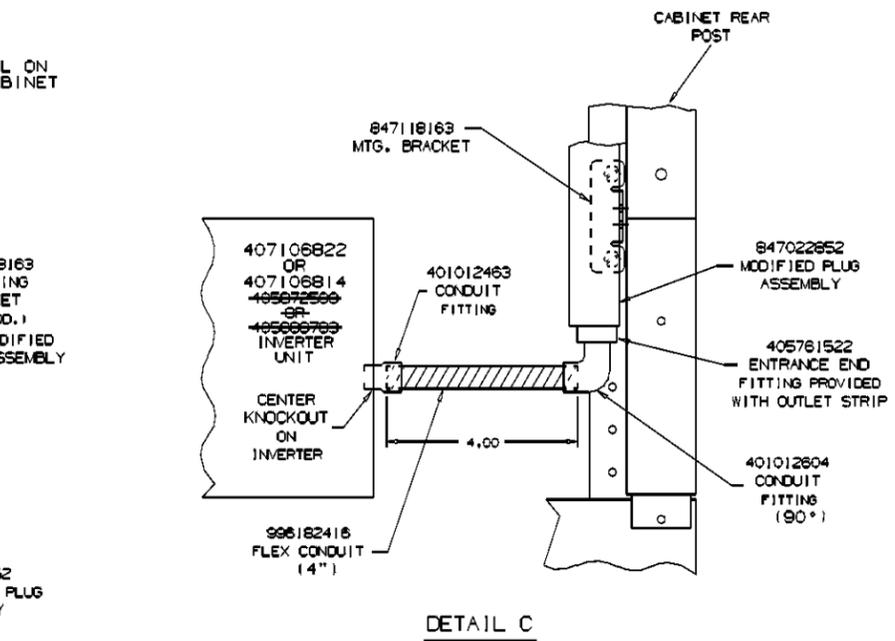


DETAIL C

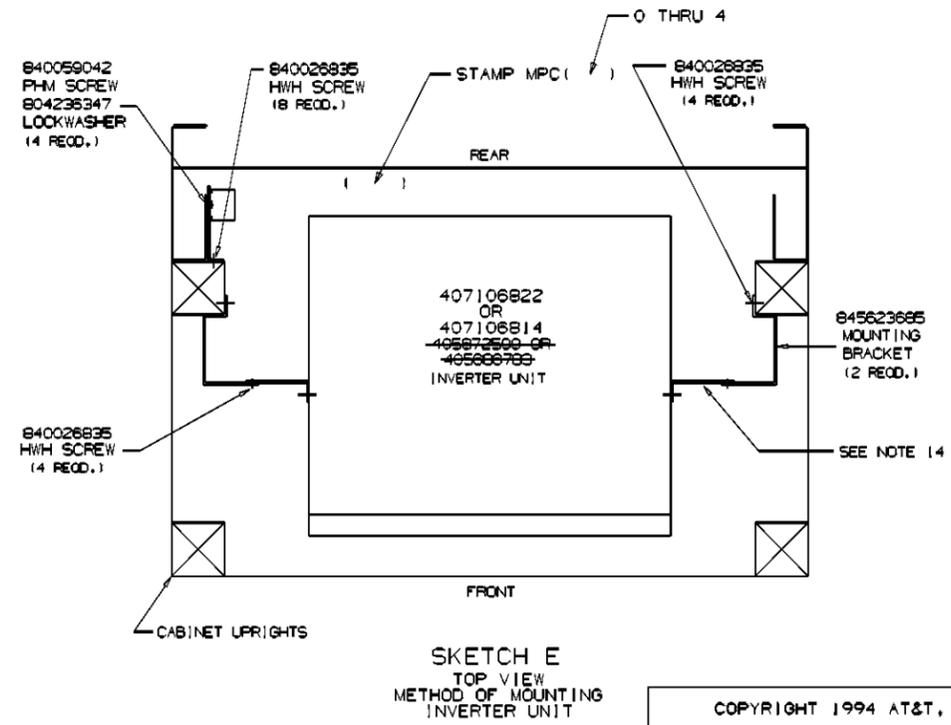


SKETCH E
TOP VIEW
METHOD OF MOUNTING
INVERTER UNIT

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	8
AT&T	J5D007B-1	SHEET B16

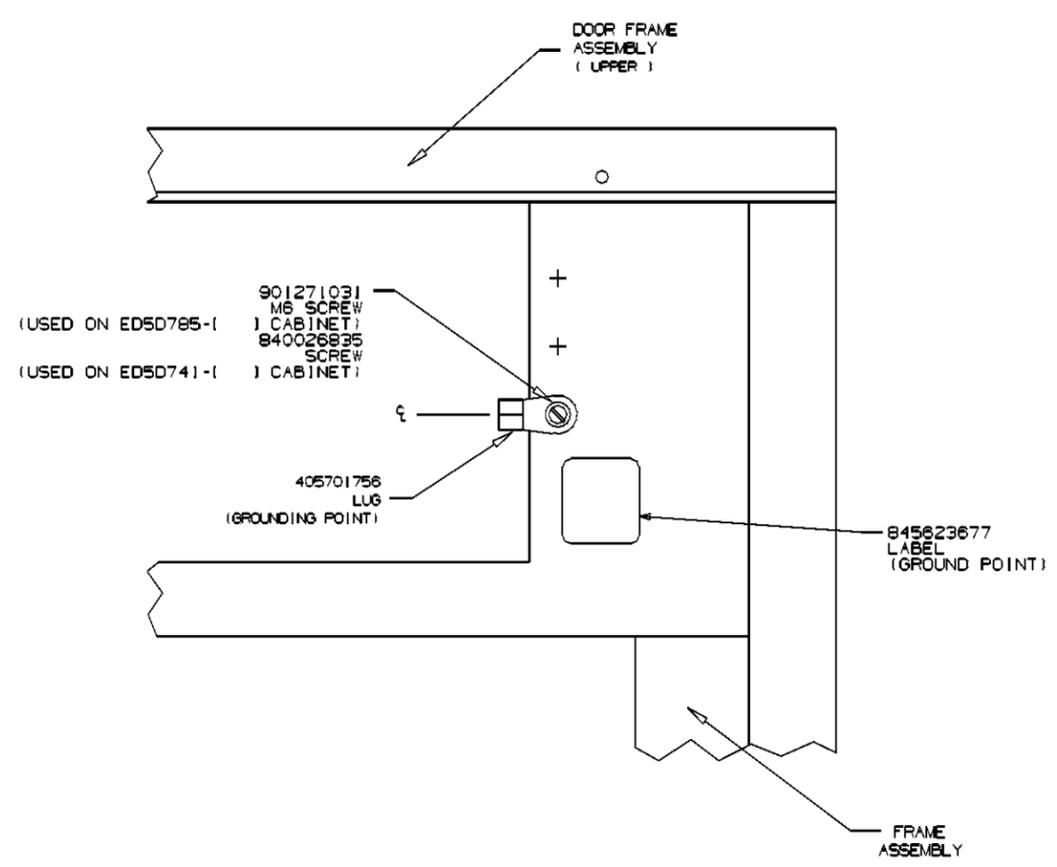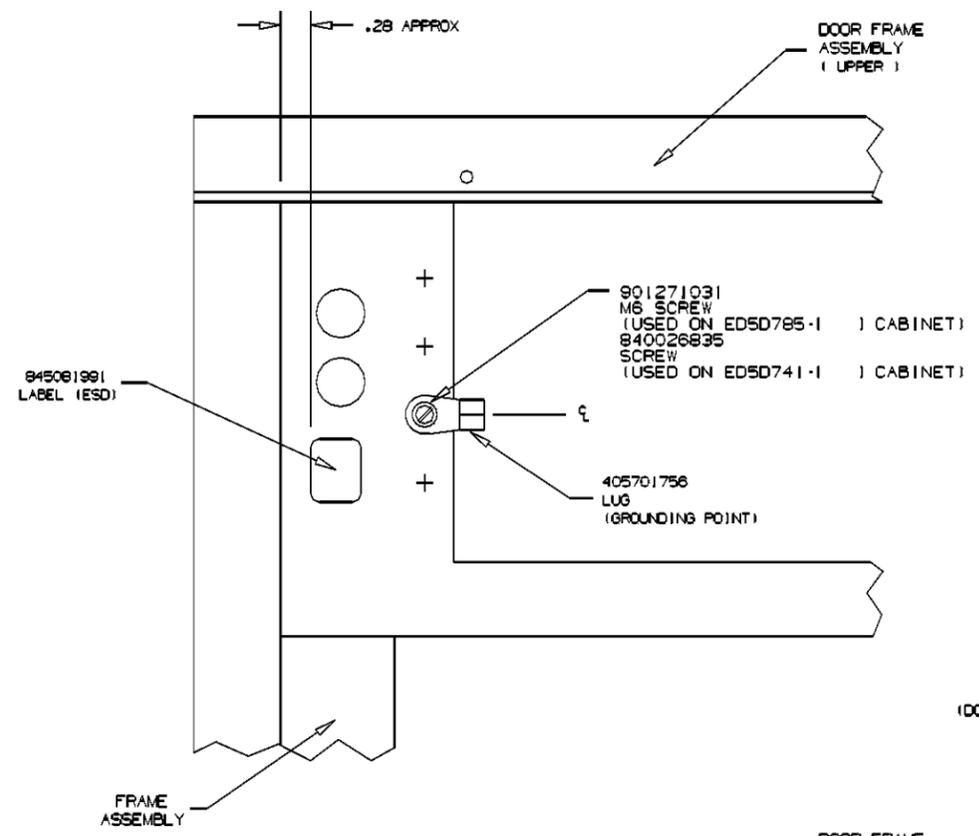


WIRING SIDE
(DOORS REMOVED FOR CLAIRITY)

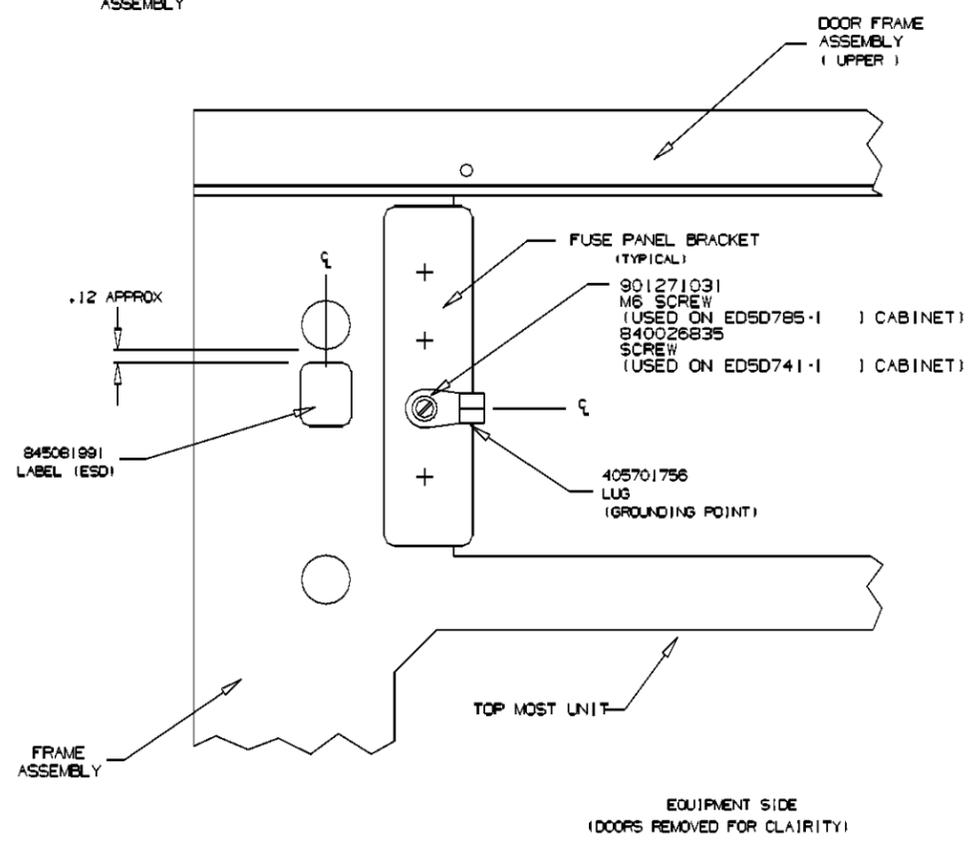

EQUIPMENT SIDE
(DOORS REMOVED FOR CLAIRITY)


FIG. D
TYPICAL ESD GROUNDING
ED50741-1 () CABINET
OR
ED50785-1 () CABINET

COPYRIGHT 1995 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	9
AT&T	J5D007B-1	SHEET B17

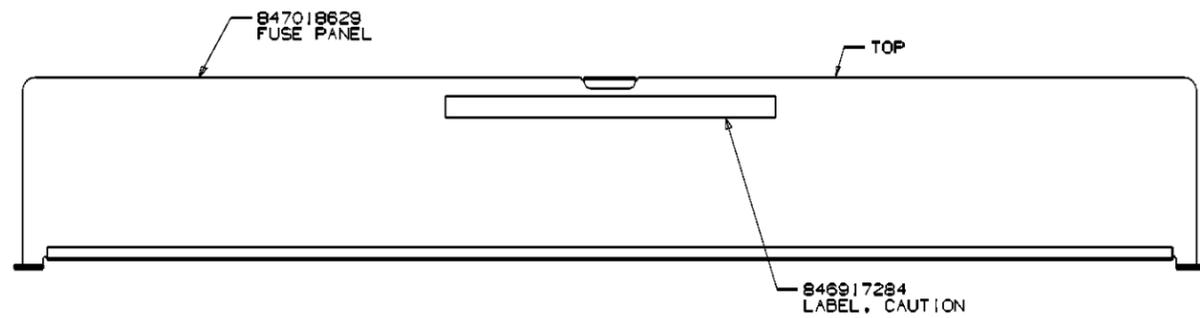


FUSE PANEL IN THE
CLOSED POSITION ED5D785-1
CABINET

SKETCH F

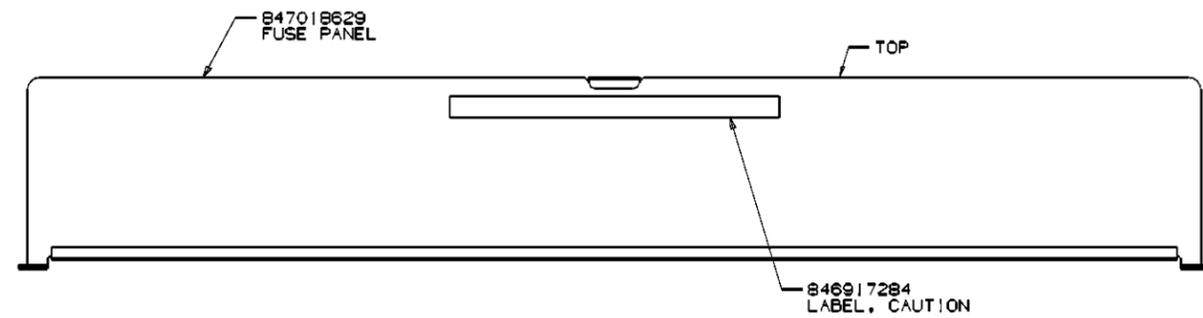


FUSE PANEL IN THE
CLOSED POSITION ED5D741-1
CABINET

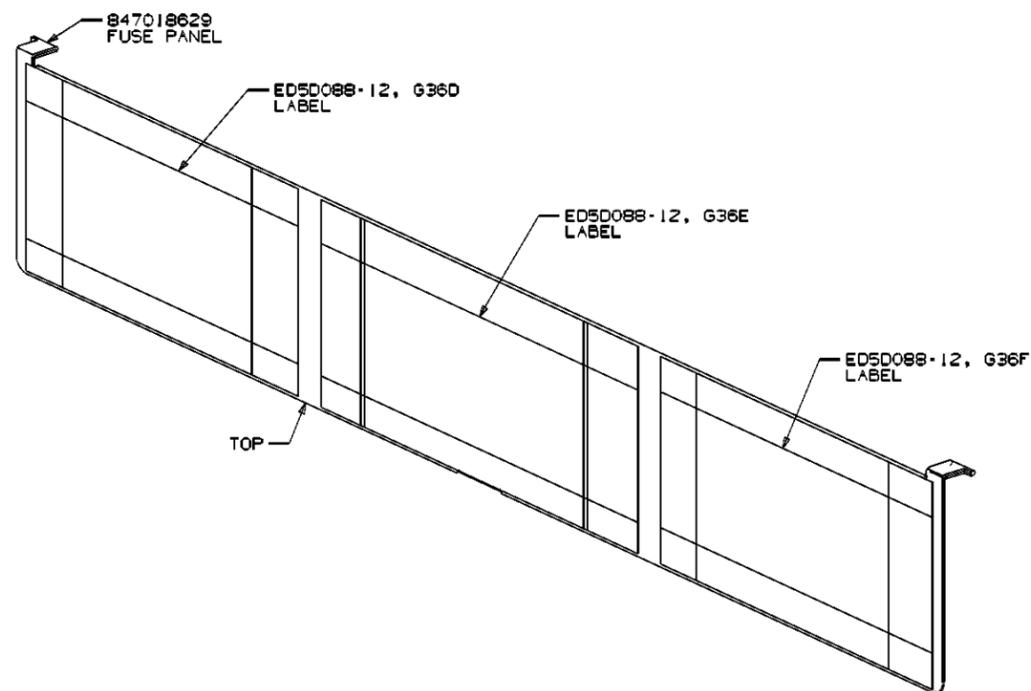

FUSE PANEL IN THE OPEN
POSITION ED5D785-1
CABINET

SKETCH G

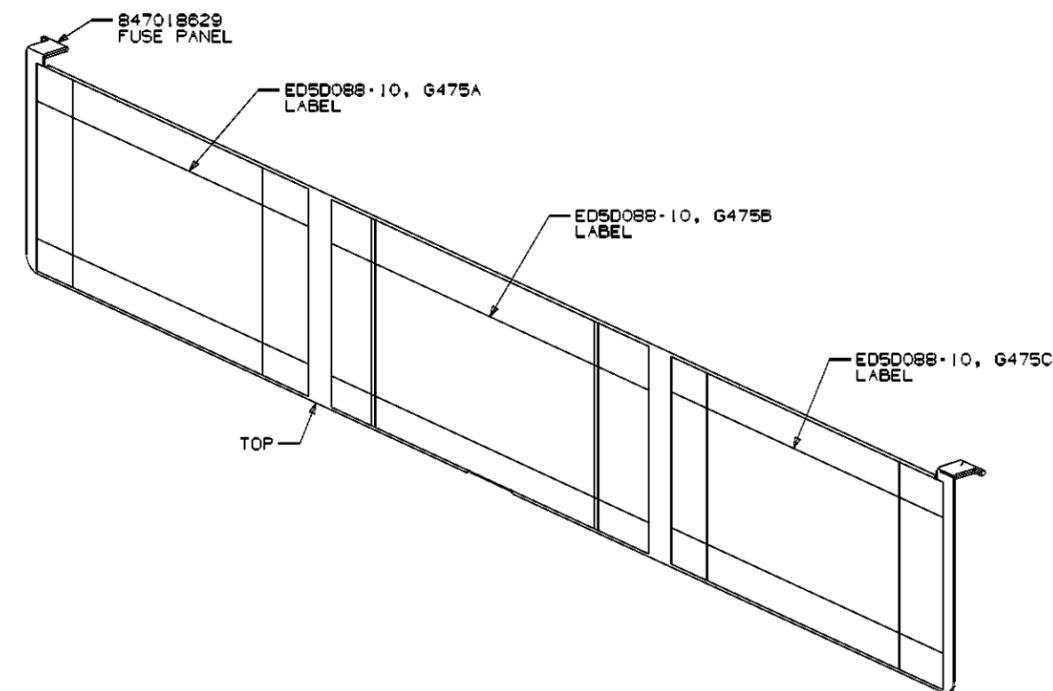

FUSE PANEL IN THE OPEN
POSITION ED5D741-1
CABINET

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	8
AT&T	J5D007B-1	SHEET B18

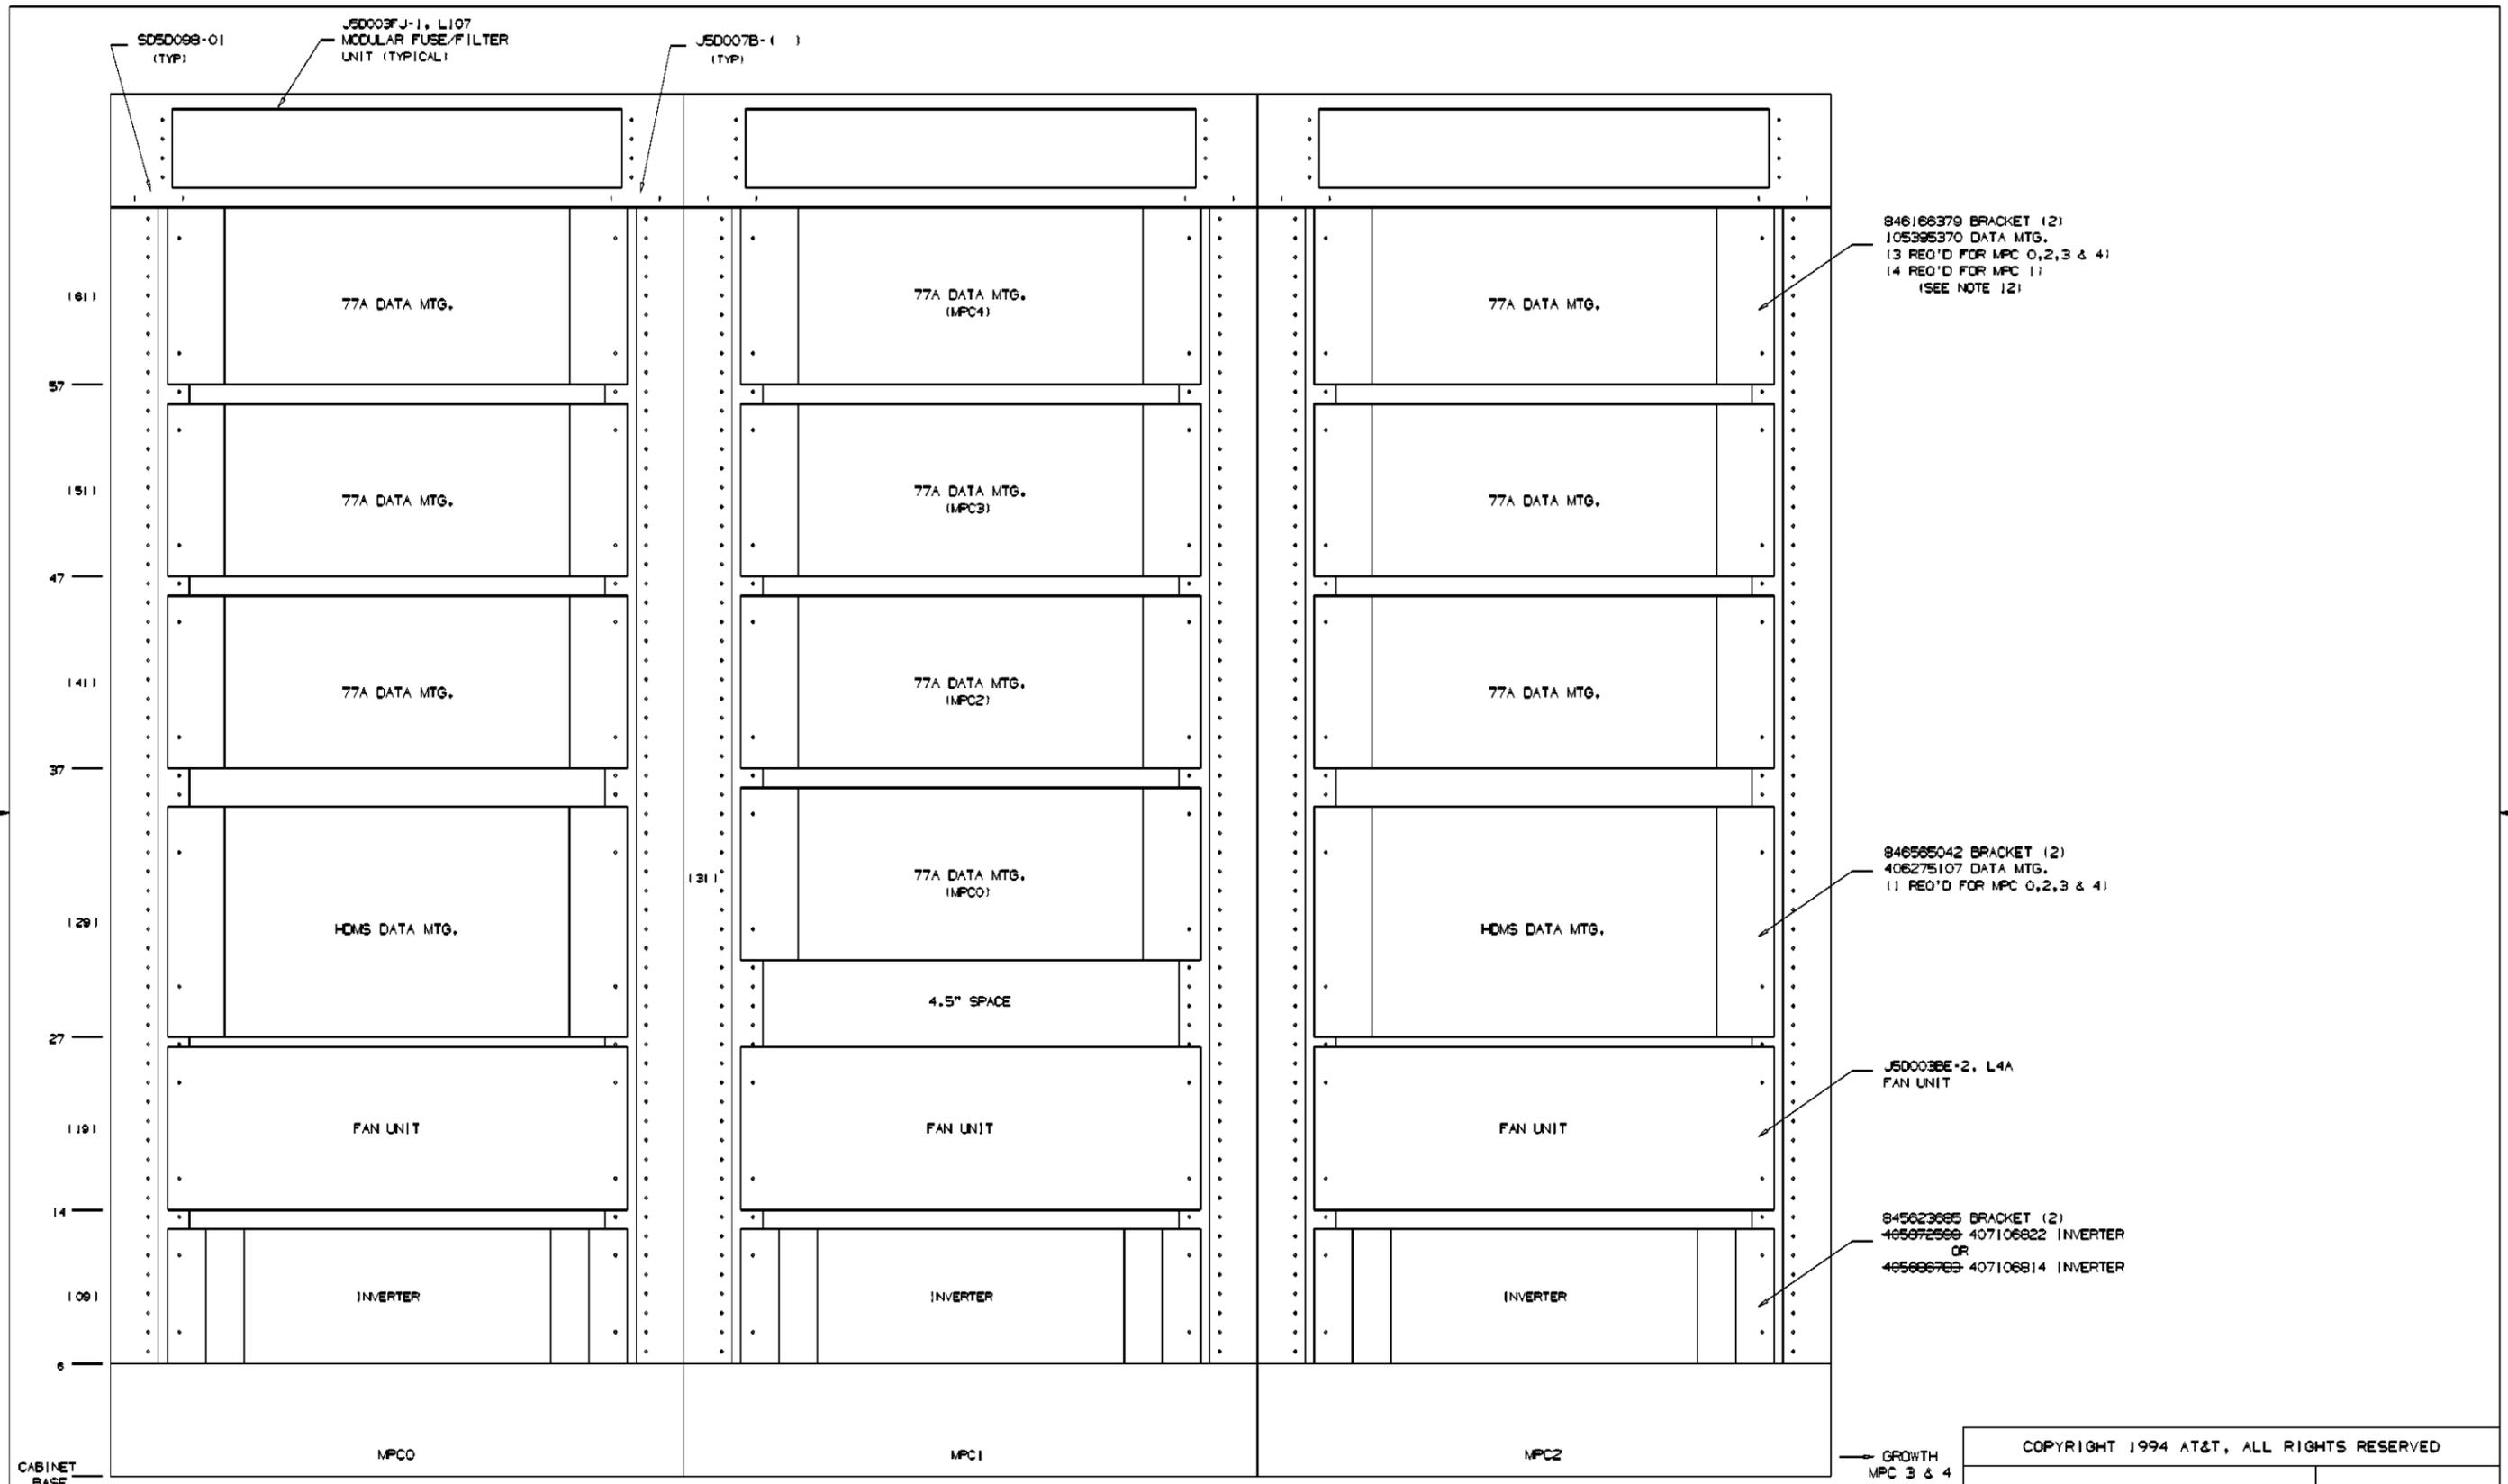


FIG. 10
FRONT VIEW ED50785-1) CABINET
EQUIPPED

J5D007B-1

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	7
AT&T	J5D007B-1	SHEET B19

PRINTED IN U.S.A.




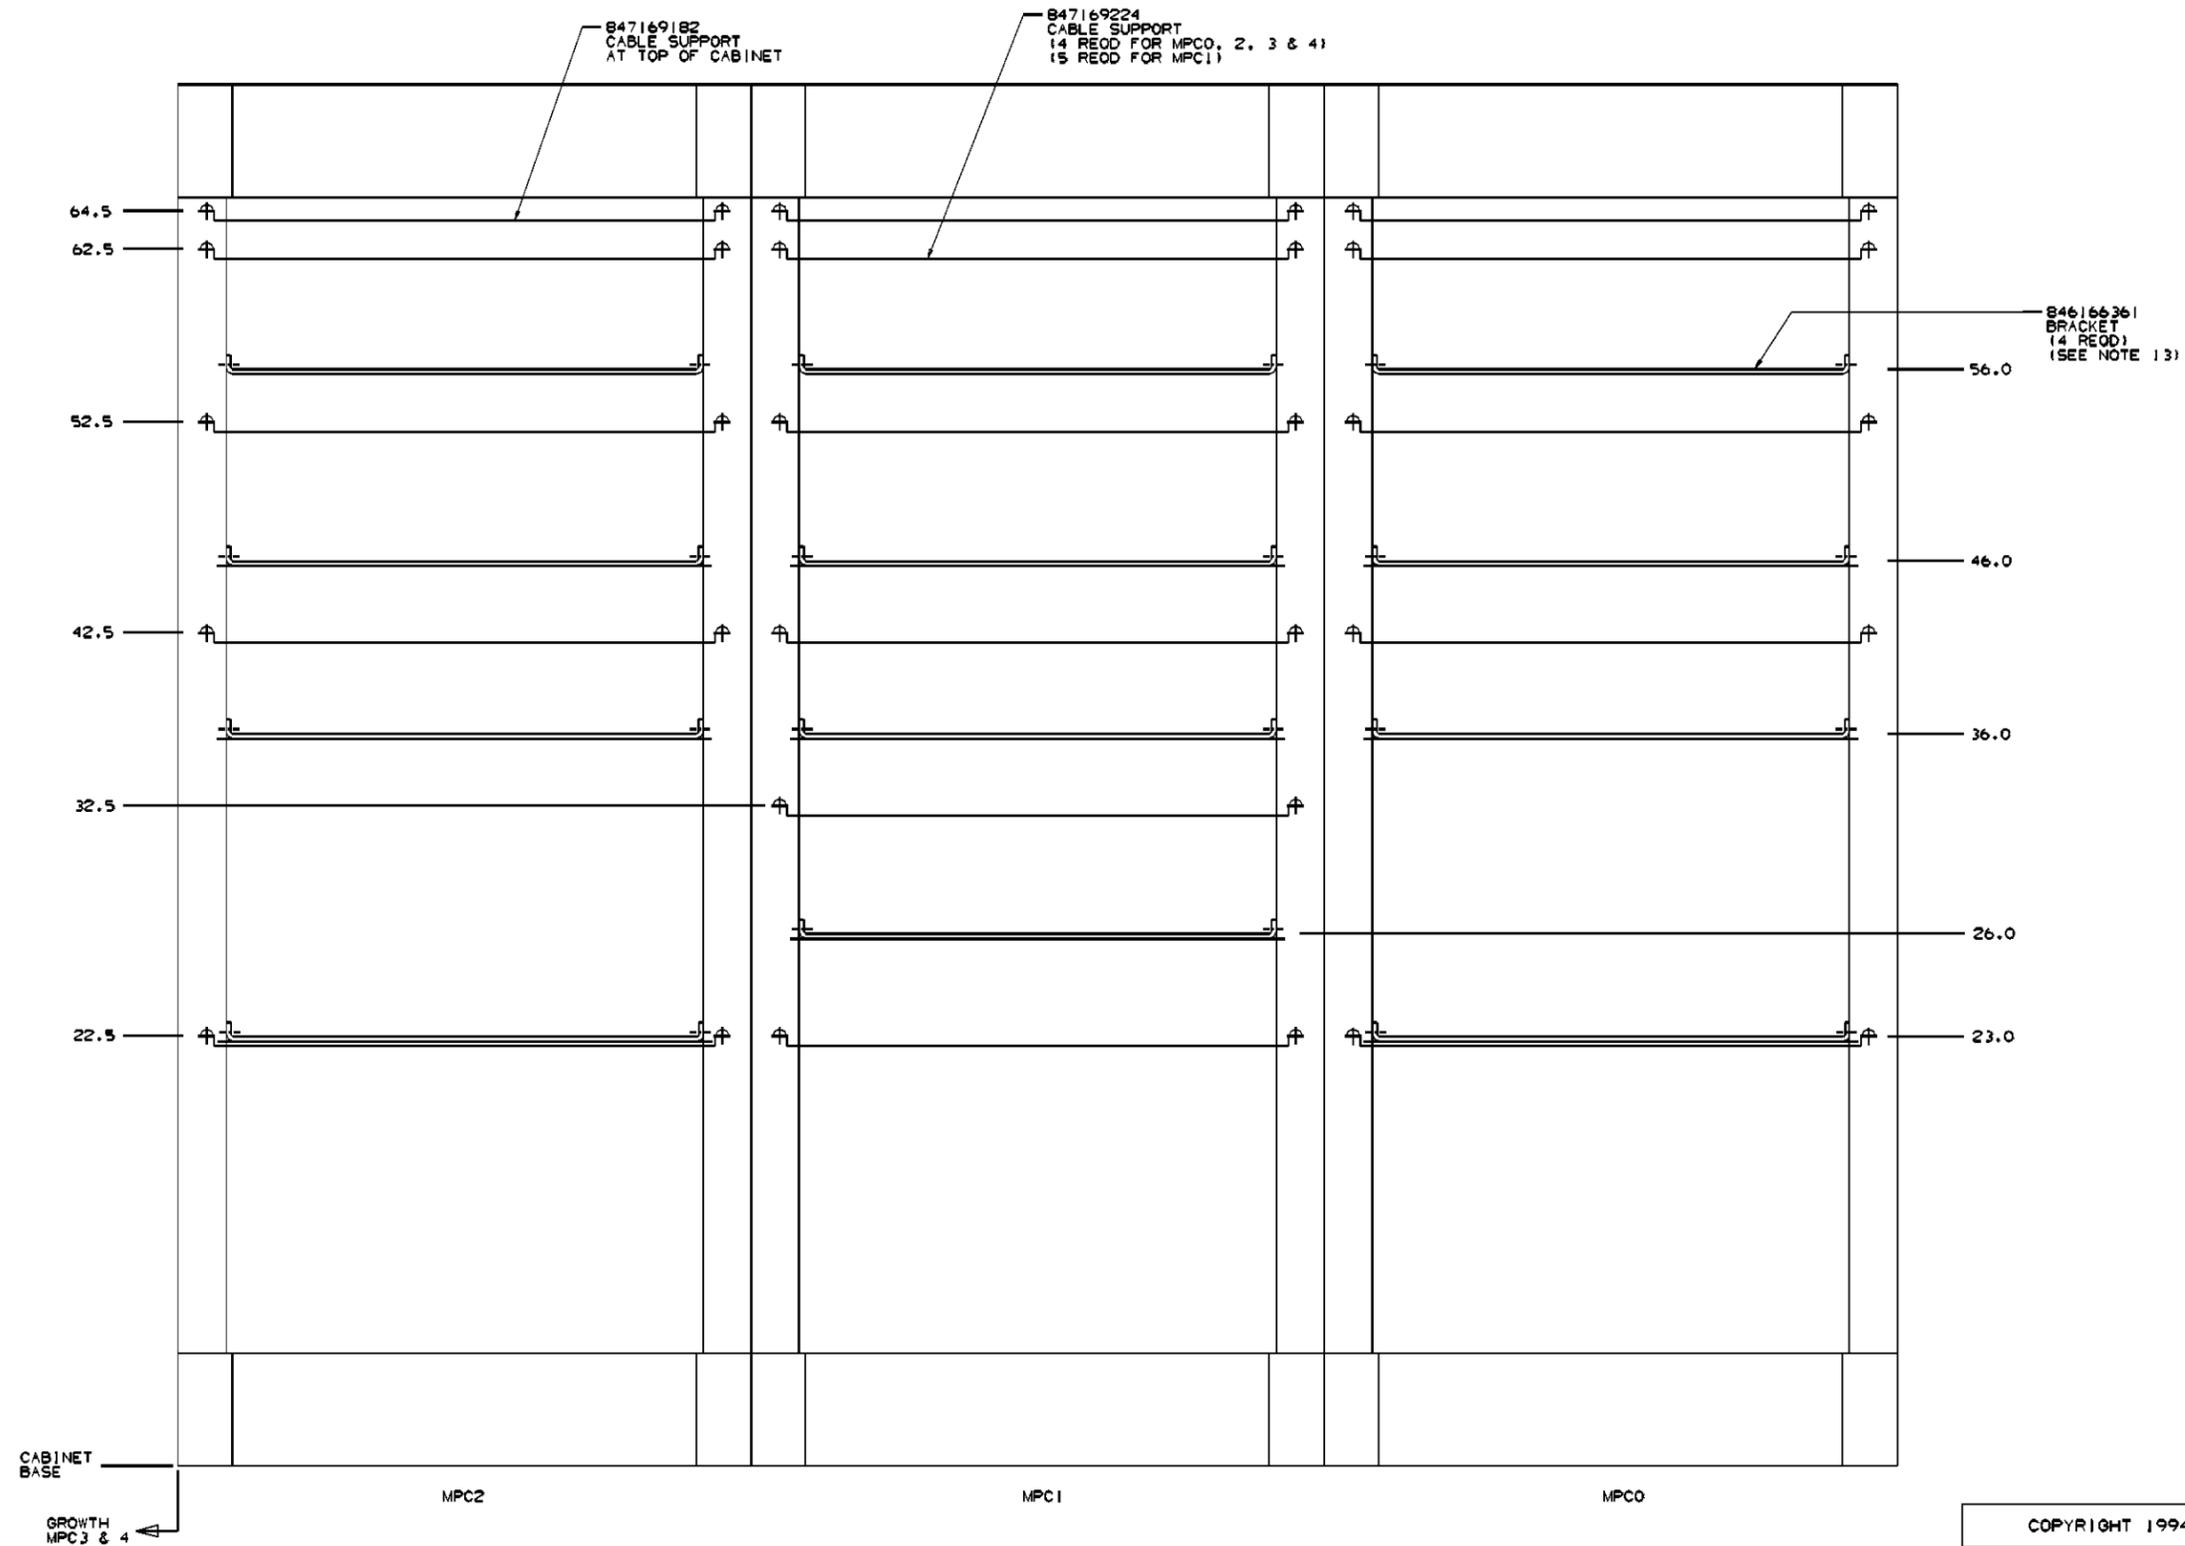


FIG. 10
REAR VIEW ED5D785-1) CABINET
LOCATION OF CABLE SUPPORTS
AND BRACKETS

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	7
AT&T	J5D007B-1	SHEET B20

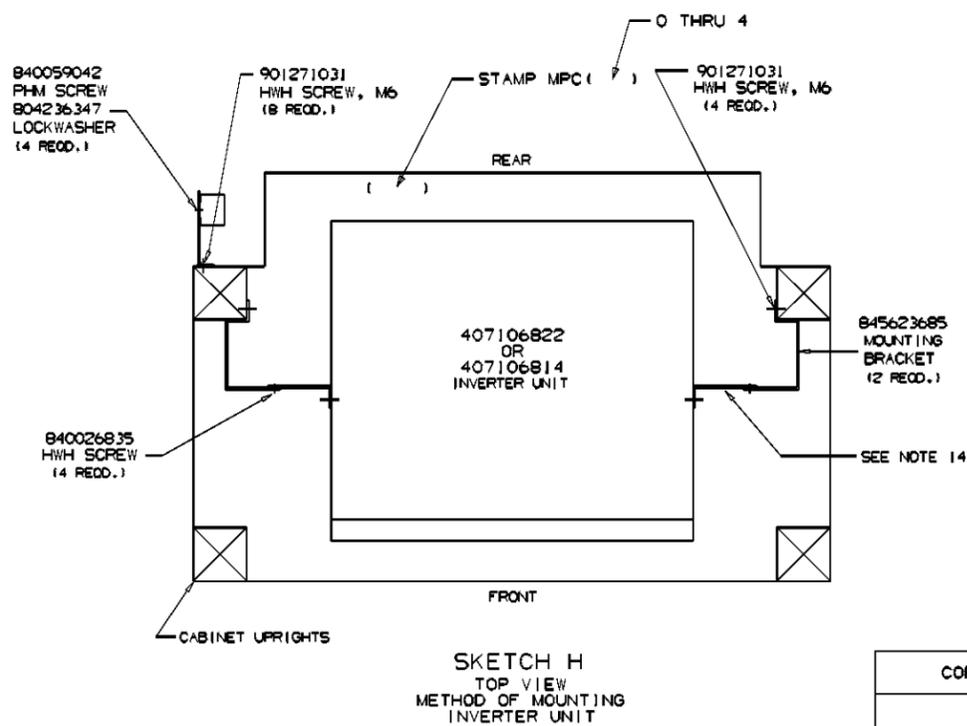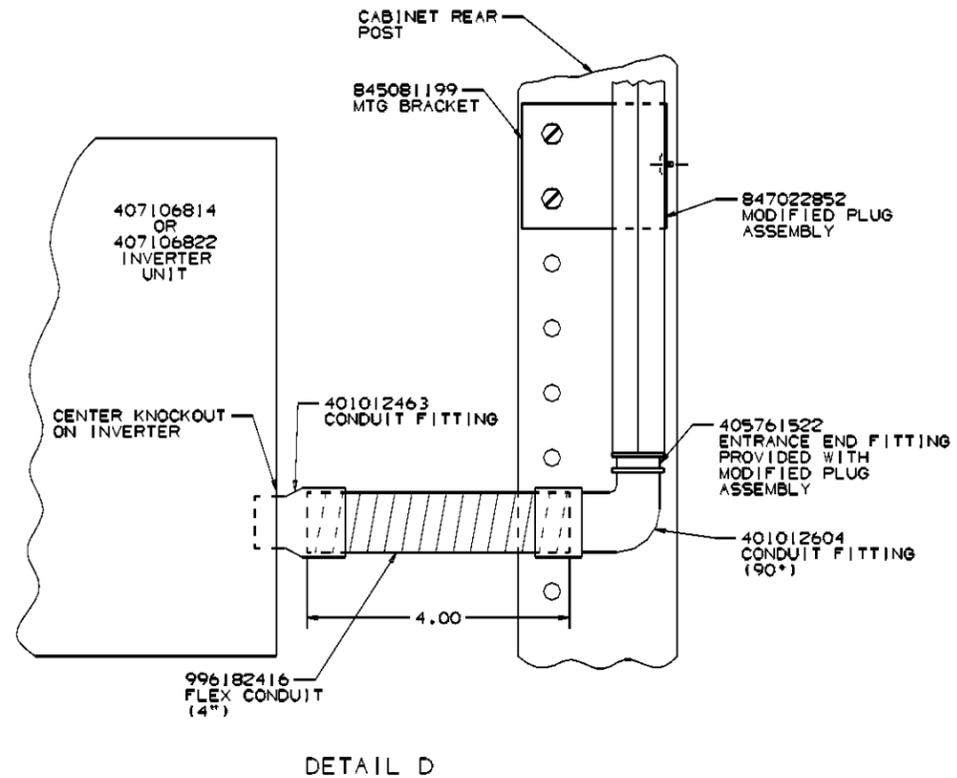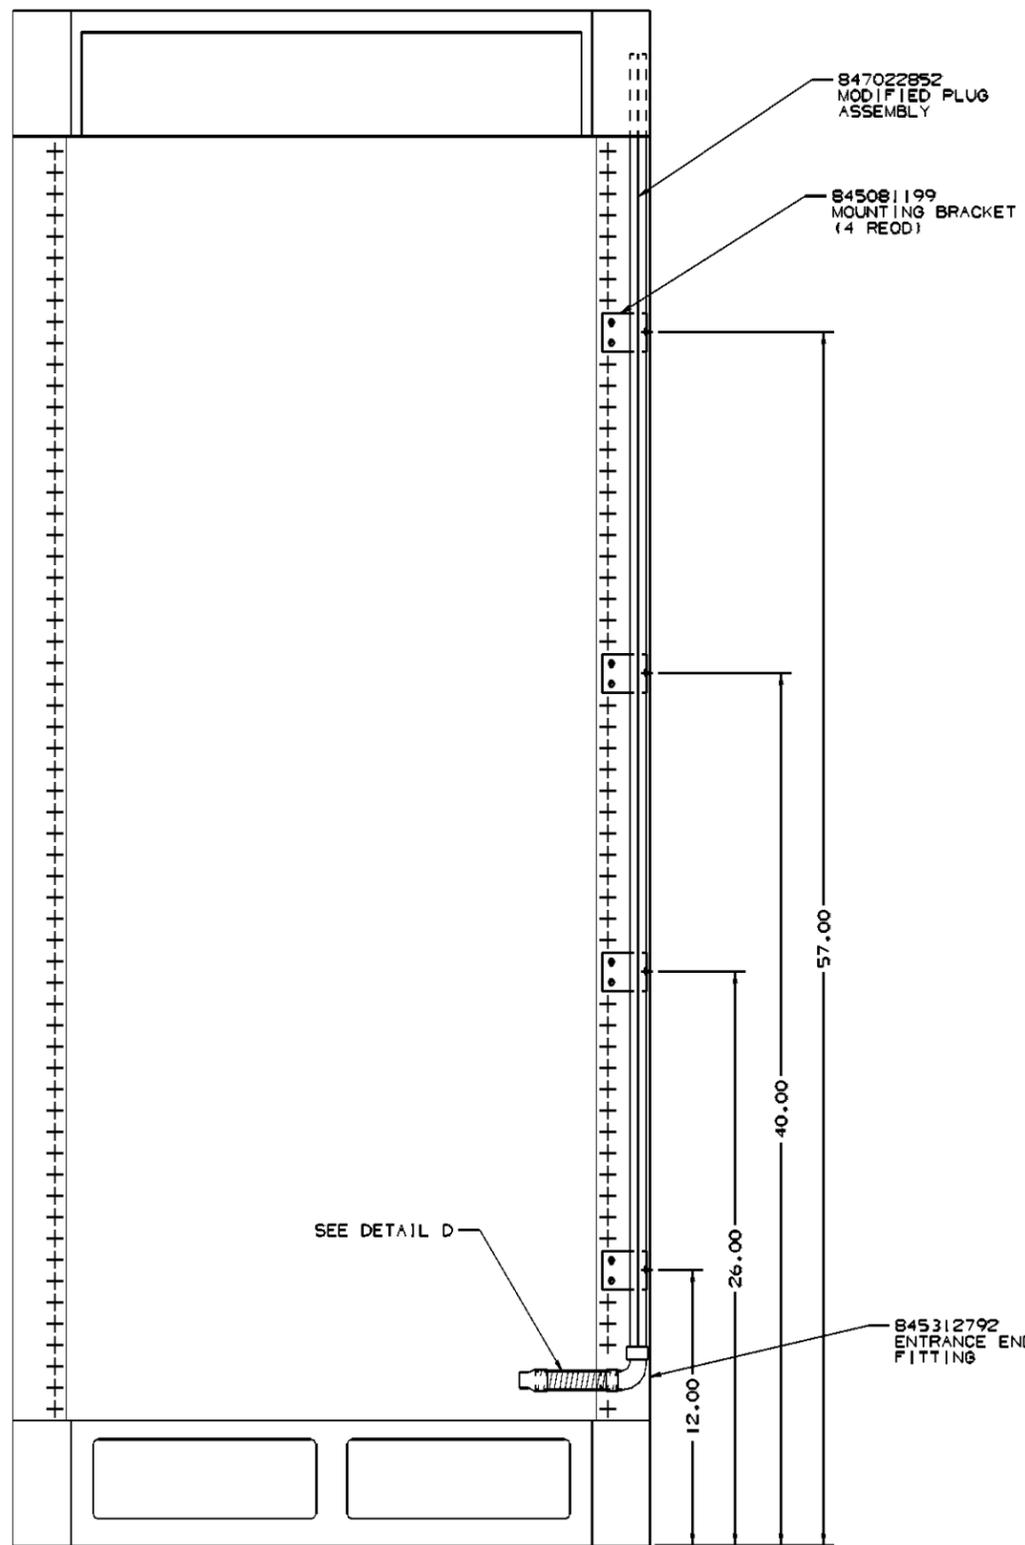

57.00	1447.80
56.00	1422.40
41.00	1041.40
40.00	1016.00
24.00	609.60
12.00	403.80
INCH	MM

CONVERSION TABLE

FIG. 11
REAR VIEW OF ED50785-1 CABINET
METHOD OF MOUNTING OF AC POWER
AND INVERTER

COPYRIGHT 1994 AT&T, ALL RIGHTS RESERVED		
MODEM POOLING CABINET	DWG SIZE	ISSUE
	C2	7
AT&T	J5D007B-1	SHEET B21

STOCKLIST								
ITEM NBR	LIST GROUP CODE	QTY PER CODE	PRODUCT IDENTIFIER	CODE	DESCRIPTION	REFERENCE POSITION	NOTE	
							SYM	NBR
1231	3A	1	407106814	WP91652L20A	INVERTER			
1240	4,46	1	105395370	77A	MOUNTING, DATA			
1250	4,46	1	405704032	WP90780L3	CABLE ASSEMBLY			
1260	4,46	1	846166361		BRACKET DATA MOUNTING SUPPORT			
1270	4,46	2	846166379		BRACKET 77A DATA MOUNTING			
1280	4	1	845309848		ASSEMBLY, CABLE SUPPORT			
1281	46	1	847169232		ROD, ROUND			
1290	4	8	840026835		SCREW, TTF SLOTTED HEX, WASHER HD .216-24 X 5/8 TAPPING TYPE (SWAGE FORM) STEEL ZINC PLATE 289A FINISH			
1291	46	8	901271031		SCREW, HEXAGON WASHER HEAD M6 X 16 STEEL, ZINC OLIVE DRAB CHROMATE FINISH THREAD FORMING QUALITY SCREW & NUT CO.			
1300	5	1	105545318	7500A-L2	UNIT, SERVICE DATA			
1301	5	1	105657639	7500B-L1	SERVICE, DATA UNIT CLEI = NCFTAB0BAA			
1310	5	1	102269669	M25B-87	CORD 4FT			
1320	6	1	105267611	106A3	MOUNTING, DATA			
1330	6	1	846166361		BRACKET DATA MOUNTING SUPPORT			
1340	6	2	846166387		BRACKET 106A3 DATA MOUNTING			
1350	6	1	845309848		ASSEMBLY, CABLE SUPPORT			
1360	6	6	840026835		SCREW, TTF SLOTTED HEX, WASHER HD .216-24 X 5/8 TAPPING TYPE (SWAGE FORM) STEEL ZINC PLATE 289A FINISH			
1370	7	1	105241099	2224G-L1/2/3	SET, DATA			
1371	7	1	105660112	2224G-L1A/2/3	SET, DATA		S	
1380	8	1	103982120	2324A1	UNIT, DATA CONTROL		S	
1390	9	1	J5D003AU-2,L7		UNIT, FUSE/FILTER		S	
1400	10	1	105578466	105A1	MOUNTING, DATA			
1410	10	1	846166361		BRACKET DATA MOUNTING SUPPORT			
1420	10	2	846565026		BRACKET, MOUNTING			
1425	10,12,47	1	406275107		MOUNT, DATA #HD CHASSIS MICROCOM HDMS			
1426	10,12,47	2	846565042		PLATE, MOUNTING			
1430	10,12	8	840026835		SCREW, TTF SLOTTED HEX, WASHER HD .216-24 X 5/8 TAPPING TYPE (SWAGE FORM) STEEL ZINC PLATE 289A FINISH			
1440	13	1	406857649		MODEM, COMMUNICATIONS #HD2400C MICROCOM		S	
1450	11	1	105246573	2296A1/2/3	SET, DATA		S	
1460	A	1	ED5D621-20,G1B		ASSEMBLY, CABLE			
1470	B	2	ED5D184-76,G1		HARDWARE		S	
1480	C	2	ED5D184-76,G2		HARDWARE		S	
1500	1A,31,48	1	J5D003FJ-1,L107		UNIT, MODULAR, FUSE/FILTER			
1505	1A,31	4	840026835		SCREW, TTF SLOTTED HEX, WASHER HD .216-24 X 5/8 TAPPING TYPE (SWAGE FORM) STEEL ZINC PLATE 289A FINISH			

***** STOCKLIST CONTINUED AT RIGHT *****

J5D007B-1

STOCKLIST								
ITEM NBR	LIST GROUP CODE	QTY PER CODE	PRODUCT IDENTIFIER	CODE	DESCRIPTION	REFERENCE POSITION	NOTE	
							SYM	NBR
1506	48	4	901271031		SCREW, HEXAGON WASHER HEAD M6 X 16 STEEL, ZINC OLIVE DRAB CHROMATE FINISH THREAD FORMING QUALITY SCREW & NUT CO.			
1510	1A,31	1	ED5D088-10, G475A,G475B, G475C		LABEL, FUSE			
1513	48	1	ED5D088-12,G36D, G36E,G36F		LABELS, FUSE			
1514	48	1	ED5D088-12,G70		LABELS, FUSE POS 014-B			
1515	48	1	ED5D088-12,G71		LABELS, FUSE POS 014-A			
1516	48	1	ED5D088-12,G72		LABELS, FUSE POS 109-A			
1517	48	1	ED5D088-12,G73		LABELS, FUSE POS 109-B			
1520	1A,31	1	ED5D088-10,G561		LABEL, FUSE POS 109-A			
1530	1A,31	1	ED5D088-10,G562		LABEL, FUSE POS 014-A			
1540	1A,31,48	4	406693895	WP91768L108	FUSE, 3.00 AMP FAST ACTING POS 014-A,B,109-A,B			19
1550	1A	1	ED5D693-15,G3, G4		ASSEMBLY, CABLE CONNECTORIZED			
1555	12	4	840026835		SCREW, TTF SLOTTED HEX, WASHER HD .216-24 X 5/8 TAPPING TYPE (SWAGE FORM) STEEL ZINC PLATE 289A FINISH			
1560	12	1	845309848		ASSEMBLY, CABLE SUPPORT			
1561	47	1	847169232		ROD, ROUND			
1570	12,47	1	846166361		BRACKET DATA MOUNTING SUPPORT			
1580	47	8	901271031		SCREW, HEXAGON WASHER HEAD M6 X 16 STEEL, ZINC OLIVE DRAB CHROMATE FINISH THREAD FORMING QUALITY SCREW & NUT CO.			
1590	30	1	ED5D741-70,G1		ASSEMBLY, CABINET			
1600	30,37,39, 40,41	1	845623677		LABEL, GROUND POINT			
1610	30,37,39	17	840026835		SCREW, TTF SLOTTED HEX, WASHER HD .216-24 X 5/8 TAPPING TYPE (SWAGE FORM) STEEL ZINC PLATE 289A FINISH			
1620	30,37,39, 40,41	1	847022852		ASSEMBLY, OUTLET STRIP			
1630	30,37,39	4	847118163		BRACKET, MOUNTING			
1640	30,37,39, 40,41	4	804236347	P423634	WASHER, EXTERNAL TOOTH LOCK .190 STEEL 289A FINISH			
1650	30,37,39, 40,41	4	840059042		SCREW, PAN HEAD MACHINE .164-32 X 1/4 STEEL 289A FINISH			
1660	30,37,39	8	804236362	P423636	WASHER, EXTERNAL TOOTH LOCK .250 STEEL 289A FINISH			

STOCKLIST CONTINUED ON SHEET D3

COPYRIGHT © 1995 AT&T
ALL RIGHTS RESERVED

BT13

5ESS* SWITCHING EQUIPMENT
SPECIFICATION FOR
MODEM POOLING CABINET
* AT&T TRADEMARK

DWG SIZE
C2

ISSUE
10

AT&T

J5D007B-1

SHEET D2
OF 28

PRINTED IN U.S.A.

STOCKLIST								
ITEM NBR	LIST GROUP CODE	QTY PER CODE	PRODUCT IDENTIFIER	CODE	DESCRIPTION	REFERENCE POSITION	NOTE	
							SYM	NBR
1670	30,37,39,40,41	2	845081991		LABEL, ESD			
1680	30,37,39,40,41	3	405701756		TERMINAL, LUG #M8-14R/SX 3M CO.			
1685	40,41	1	901271031		SCREW, HEXAGON WASHER HEAD M6 X 16 STEEL, ZINC OLIVE DRAB CHROMATE FINISH THREAD FORMING QUALITY SCREW & NUT CO.			
1690	30	2	403813009		LUG, TERMINAL #C1=203 3M CO.			21
1691	30,37,39,40,41	2	995829660		LUG, TERMINAL #C71 STA-KON THOMAS & BETTS CO.			21
1700	30,37,39,40,41	2	804236347	P423634	WASHER, EXTERNAL TOOTH LOCK .190 STEEL 289A FINISH			21
1710	30,37,39,40,41	1	401010426	KS20747	WIRE 12 GA SOLID 1 CONDUCTOR GREEN TYPE THW			21
1720	30,37,39	1	843087073		SUPPORT, CABLE			
1721	40,41	1	847169182		ROD, ROUND			
1730	30,37,39,40,41	1	406748145		LUG, TERMINAL #M10-14FLX 3M CO.			
1740	30,37,39,40,41	1	405811845		TERMINAL #137 H.H. SMITH			
1750	32	4	840026835		SCREW, TTF SLOTTED HEX, WASHER HD .216-24 X 5/8 TAPPING TYPE (SWAGE FORM) STEEL ZINC PLATE 289A FINISH			
1751	40,41	12	901271031		SCREW, HEXAGON WASHER HEAD M6 X 16 STEEL, ZINC OLIVE DRAB CHROMATE FINISH THREAD FORMING QUALITY SCREW & NUT CO.			
1760	33	1	ED5D745-70,G1		STRIP, 5ESS-2000 CABINET INDICATOR			
1770	33	1	ED5D745-70,G2		STRIP, 5ESS-2000 CABINET INDICATOR			
1780	33	1	ED5D745-70,G3A		STRIP, 5ESS-2000 CABINET INDICATOR			
1790	33	1	ED5D734-14,G15		CABLE, MFFU POWER & ALARM			
1800	34	2	ED5D745-70,G1		STRIP, 5ESS-2000 CABINET INDICATOR			
1810	34	2	ED5D745-70,G3A		STRIP, 5ESS-2000 CABINET INDICATOR			
1820	34	1	ED5D734-14,G16		CABLE, MFFU POWER & ALARM			
1830	35	1	ED5D741-70,G2		ASSEMBLY, CABINET			S
1840	36	2	901249177		LABEL, DESIGNATION			20
1900	48,D	1	J5D003FJ-1,LCH		UNIT, MODULAR, FUSE/FILTER			
1910	48,E	1	J5D003FJ-1,LCK		UNIT, MODULAR, FUSE/FILTER			
1920	K	1	J5D003FJ-1,LCP		UNIT, MODULAR, FUSE/FILTER			
1930	L	1	J5D003FJ-1,LCR		UNIT, MODULAR, FUSE/FILTER			
2000	37	1	ED5D741-70,G1A		ASSEMBLY, CABINET			
2010	38	1	ED5D741-70,G2A		ASSEMBLY, CABINET			S
2020	39	1	ED5D741-70,G1B		ASSEMBLY, CABINET			
2100	40,41	1	ED5D785-70,G1A		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			
2110	40	1	ED5D785-70,G2A		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2120	41	1	ED5D785-70,G2B		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2130	41	1	ED5D785-70,G4		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2140	42	2	ED5D785-70,G3A		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2150	43	2	ED5D785-70,G3B		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2160	44	1	ED5D785-70,G3A		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S

***** STOCKLIST CONTINUED AT RIGHT *****

STOCKLIST								
ITEM NBR	LIST GROUP CODE	QTY PER CODE	PRODUCT IDENTIFIER	CODE	DESCRIPTION	REFERENCE POSITION	NOTE	
							SYM	NBR
2170	44	1	ED5D785-70,G3C		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2180	45	1	ED5D785-70,G3B		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2190	45	1	ED5D785-70,G3D		ASSEMBLY, GLOBAL SINGLE BAY FR & CAB			S
2200	F	1	847337524		KIT, JUNCTION UNITIZED (NEMC)			
2210	G	1	847337557		KIT, JUNCTION NON-UNITIZED (NEMC)			*
2220	H	1	847337565		KIT, JUNCTION UNITIZED (EMC)			
2230	J	1	847337573		KIT, JUNCTION NON-UNITIZED (EMC)			*

***** END OF STOCKLIST *****

TABLE JJ

TABLE JJ STOCKLIST ORDERING COMCODES TO INDIVIDUAL/SINGULAR COMCODES CROSS REFERENCE		
STOCKLIST ORDERING COMCODE	INDIVIDUAL/SINGULAR COMCODE	COMMENTS
406663971	406747501	WP91768,L104 .50 AMP - FAST ACTING FUSE
406599308	406747519	WP92458,L2 1.25 AMP - VERY FAST ACTING FUSE
406708545	406747527	WP91768,L107 2 AMP - FAST ACTING FUSE
406693895	406747535	WP91768,L108 3 AMP - FAST ACTING FUSE
406693887	406747543	WP91768,L110 5 AMP - FAST ACTING FUSE
406693903	406747550	WP91768,L112 7 AMP - FAST ACTING FUSE
406599324	406747568	WP92458,L11 10 AMP - VERY FAST ACTING FUSE
406599332	406747576	WP92458,L12 12 AMP - VERY FAST ACTING FUSE
406599357	406808469	WP92458,L13 15 AMP - VERY FAST ACTING FUSE
406759050	406808477	WP92458,L14 20 AMP - VERY FAST ACTING FUSE

COPYRIGHT © 1995 AT&T
ALL RIGHTS RESERVED

BT13

5ESS* SWITCHING EQUIPMENT
SPECIFICATION FOR
MODEM POOLING CABINET
* AT&T TRADEMARK

DWG SIZE C2 ISSUE 10

AT&T

J5D007B-1

SHEET D3 OF 28

PRINTED IN U.S.A.

J5D007B-1