


\* MAKES LAST

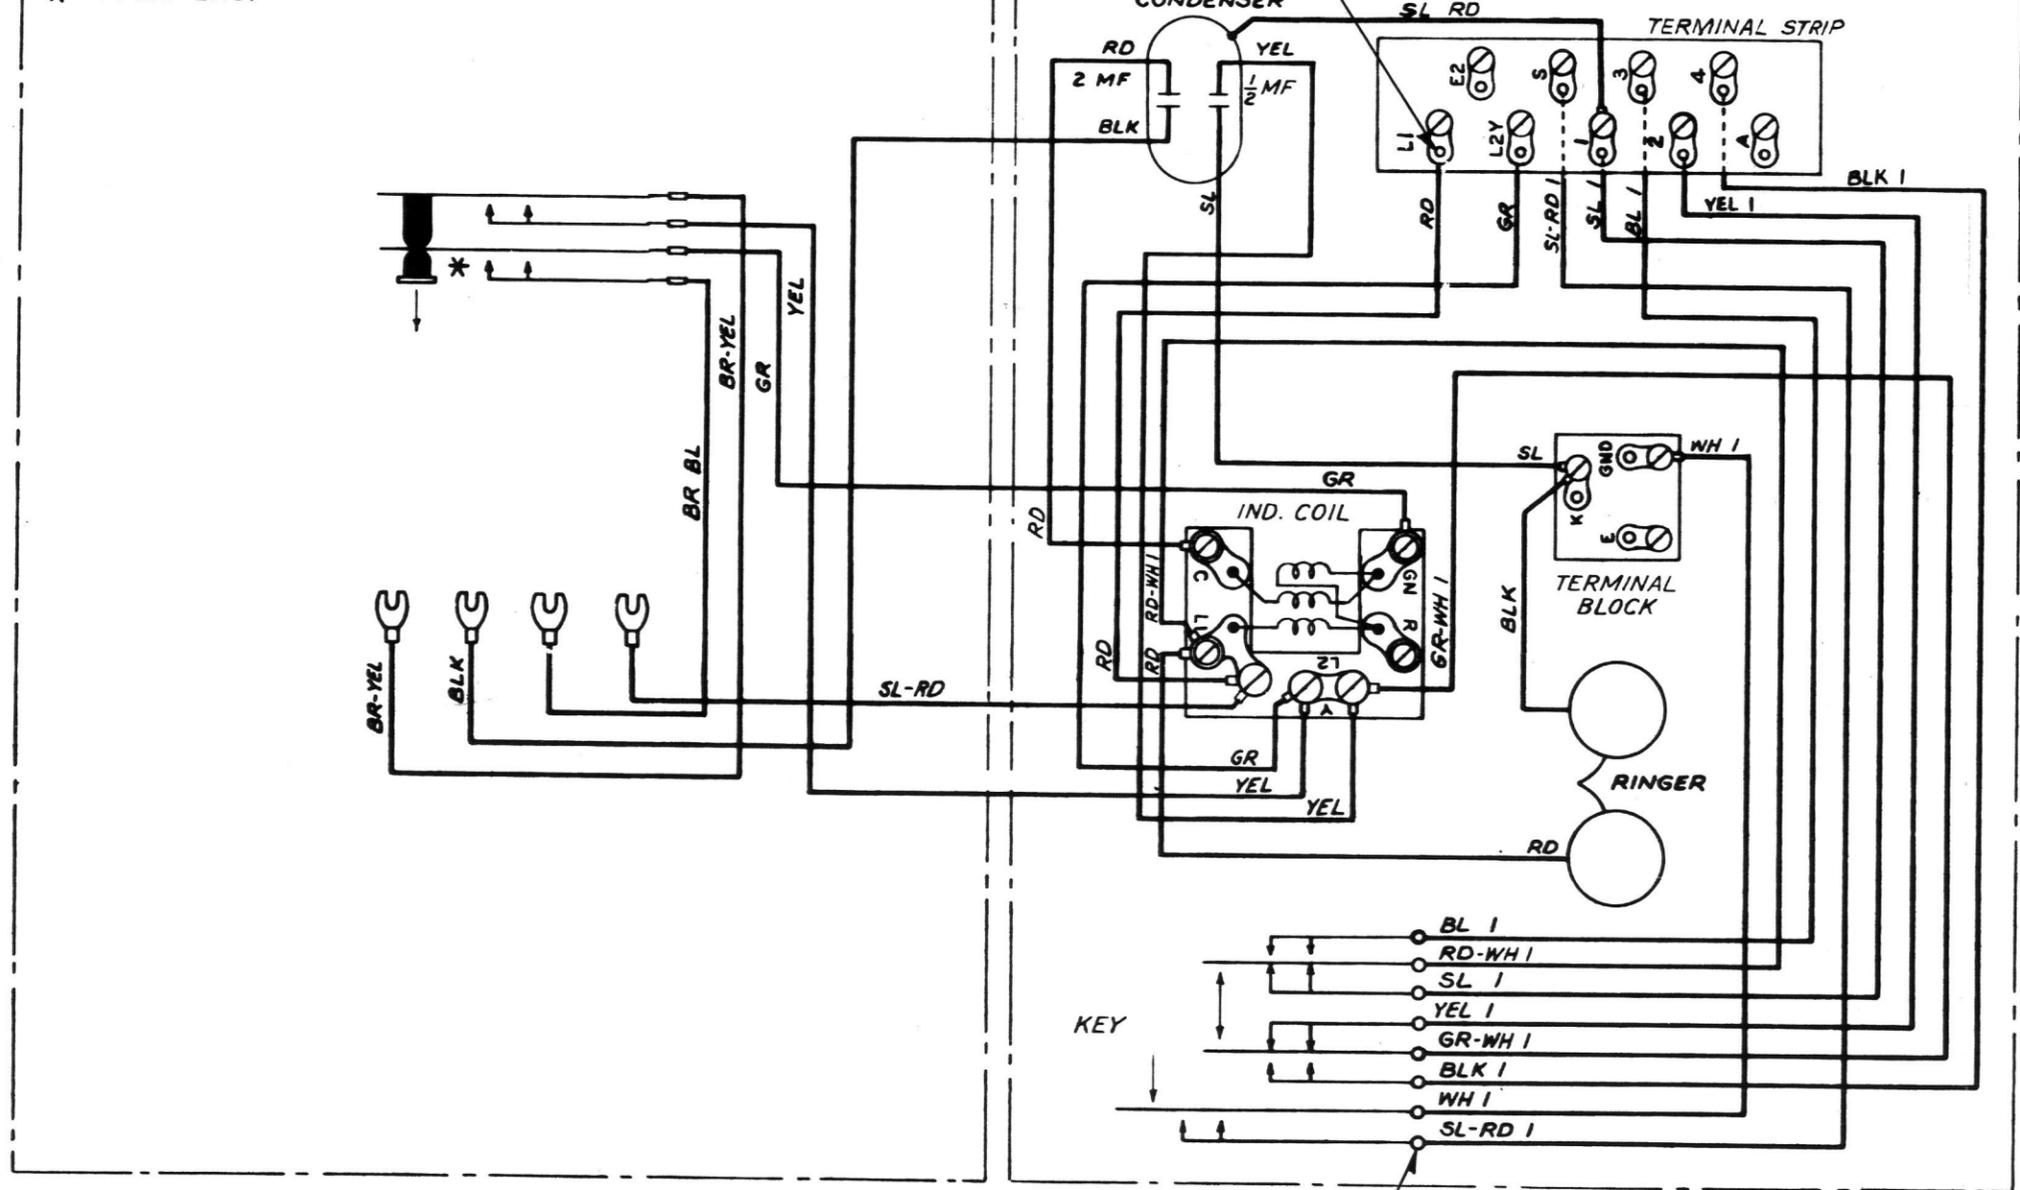

NOTES:

1. WIRES DESIGNATED "1" ARE ITEM 57B TO ITEM 64B, LA800102, GROUPED AS SHOWN ON CORDING DIAGRAM.
2. ENDS OF WIRES WITHOUT CORD TIPS SHALL BE SOLDERED TO THEIR RESPECTIVE TERMINALS.
3. ALL SOLDERED CONNECTIONS SHALL BE MADE IN ACCORDANCE WITH KS-512, METHOD C.

4. WIRES SHOWN UNCONNECTED SHALL BE CONNECTED AS SHOWN ON WIRING DIAGRAMS FOR THE #10 TYPE TELEPHONE SETS.

5. RD. WIRE OF RINGER, YEL. AND SL. WIRES OF CONDENSER, AND RD-WH 1 AND GR-WH 1 WIRES OF KEY MAY BE CONNECTED TO DIFFERENT TERMINALS FOR DIFFERENT CODED TELEPHONE SETS AND FOR INSTALLATION WIRING ARRANGEMENTS.

6. (L-FINISH IN ACCORDANCE WITH LA850112-33, FIG 84.)

7. (L-FINISH IN ACCORDANCE WITH LA850112-33, FIG 85A.)

LA-701297

L - DESIGNATES GUIDANCE INFORMATION

DIMENSIONS UP TO AND INCLUDING 72 INCHES EXPRESSED IN INCHES

LA-701297 A-  
ISSUE

USED ON DWG.

● DENOTES MANUFACTURE DISCONTINUED

J1 TYPE TELEPHONE SET MOUNTING WIRING DIAGRAM

SCALE ~  
DRAWN APPROVED  
CHECKED

WESTERN ELECTRIC CO. INC.  
ENGINEER OF MANUFACTURE

LA-701297  
#  
L

ISSUE 8 4-28-44  
REPRODUCED DUE TO EXTENSIVE CHANGES IN NOTES.  
E.I. J.A. CAJ  
CO-130692  
ISSUE 9 10-27-42  
NOTES 6, 7 WERE NOT SPEC.  
"K.M.P.O." WAS NOT SPEC.  
NPB J.C. ECG  
CO 162933  
ISSUE 10 1-24-50

APPLS  
DR. LITHO. CH. ENG. J.M.H.  
BELL TELEPHONE LABORATORIES, INC. NEW YORK  
ES  
LA-701297