

BELL SYSTEM PRACTICES
Teletypewriter and Data Stations

ADDENDUM P34.309
Issue 1, February, 1963
AT&TCo Standard

**28D, D-1, D-2, K AND U ELECTRICAL
SERVICE UNITS FOR 28-TYPE
TYPING REPERFORATOR**


WIRING DIAGRAM

1. GENERAL

- 1.001 This addendum supplements Section P34.309, Issue 3.
- 1.002 This addendum is issued to add the wiring of the 28U electrical service units, and to change the title accordingly.

28D AND 28U ELECTRICAL SERVICE UNITS

SEE NOTE 2

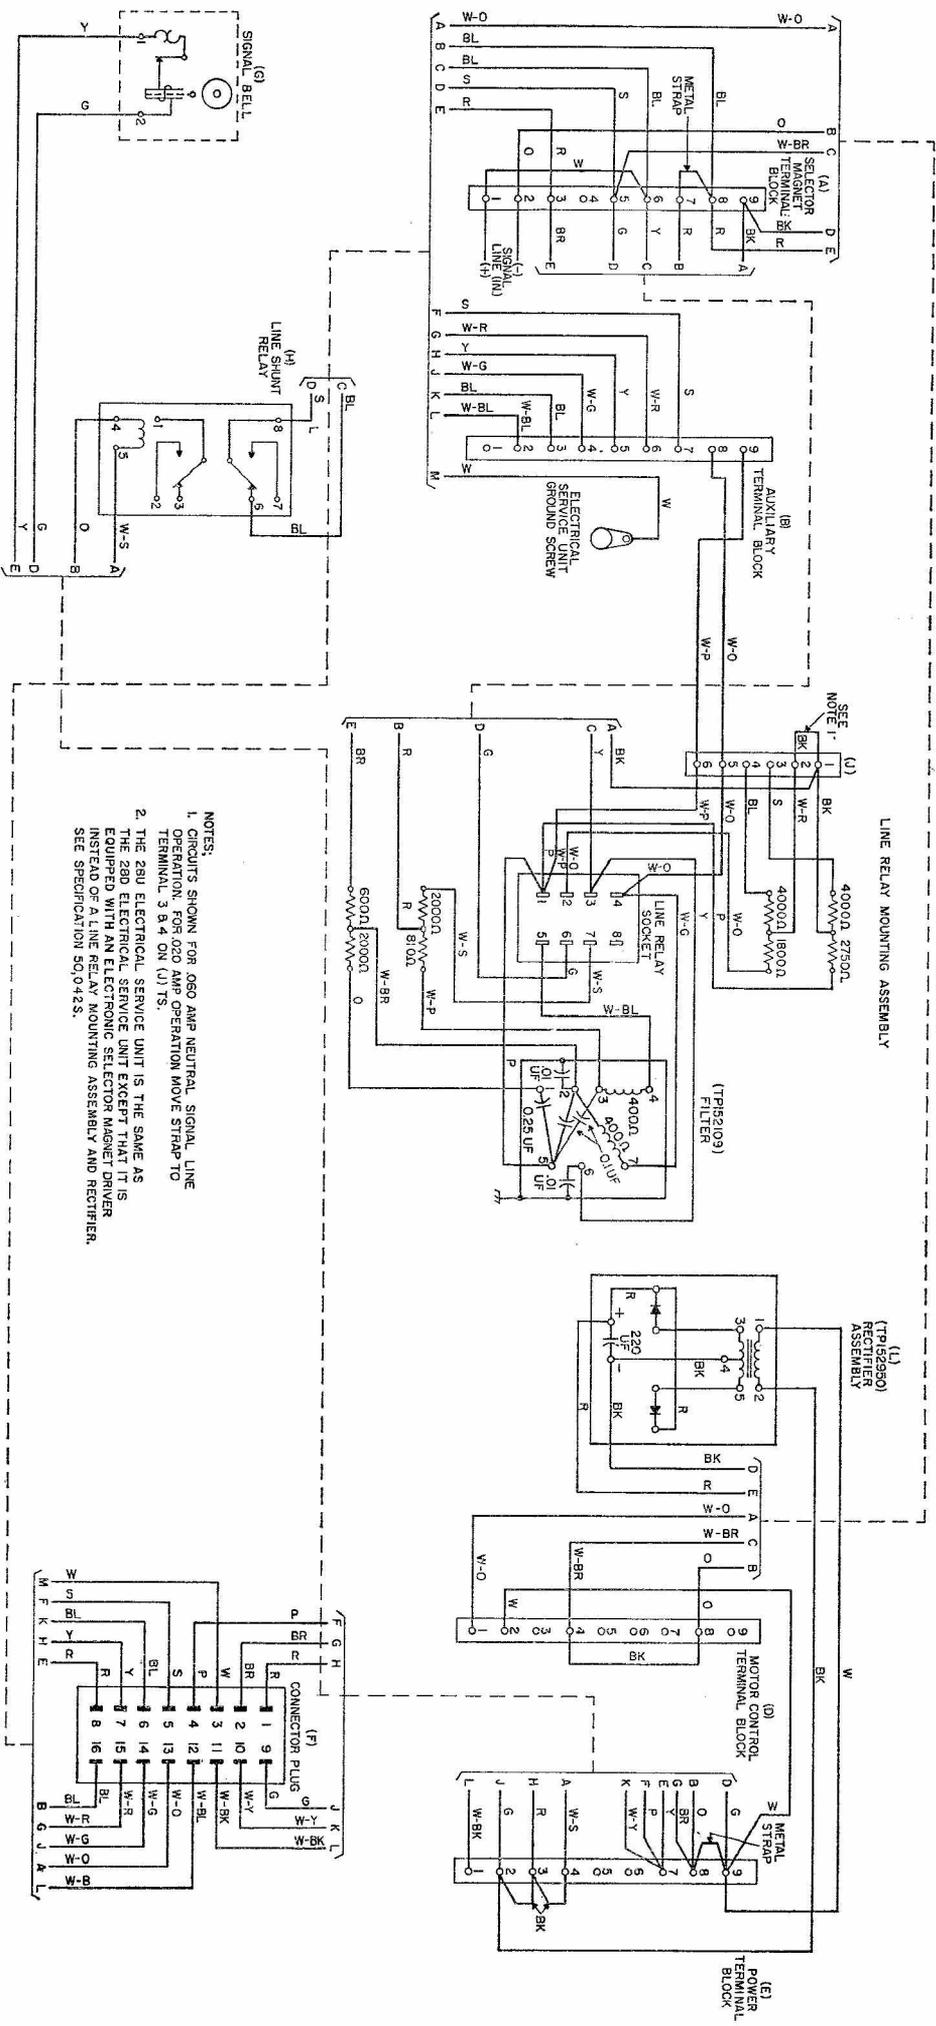

- NOTES:
1. CIRCUITS SHOWN FOR 200 AMP NEUTRAL SIGNAL LINE OPERATION. FOR 100 AMP OPERATION MOVE STRAP TO TERMINAL 3 & 4 OR (J) 7 & 8.
 2. THE 28U ELECTRICAL SERVICE UNIT IS THE SAME AS THE 28D ELECTRICAL SERVICE UNIT EXCEPT THAT IT IS EQUIPPED WITH AN ELECTRONIC SELECTOR MAGNET DRIVER. SEE SPECIFICATION SO.0442S.

28D and 28U Electrical Service Units