

15 TYPE TYPING UNIT & 15C BASE
 (REFER TO FIG. 6 & 14 B.S.P. P36.301)

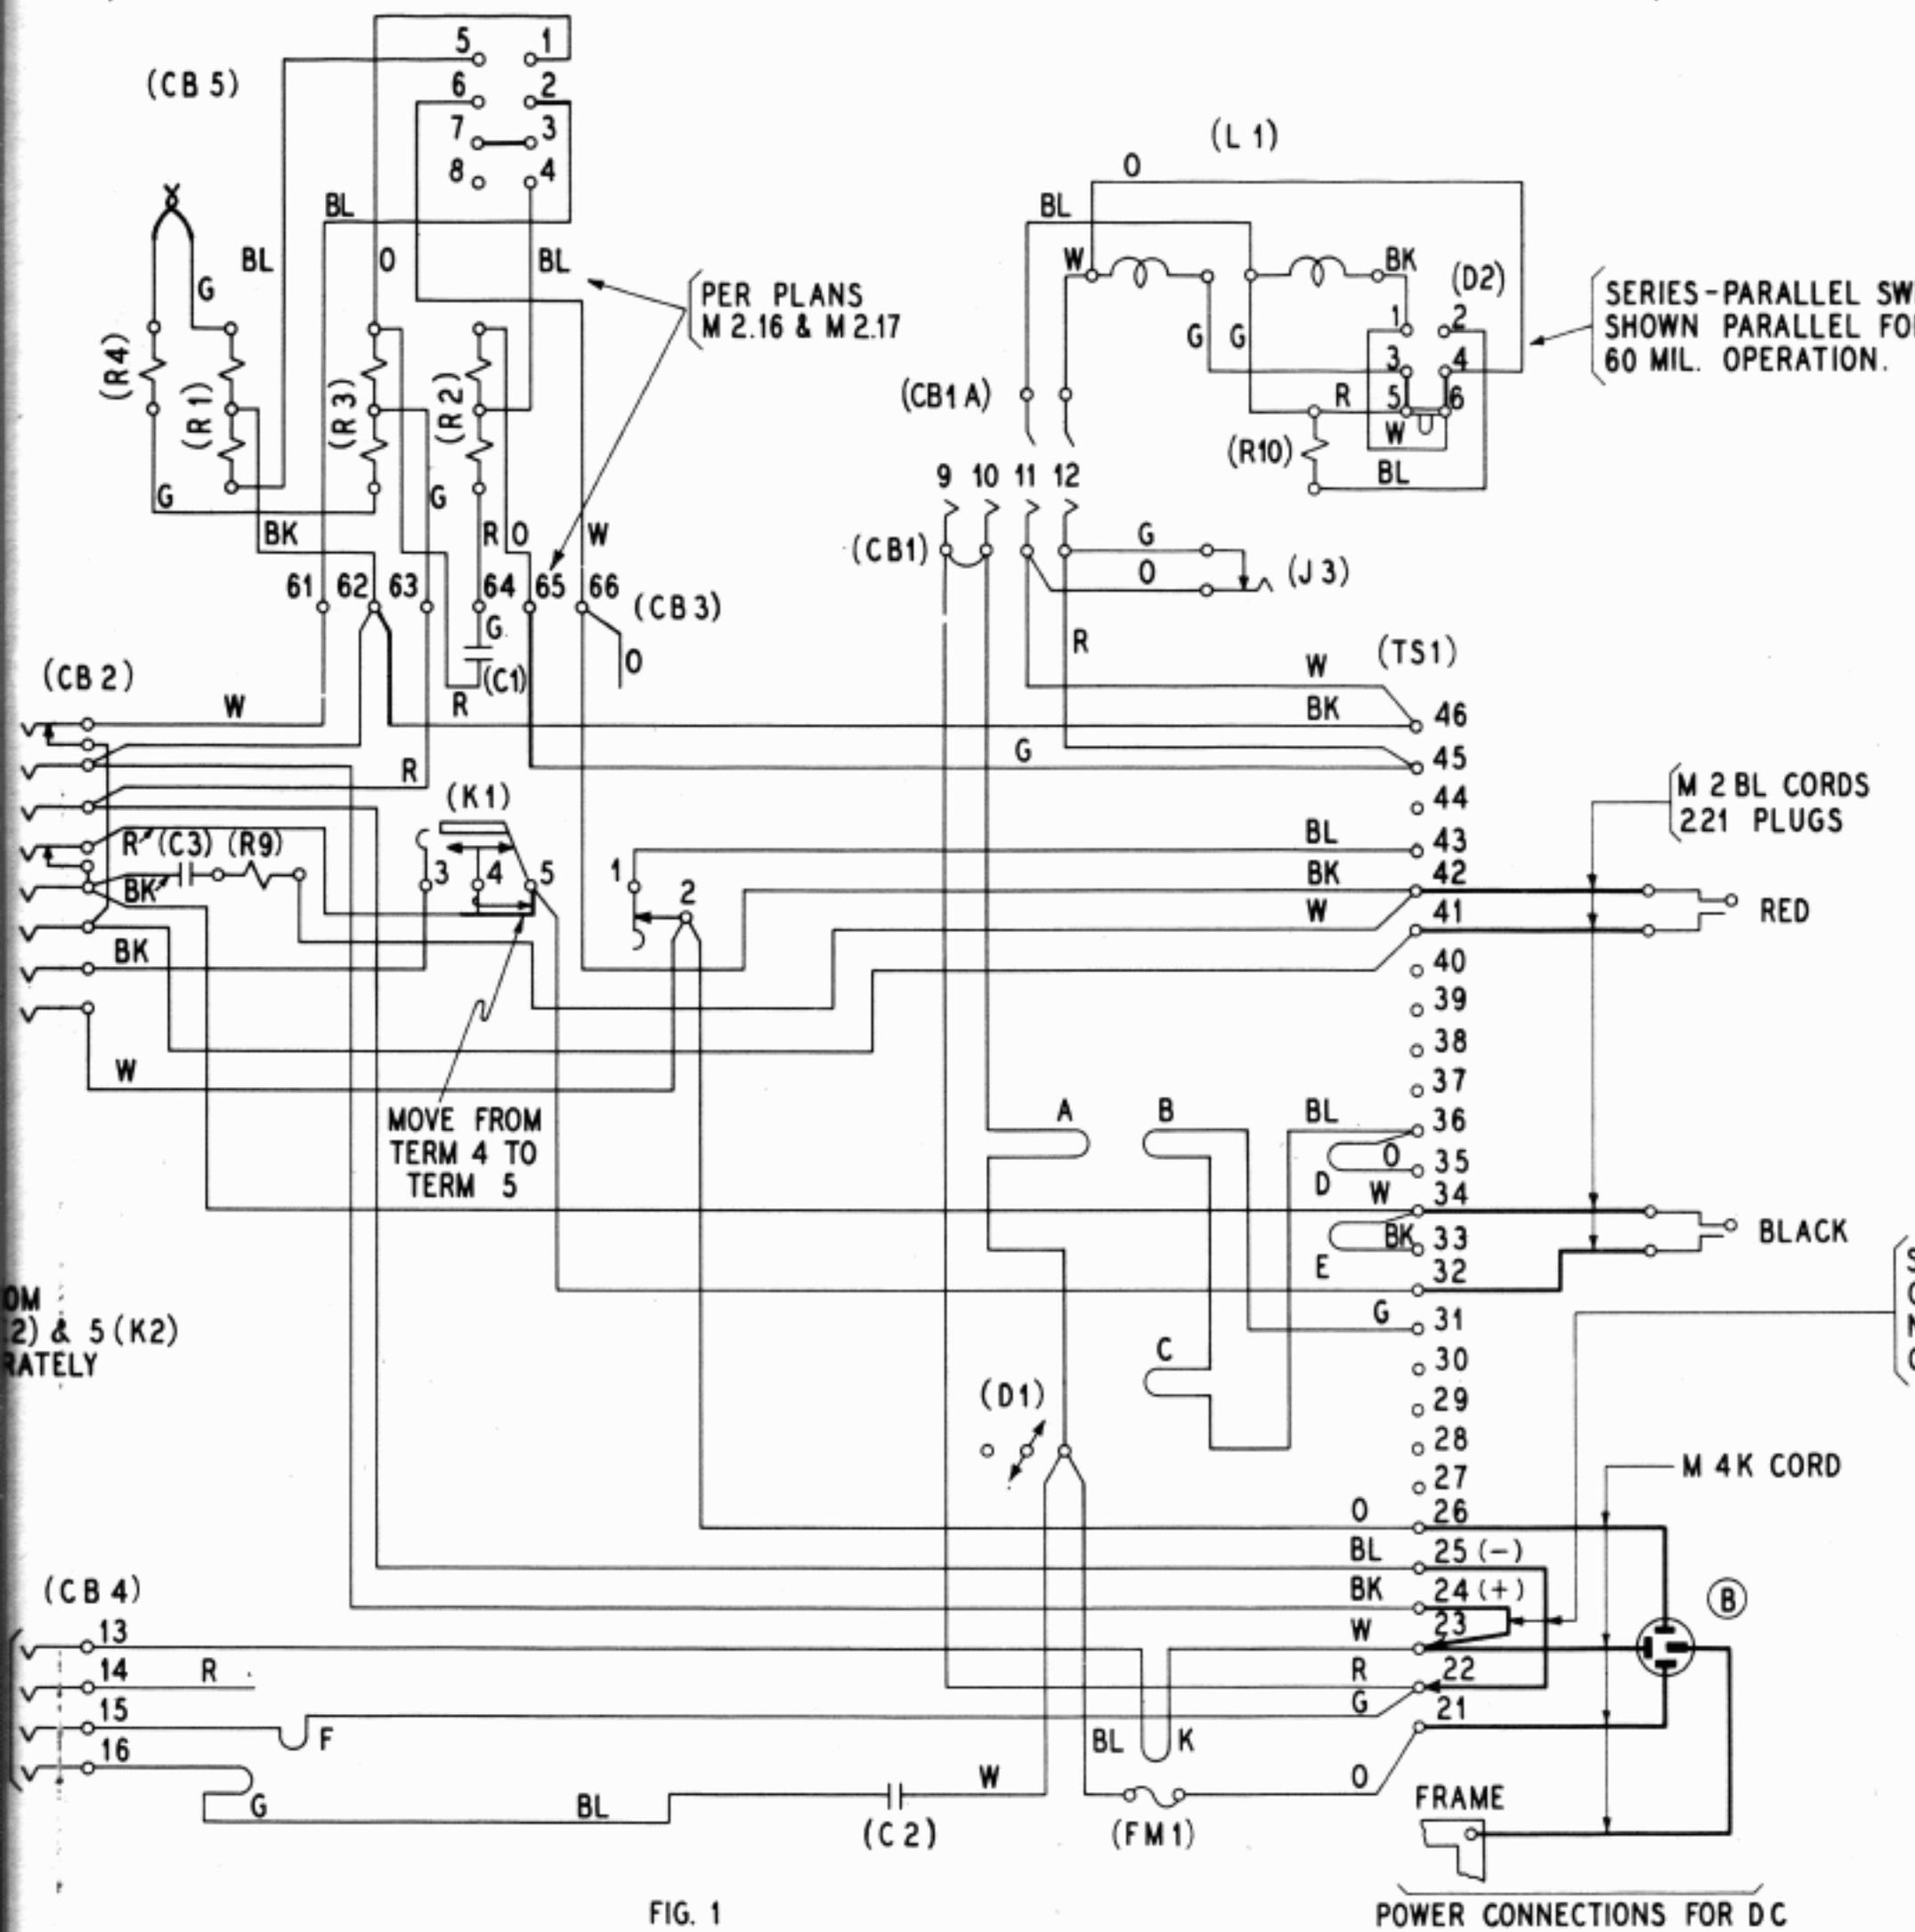


FIG. 1



POWER CONNECTIONS FOR DC

E
01)


BELL SYSTEM PRACTICES
TELETYPEWRITER STATION
INSTALLATION AND MAINTENANCE
REPRODUCED FROM DWG. 20721-106

SECTION P 90.918
ISSUE C APRIL 1944
LONG LINES DEPT.

Dist. Class. 602.054C

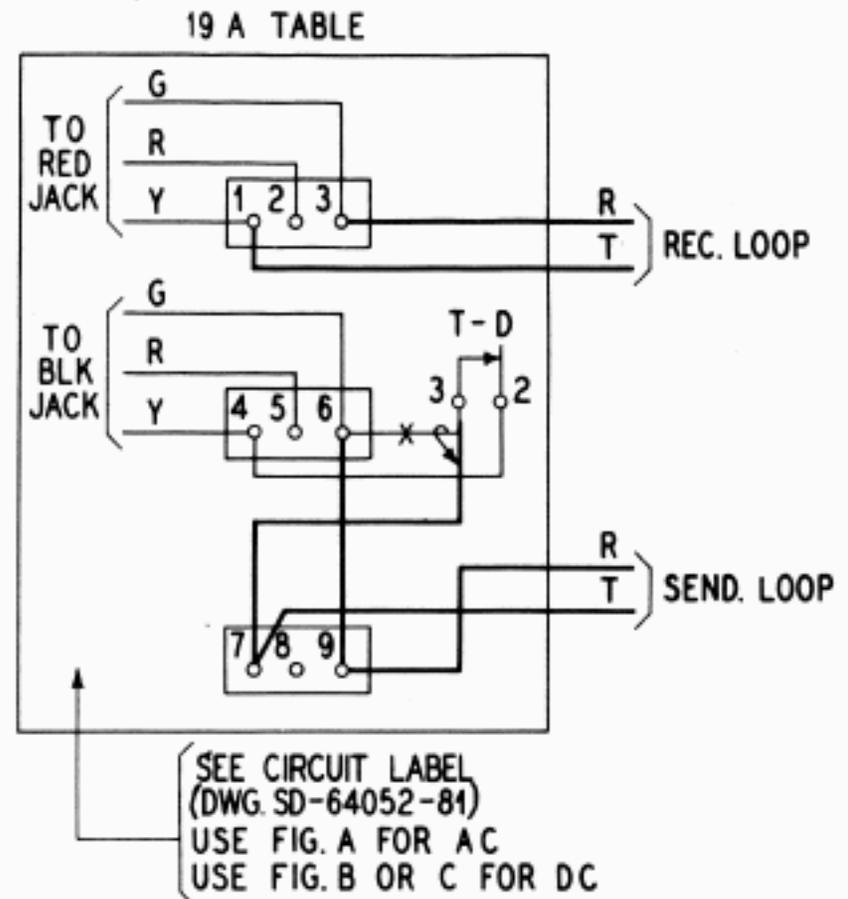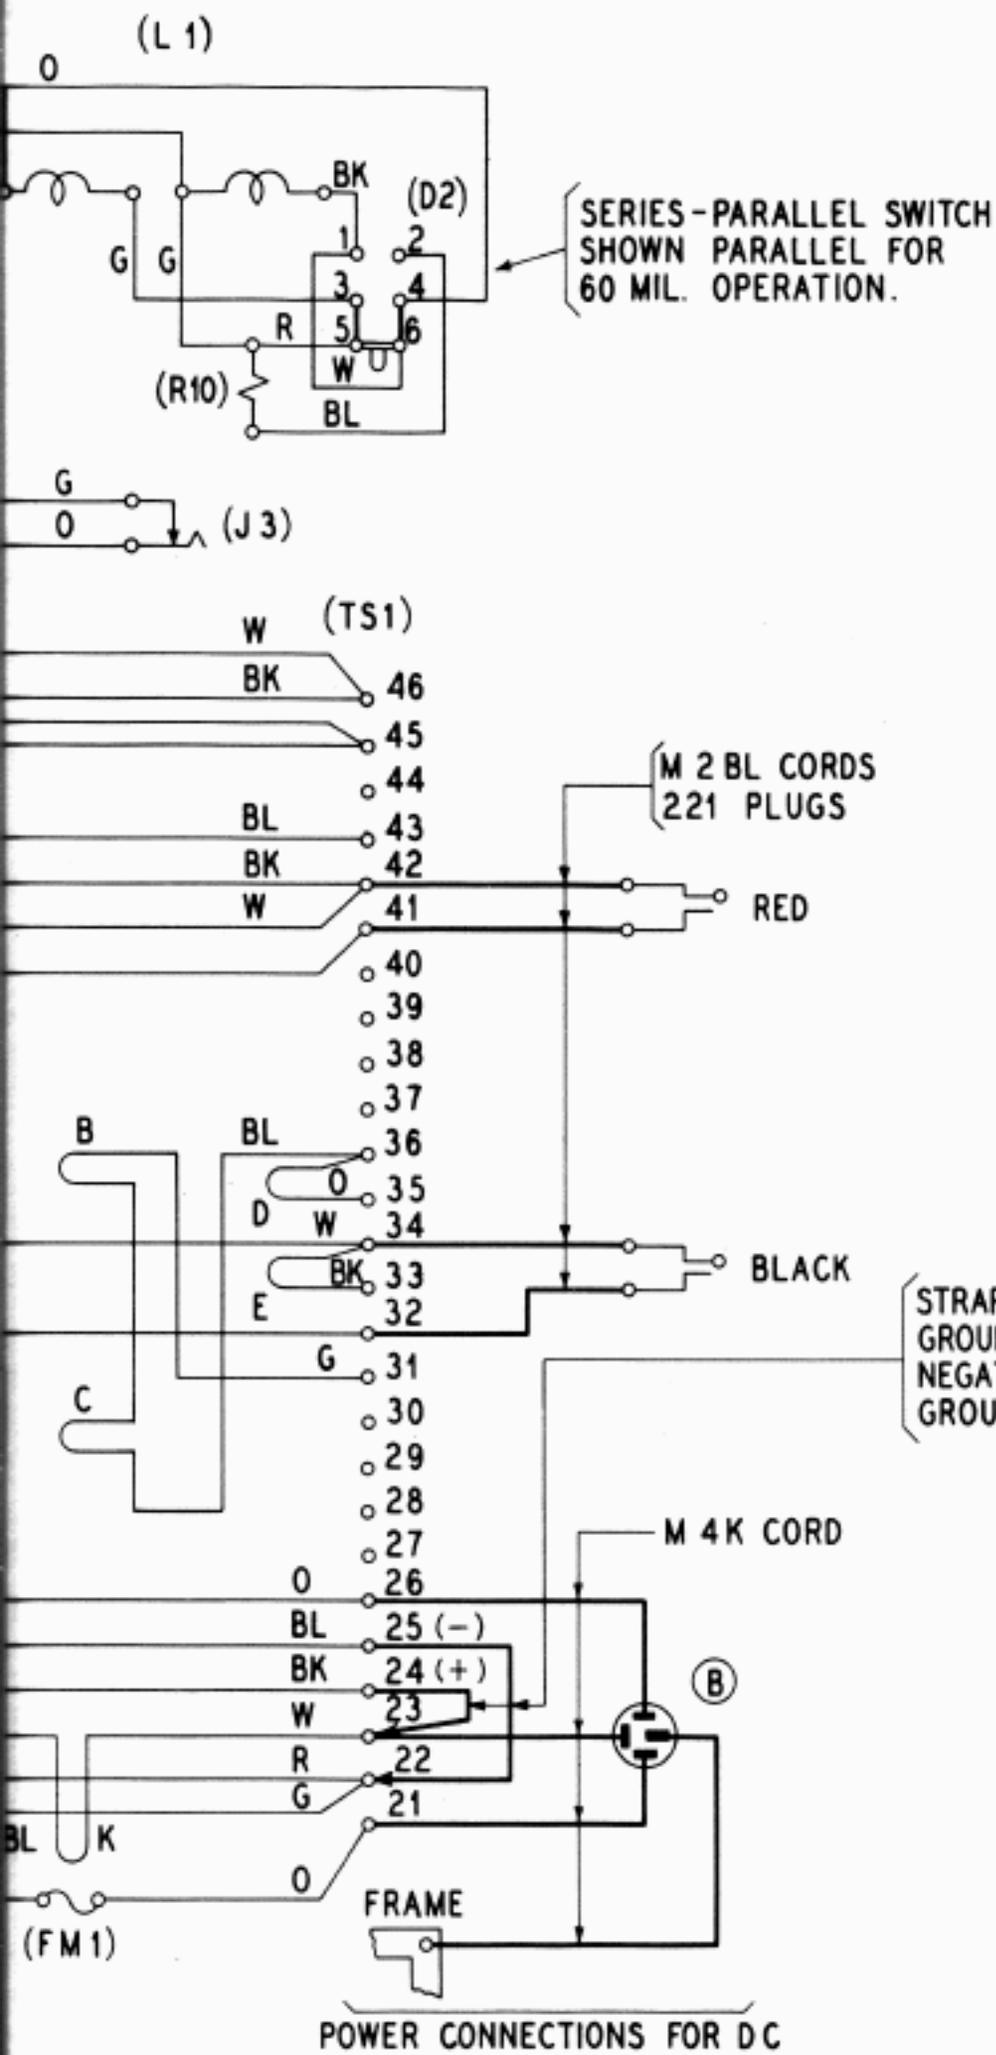

STRAPS SHOWN FOR POSITIVE GROUNDED. INTERCHANGE FOR NEGATIVE GROUNDED OR NON-GROUNDED.

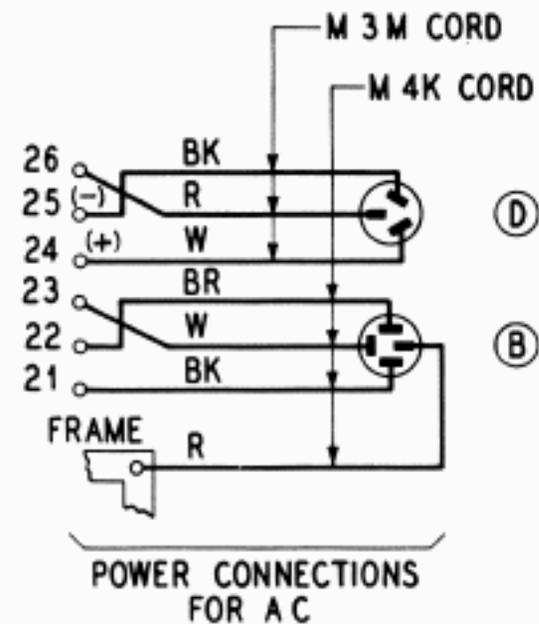

TELETYPEWRITER SYSTEMS
CIRCUIT ARRANGEMENT AND
OPERATING FEATURES OF
19A TTY SET (15C BASE) AS USED FOR
PRESS ASSOCIATION INC. TTY SERVICE
AC OR DC COMMERCIAL POWER.