

BELL SYSTEM PRACTICES
 TELETYPEWRITER STATIONS

FIG. E




FIG. C




FIG. F




FIG. D





FIG. 1

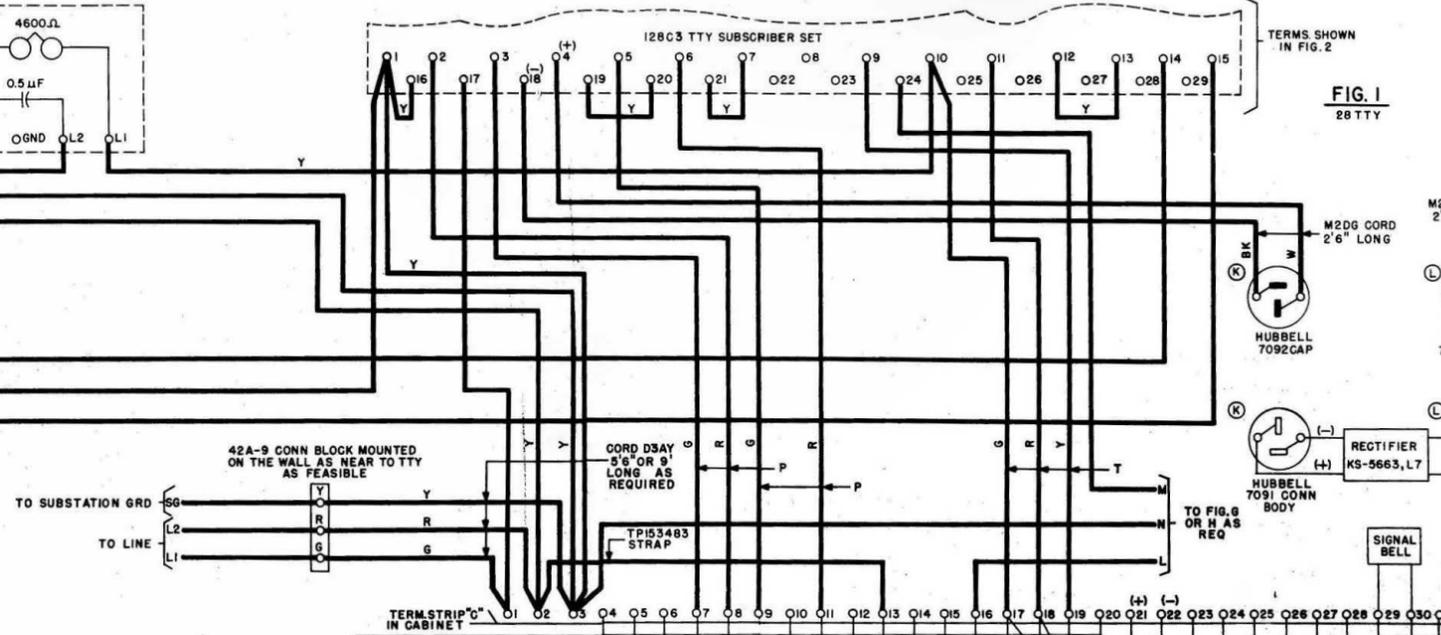


FIG. 2

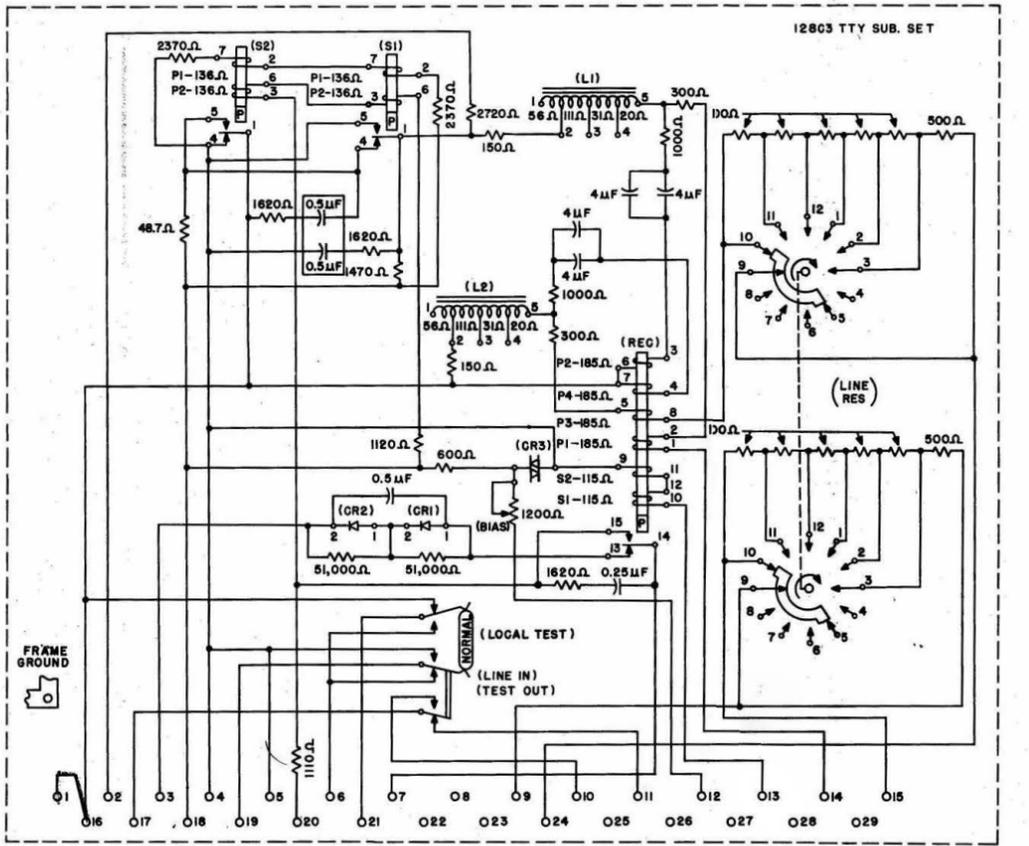


FIG. G





FIG. H




- NOTES:
- BROKEN LINES T2 INDICATE LEADS CARRIED THROUGH CORRESPONDINGLY NUMBERED CONTACTS OF PLUG AND SOCKET CONNECTORS. T INDICATES TYPING UNIT CONNECTOR; K, KEYBOARD.
 - INDICATES CONNECTIONS TO BE ADDED OR CHECKED FOR THEIR EXISTENCE. UNLESS OTHERWISE SPECIFIED ALL SUCH LEADS SHALL BE 22 GAUGE, BROWN, TYPE GS STATION WIRE PER AT&T SPEC. 7089.
 - INDICATES UNIT WIRING TO BE CONNECTED AS SHOWN.
 - THE 128C3 TTY SUBSCRIBER SET, THE 152A1 60° INDUCTION SUPPRESSION UNIT (WHEN REQUIRED), THE KS-5663, L7 RECTIFIER, AND THE 531A3 SUB. SET SHALL BE MOUNTED IN THE 28B TTY CABINET.
 - PROVIDE FIG. C OR D, FIG. E OR F, AND FIG. G OR H AS REQUIRED.
 - THE 128C3 TTY SUBSCRIBER SET SHALL BE ADJUSTED AND STRAPPED FOR LINE CONDITIONS IN ACCORDANCE WITH B.S.P. INSTRUCTIONS IN THE "P" SERIES.
 - THE FOLLOWING EQUIPMENT IS REQUIRED:

28B TTY CABINET
28B ELECTRICAL SERVICE ASSEMBLY
28A TYPING UNIT
28C TTY BASE
28A MOTOR UNIT
128C3 TTY SUBSCRIBER SET
KS-5663, L7 RECTIFIER

FIG. 3

28B ELECTRICAL SERVICE UNIT
 EQUIPMENT ARRANGEMENT

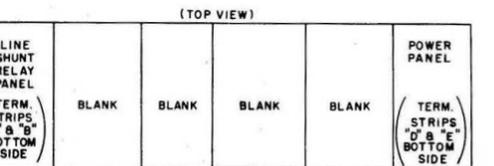

28 TYPE TELETYPEWRITER
 IN 28B TTY CABINET
 ATTENDED TWX SERVICE
 128C3 TTY SUBSCRIBER SET
 120VOLT AC POWER SUPPLY