


FIGURE 1

X-19130

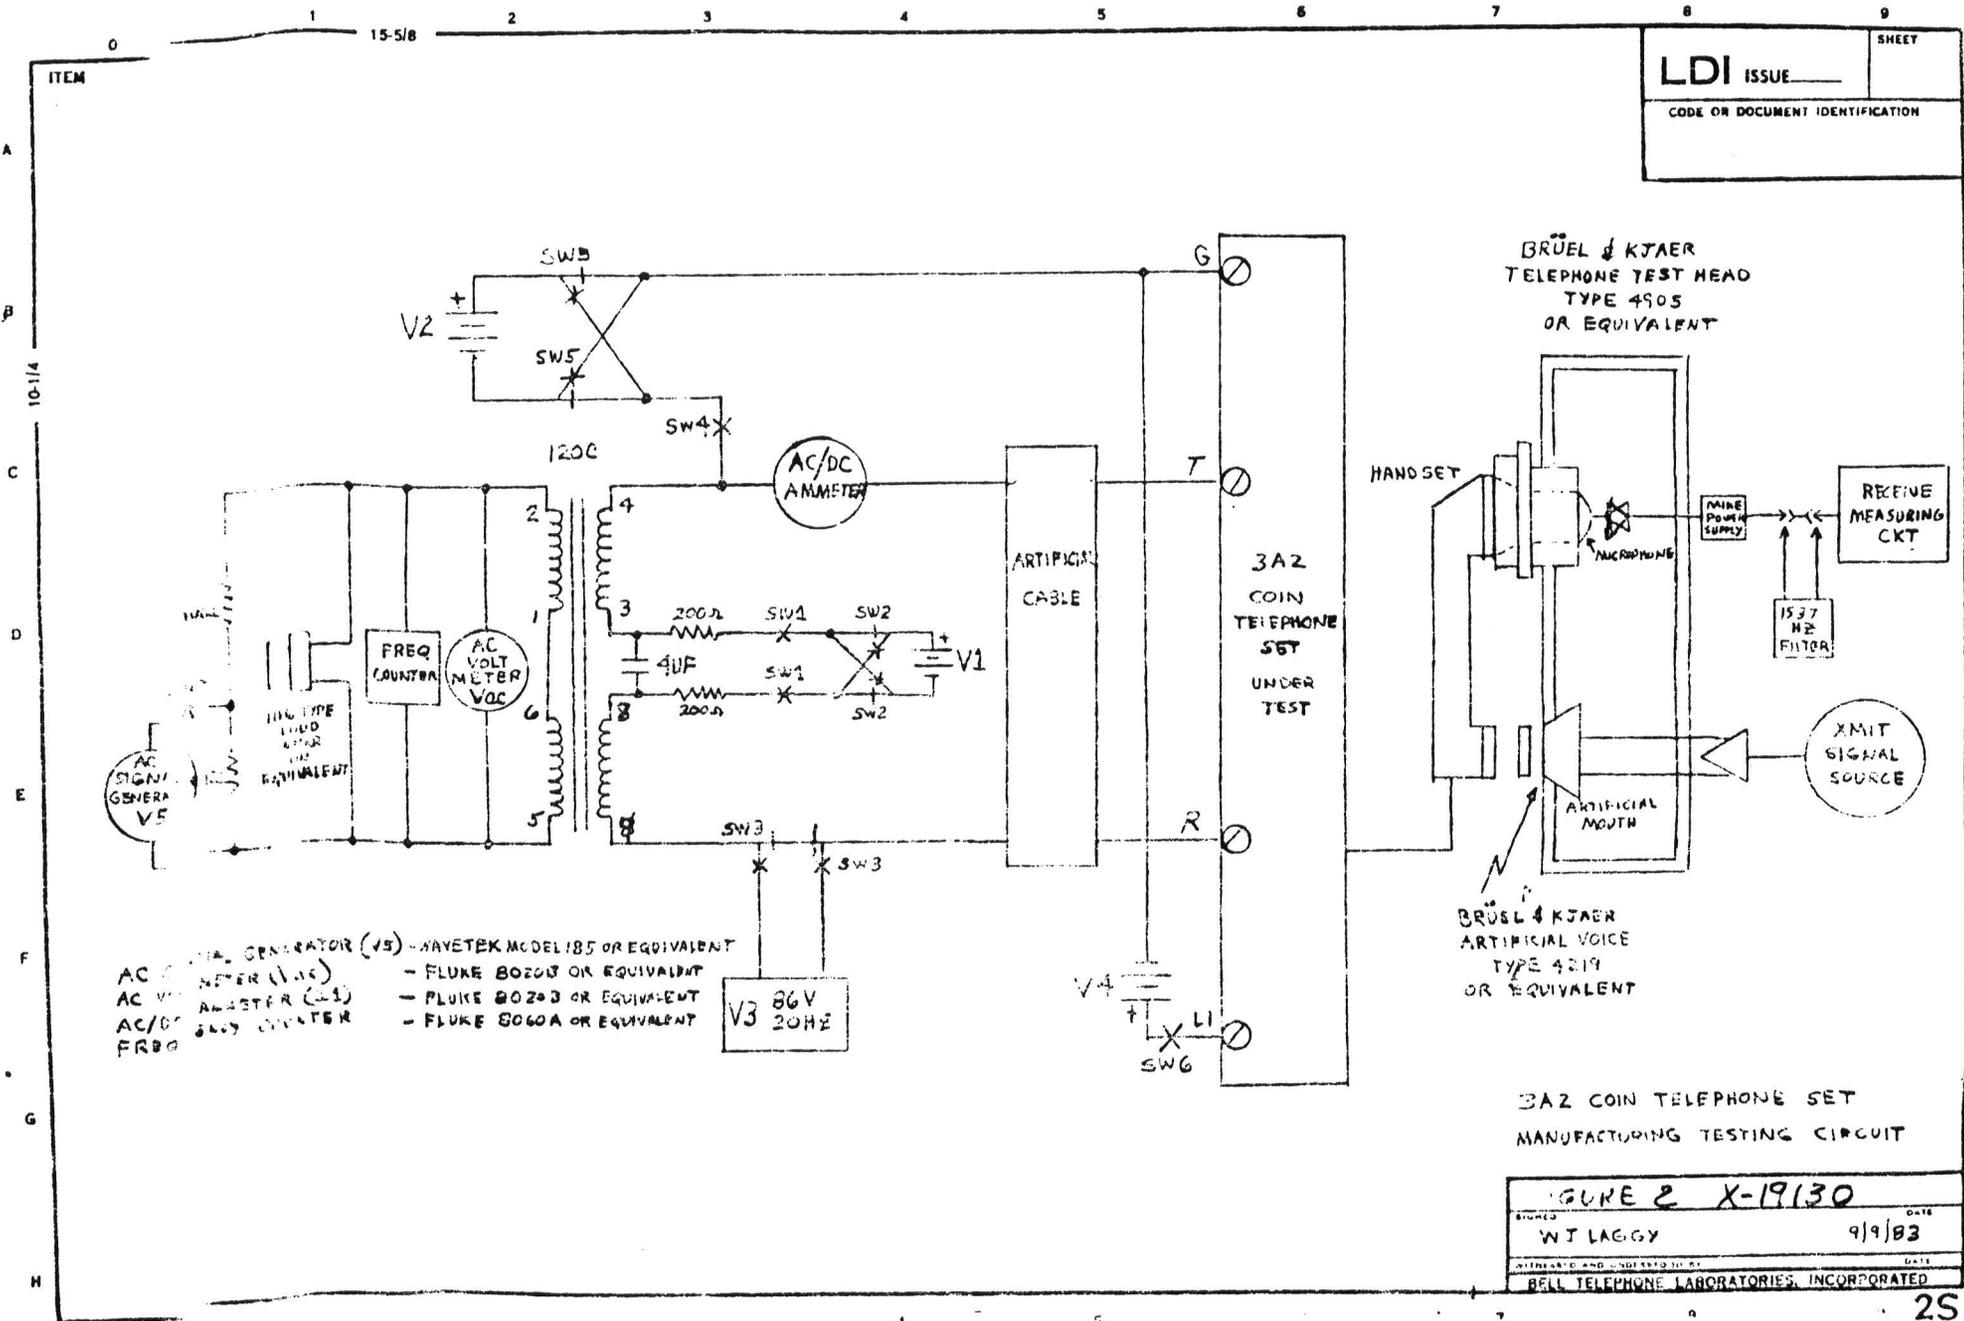

- AC SIGNAL GENERATOR (V5) - MAYTEK MODEL 185 OR EQUIVALENT
  - AC VOLT METER (VAC) - FLUKE 80203 OR EQUIVALENT
  - AC/DC METER (A) - FLUKE 80203 OR EQUIVALENT
  - FREQ. COUNTER - FLUKE 8060A OR EQUIVALENT
- V3 36V 20HZ

3A2 COIN TELEPHONE SET  
 MANUFACTURING TESTING CIRCUIT

FIGURE 2 X-19130	
DRAWN WT LAGGY	DATE 9/9/83
BELL TELEPHONE LABORATORIES, INCORPORATED	